
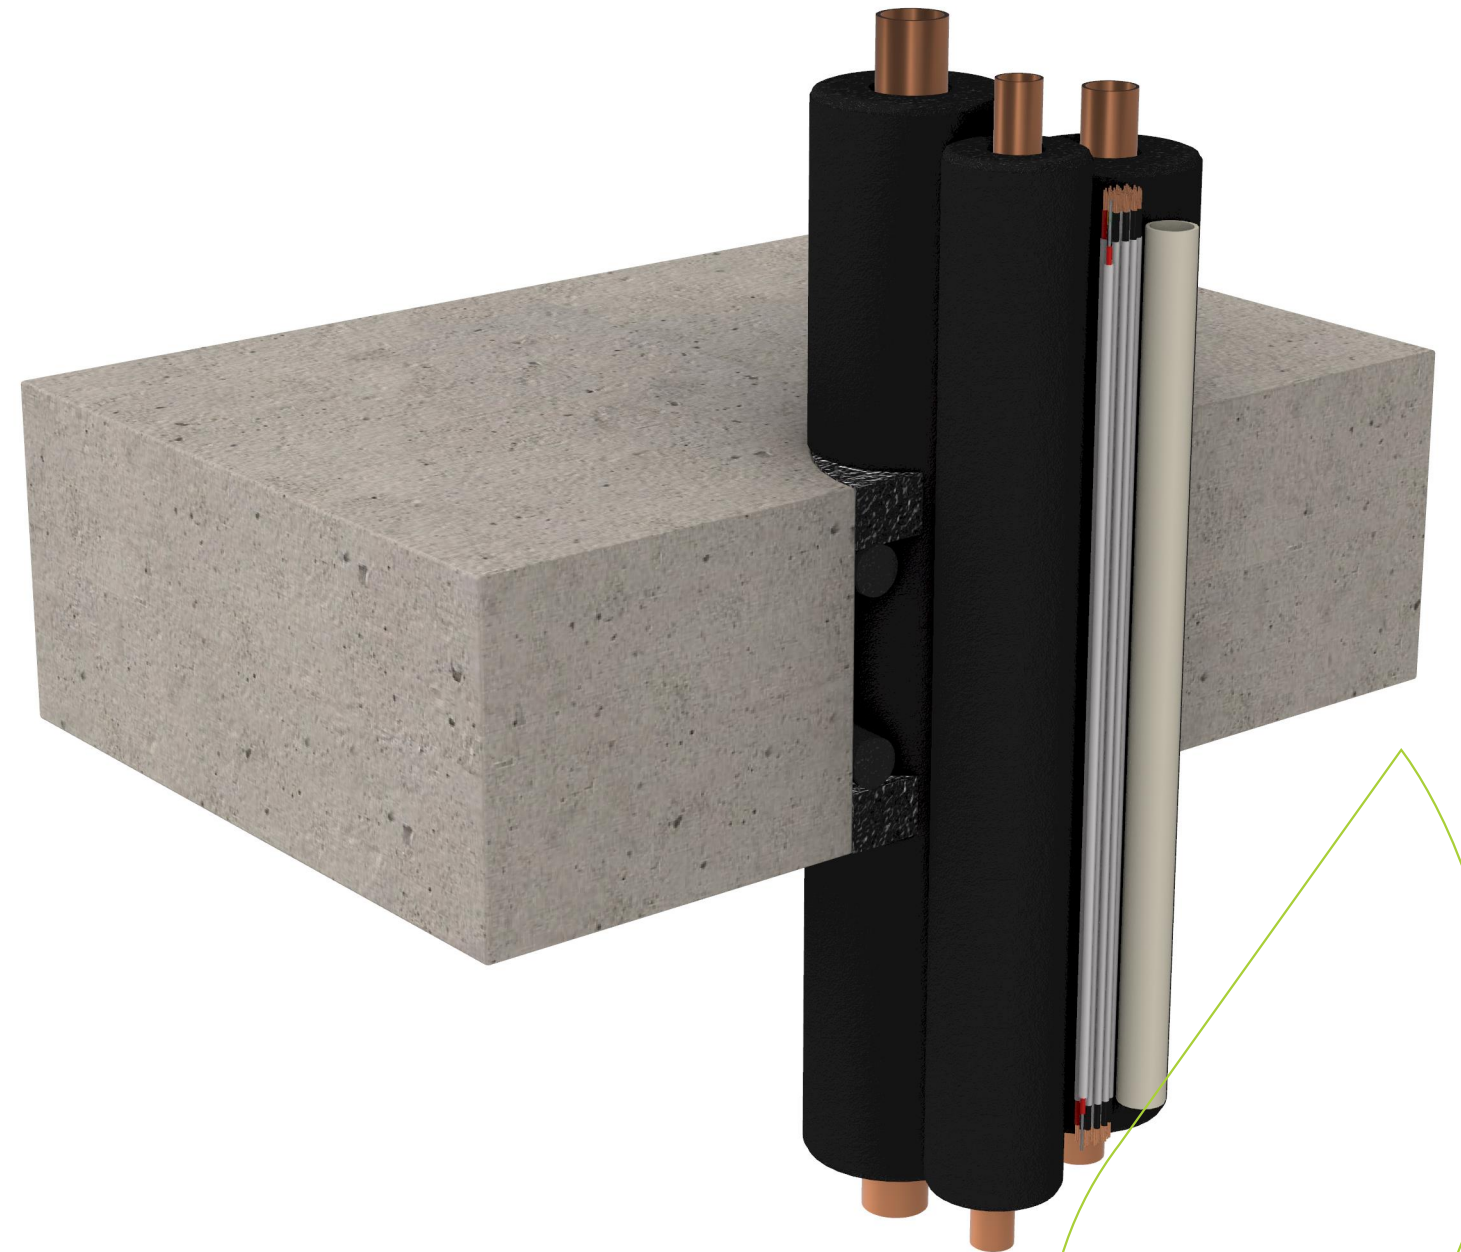


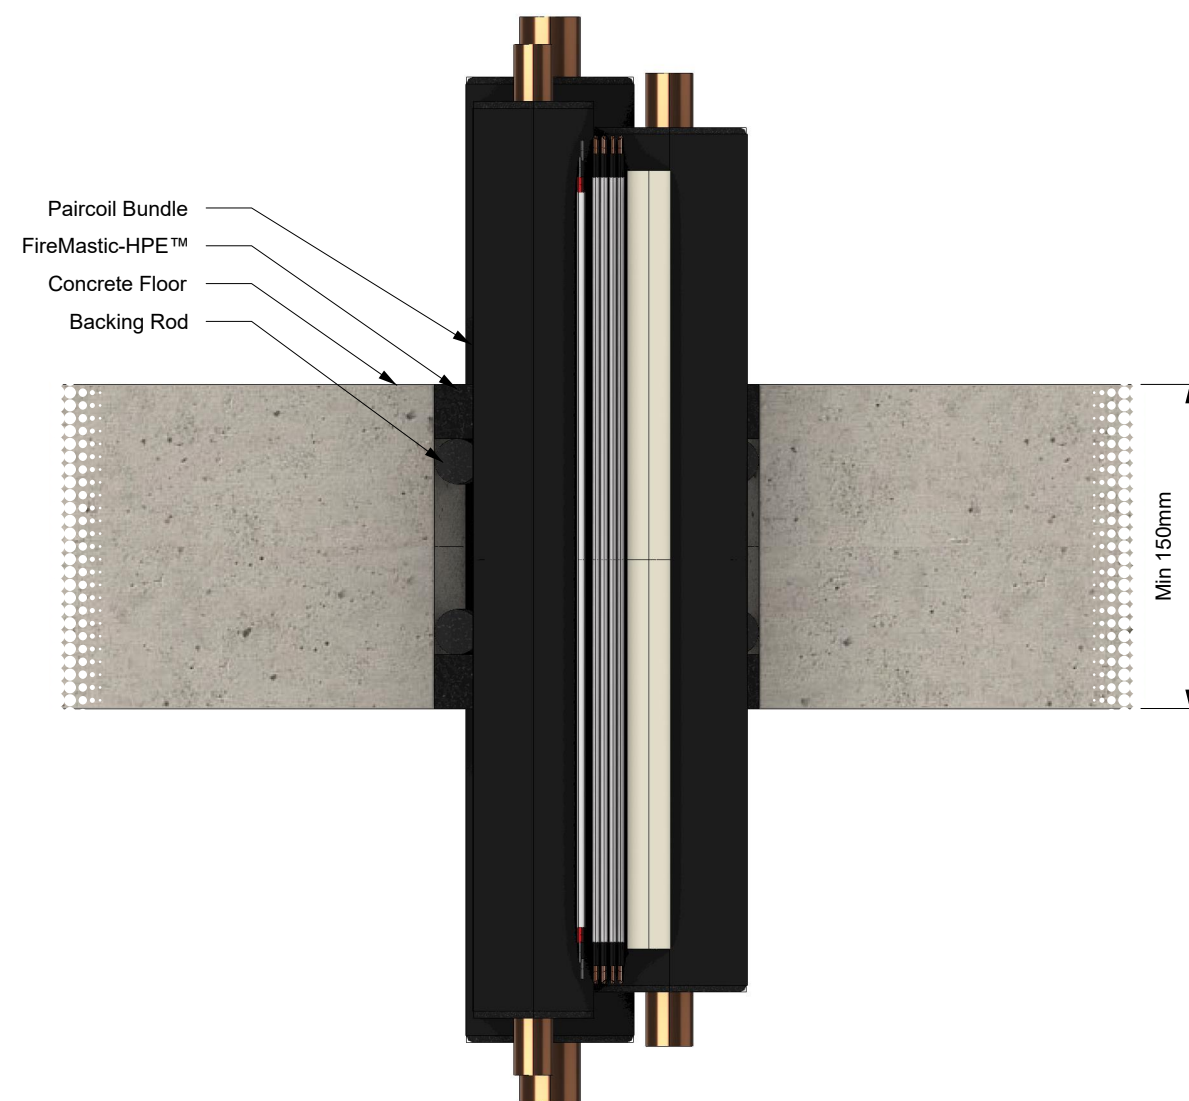

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS FireMastic-HPE™	-	- Up to 1 1/8" (28.3 mm) copper pipe with 25 mm thick E-Flex ST lagging - Up to 7/8" (22 mm) copper pipe with 25 mm thick E-Flex ST lagging - Up to 1 x 18 mm copper pipe with 19 mm thick lagging - Up to 1 x 20 mm uPVC condensate pipe (WT 1.5 mm). - Up to 2 x 2.5 mm² 3C+E TPS Power Cable - Up to 2 x 2.5 mm² 2C+E TPS Power Cable - Istrolex control cable Sealant to depth of 25 mm in annular gap to backing rod finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	HVAC	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		WF FAS 190335	
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2213.25	
Min Substrate Thickness (mm):	150	150	-		Date:	23/01/25	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/240/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.