


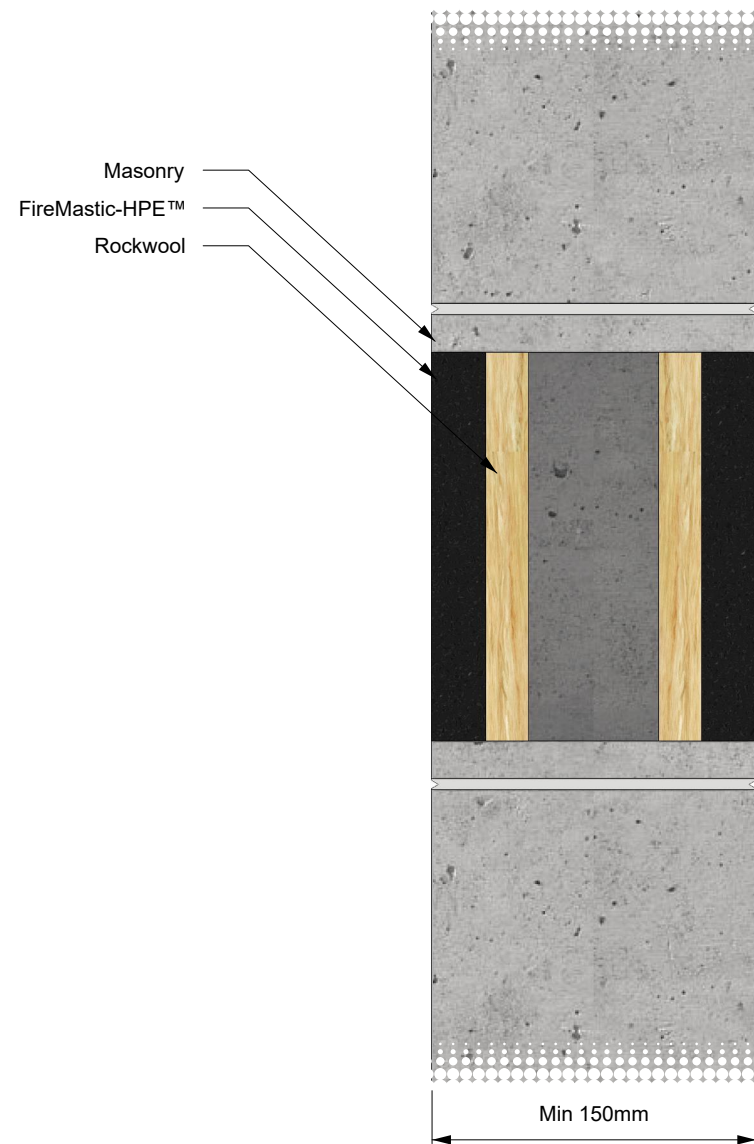

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Aperture size of 180 mm x 180 mm. Sealant 25 mm deep in aperture applied flush with both sides of the wall. The sealant backing consisted of 20 mm thick Rockwool RWA45 insulation of density greater than 45 kg/m³.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Construction (Linear Gaps / Blank Seals)	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:		-	-		Report Reference:		WF FAS 190335	
Substrate:	Masonry	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2215.5	
Min Substrate Thickness (mm):	150	180 x 180	-		Date:		23/01/25	Rev:
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/240/240							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.