
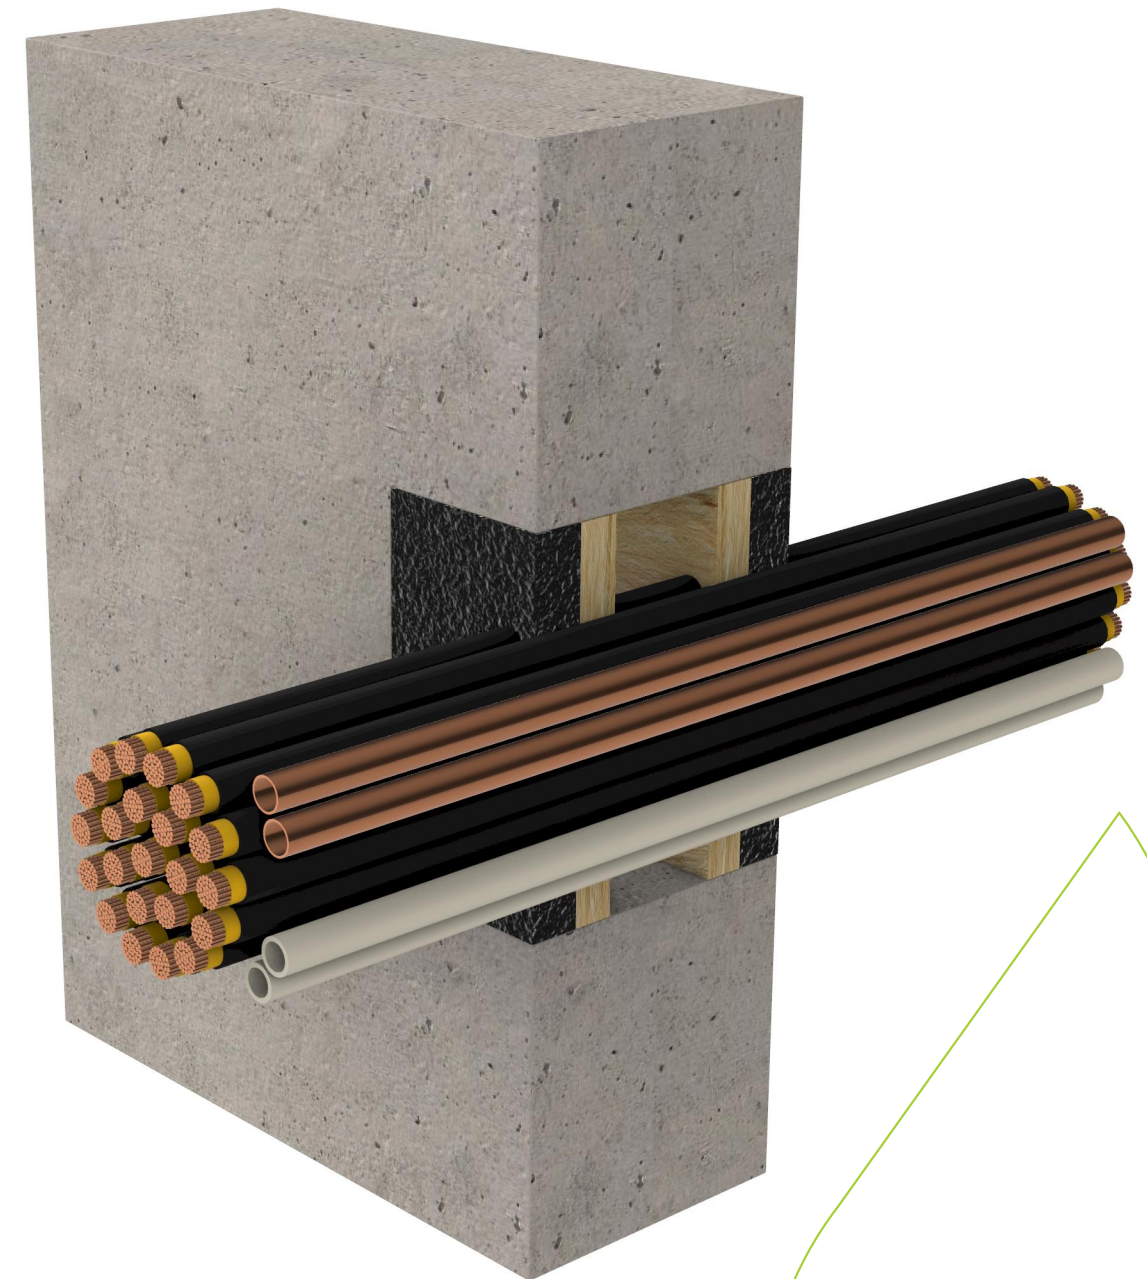


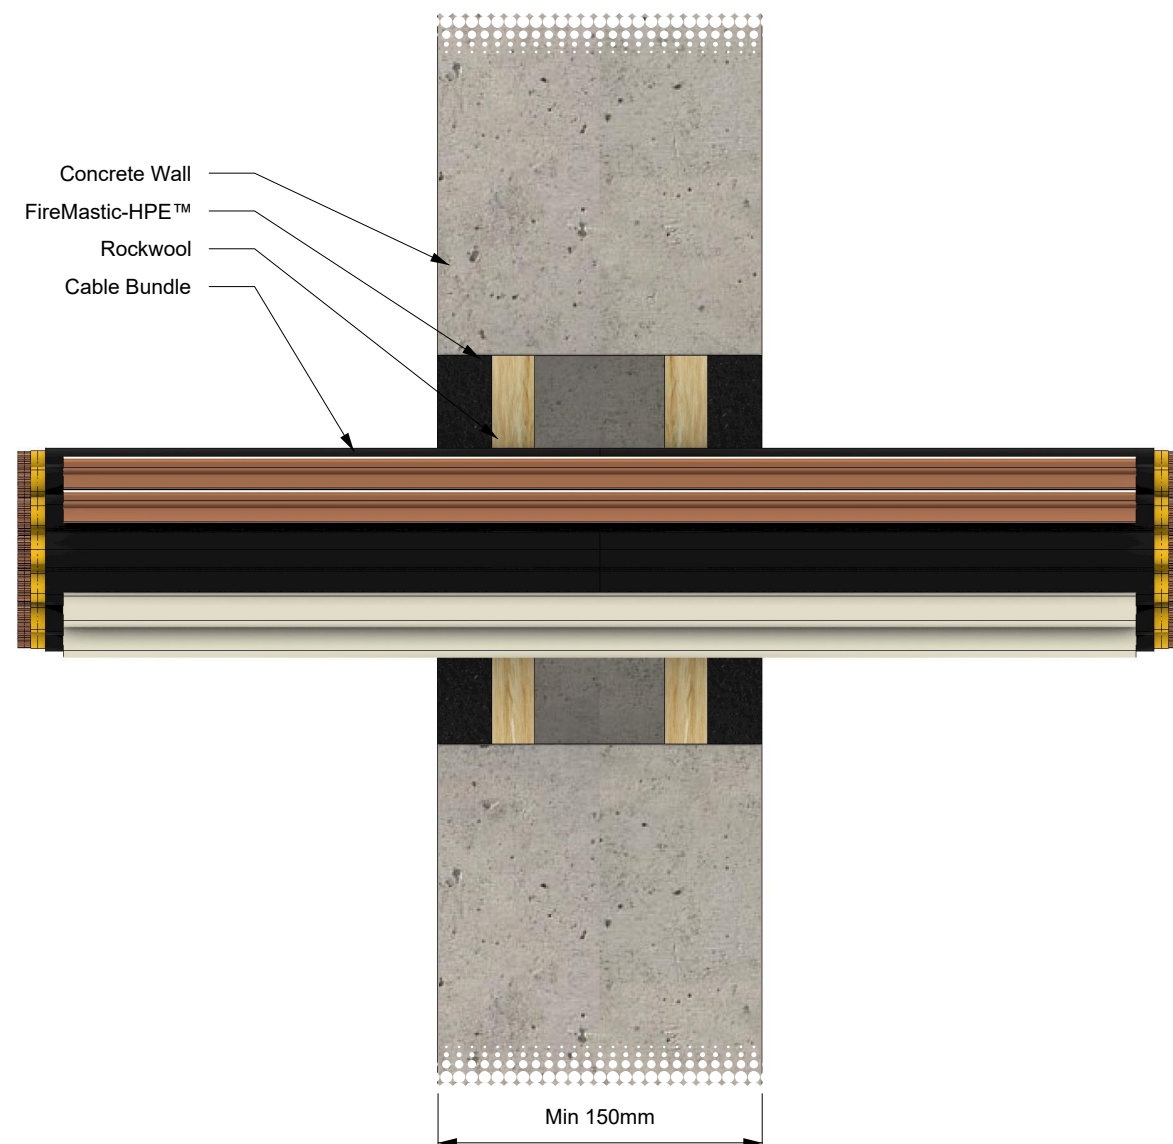

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	•100 mm diameter (F) cable bundle (telecommunication cable) (PE/PE) 20 mm x 2 mm x 0.6 mm ² screened, •2 x 15 mm x 1 mm wall thickness rigid H copper conduits, •2 x 16 mm x 2 mm wall thickness PVC conduits. Sealant 25mm deep in annular gap finished flush with both sides of the wall. The sealant backing consisted of 20 mm thick Rockwool RWA45 insulation of density greater than 45 kg/m ³ .	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Telecommunications	-	-		Report Reference:		WF FAS 190335	
Substrate:	Concrete wall	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2219.4	
Min Substrate Thickness (mm):	150	180 x 180	-		Date:	23/01/25	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/240/30							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.