
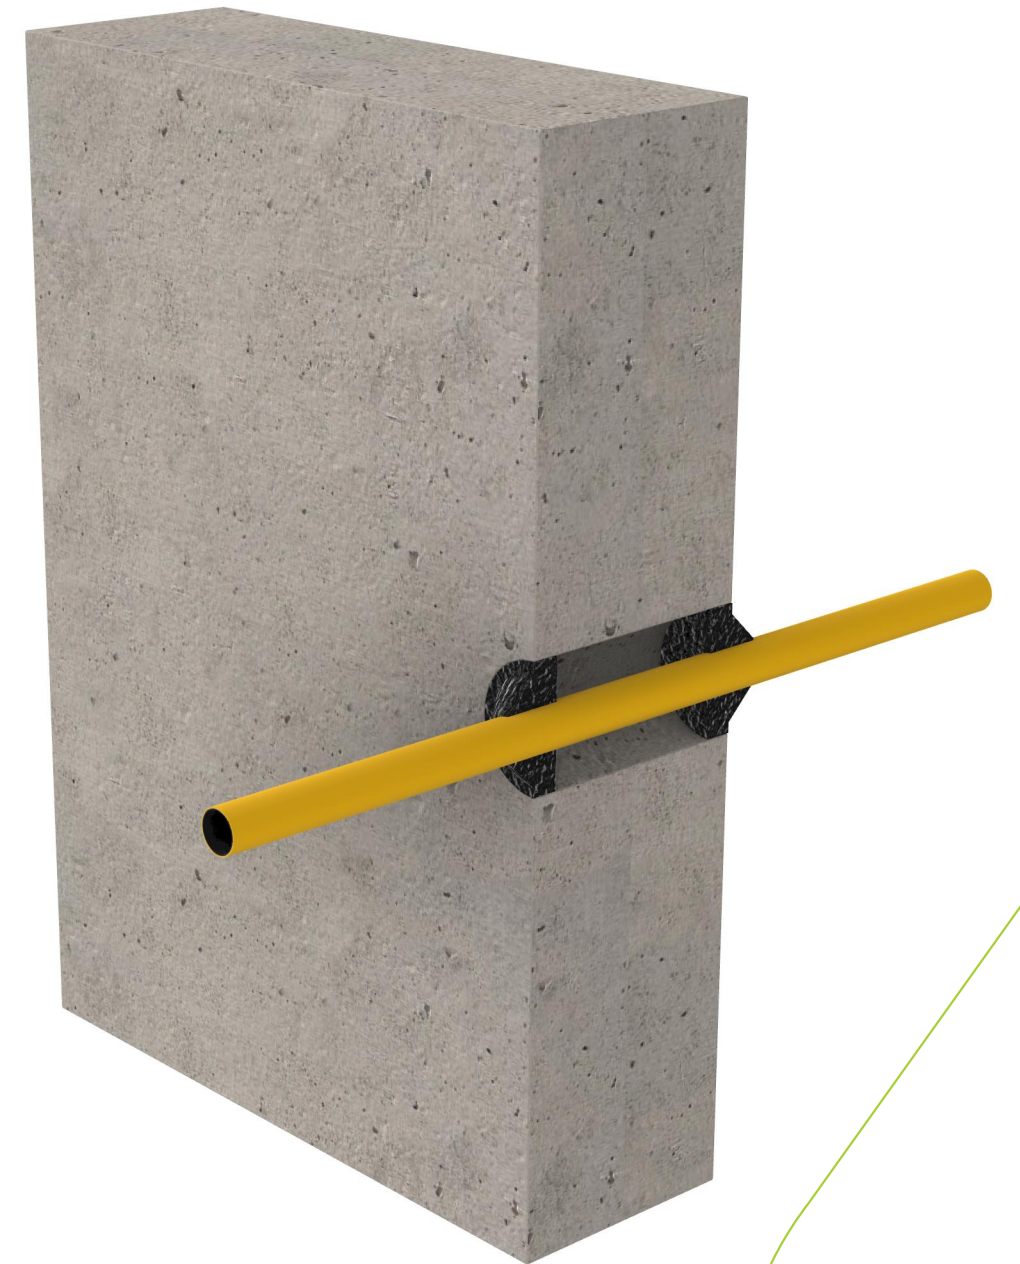


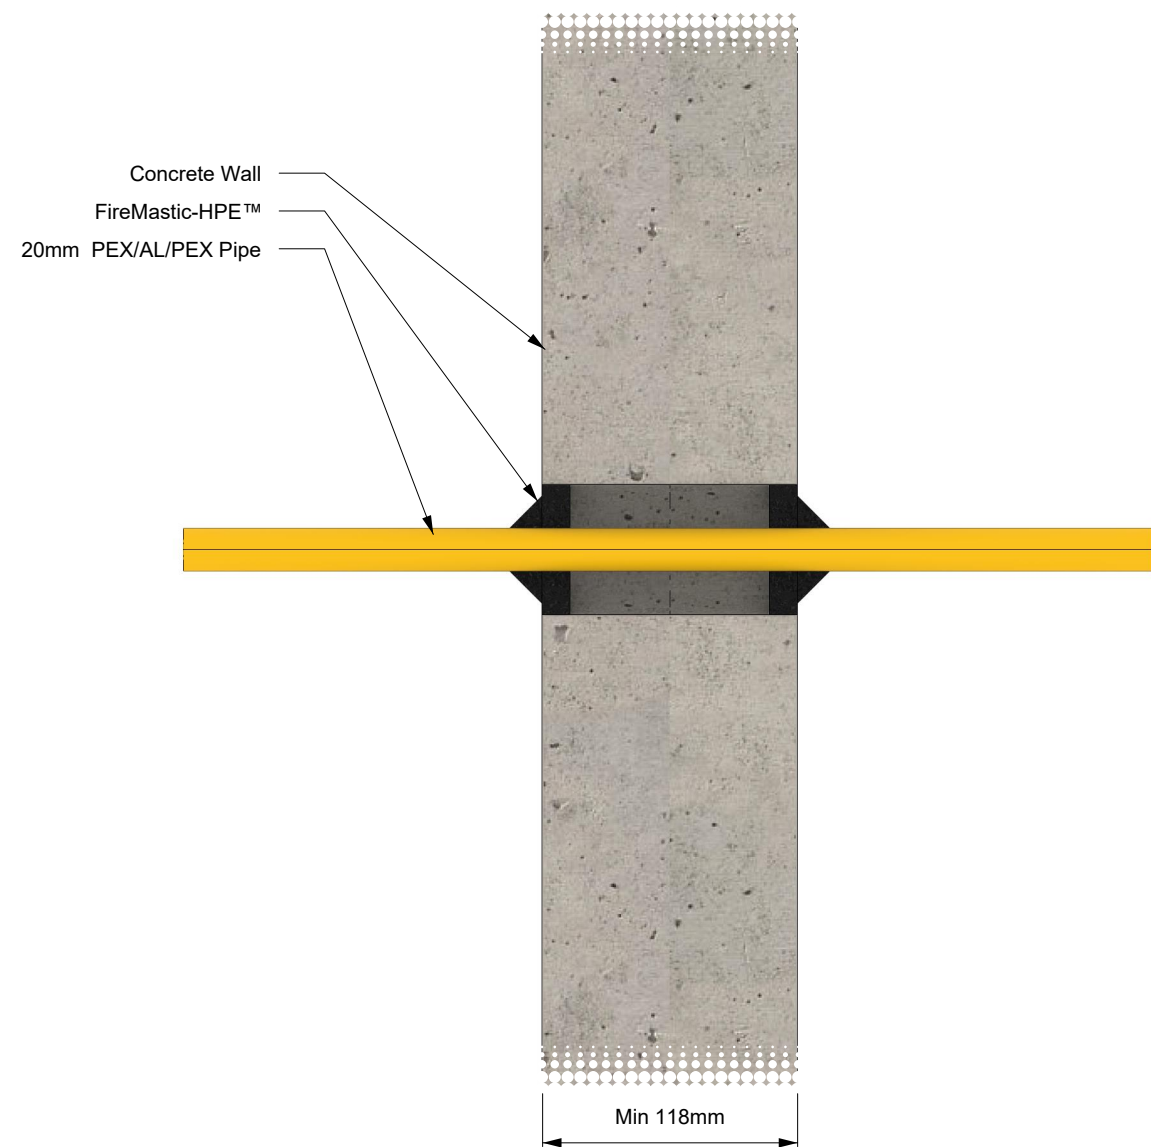

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE	-	**Specimen achieved greater performance, but the FRL is limited to the published performance of the wall.** 20 mm PEX-AL-PEX pipe (DuoPEX Gas pipe). HPE installed into the annular gap, 13 mm deep finished flush. An additional 15 mm x 15 mm fillet both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PEX-AL	-	-		Report Reference:		PF23029	
Substrate:	Concrete wall	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2225.4	
Min Substrate Thickness (mm):	118	60	21 - 22		Date:	23/01/25	Rev:	01
Sealant Depth (mm):	13	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	15	-						
Wrap Length (mm):	-							
FRL / FRR:	-/90/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.