
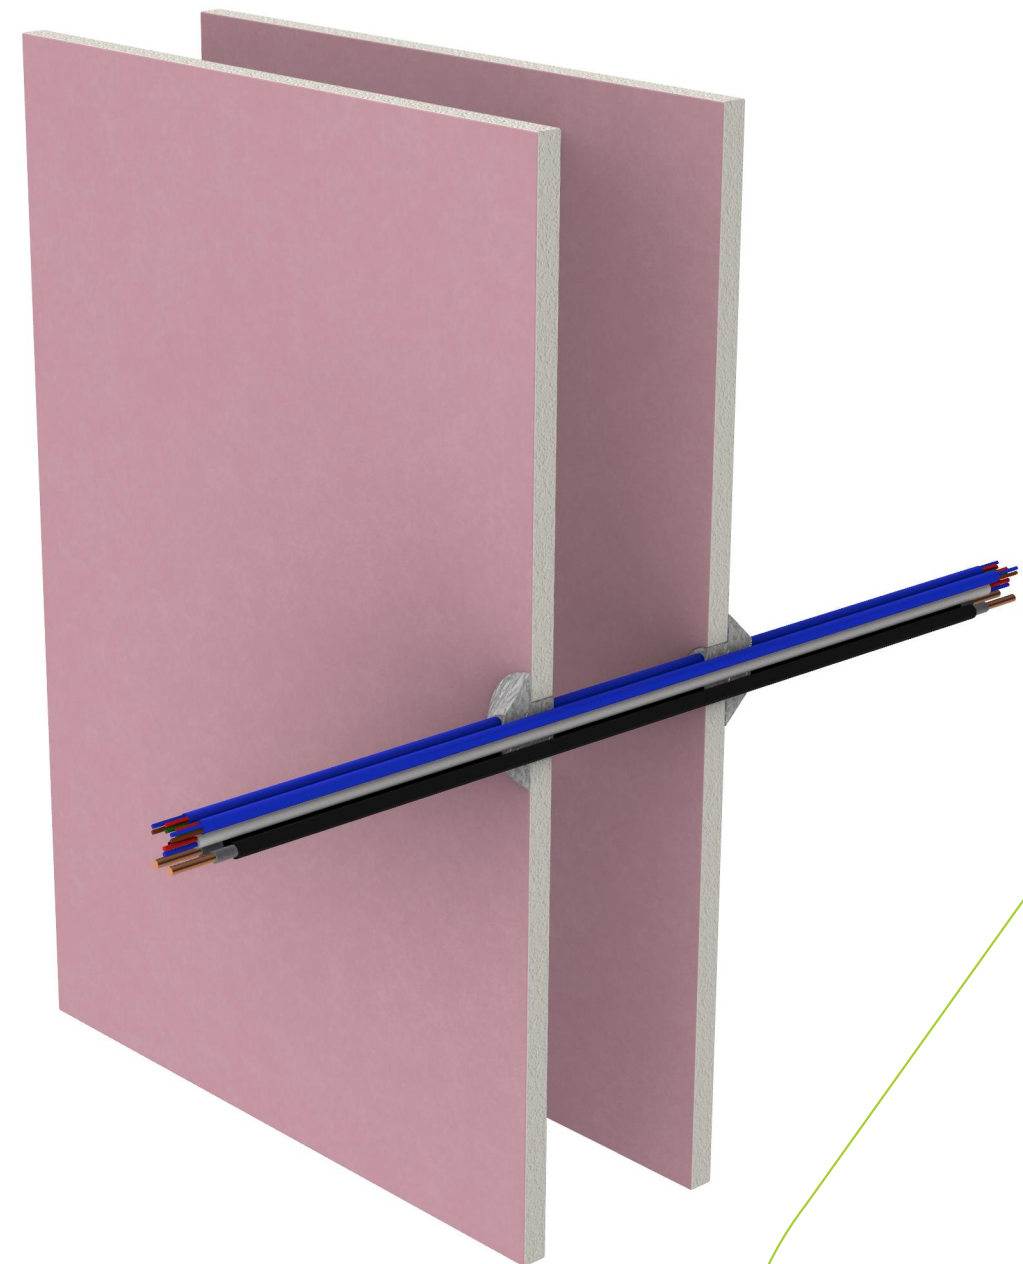


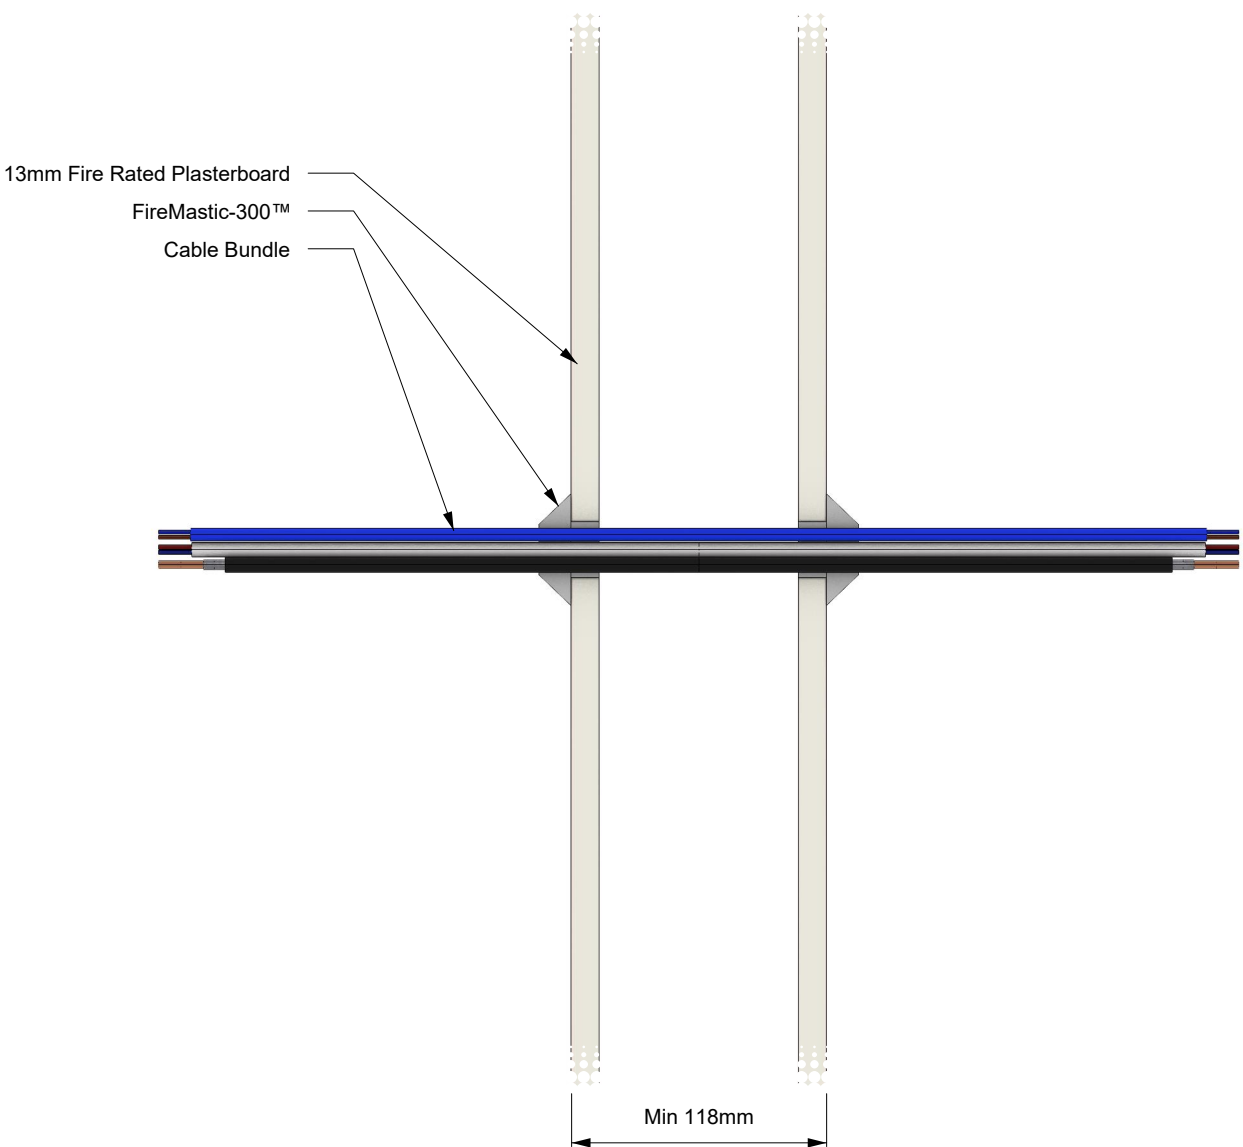

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-300™	-	FRL has been limited to the published performance of the wall. Cable bundle 2 x CAT6, 2 x COAX, 1 x Security cable. FM 300 installed into the annular gap, 13 mm deep finished flush. An additional 15 mm x 15 mm fillet both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Mixed Comms Bundle	-	-		Report Reference:		PF23029	
Substrate:	Single Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2251.1	
Min Substrate Thickness (mm):	118	26.0	4.5 - 6 mm		Date:	09/04/25	Rev:	01
Sealant Depth (mm):	13	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	15	-						
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.