
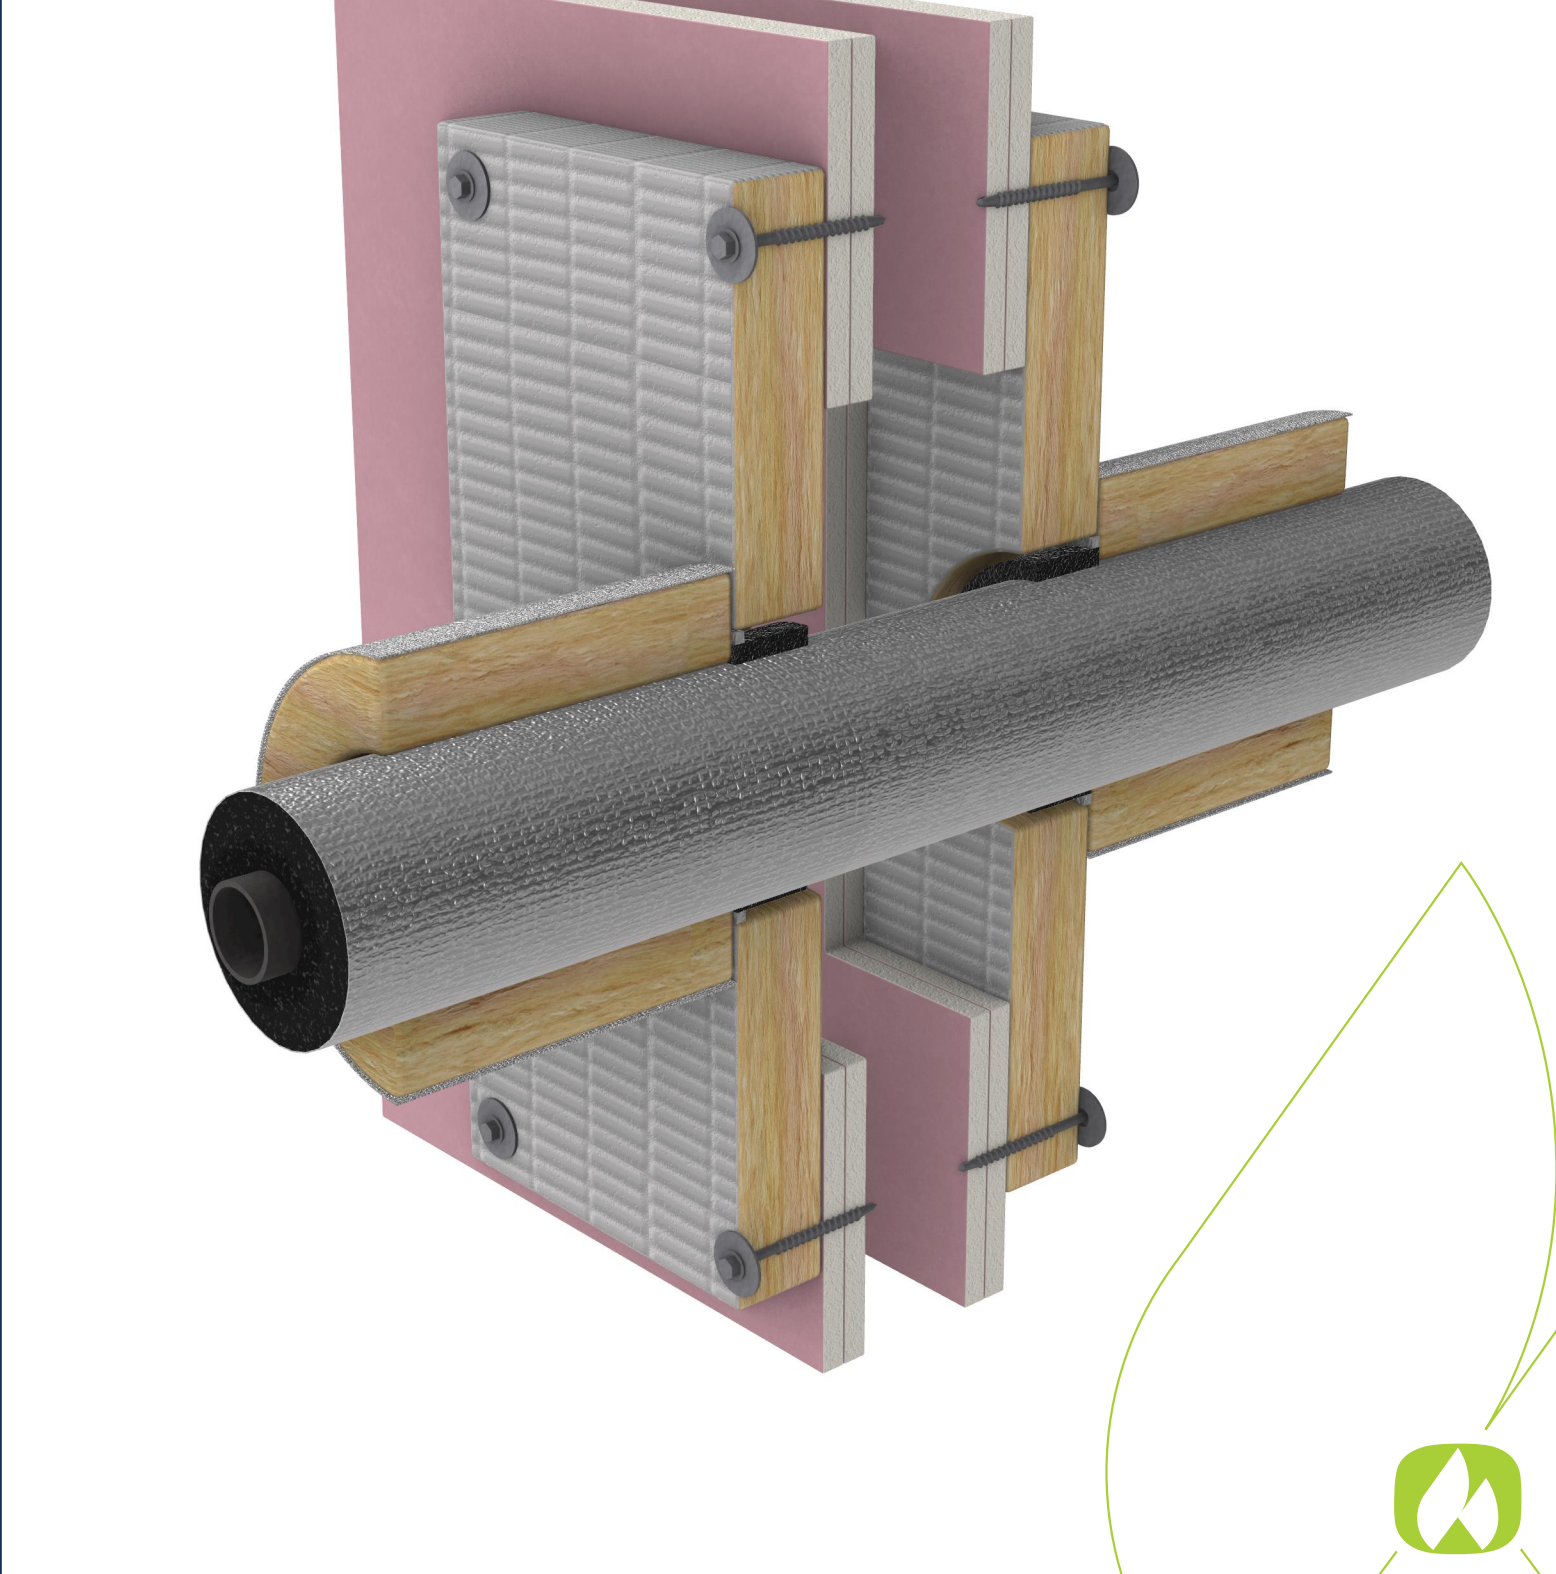


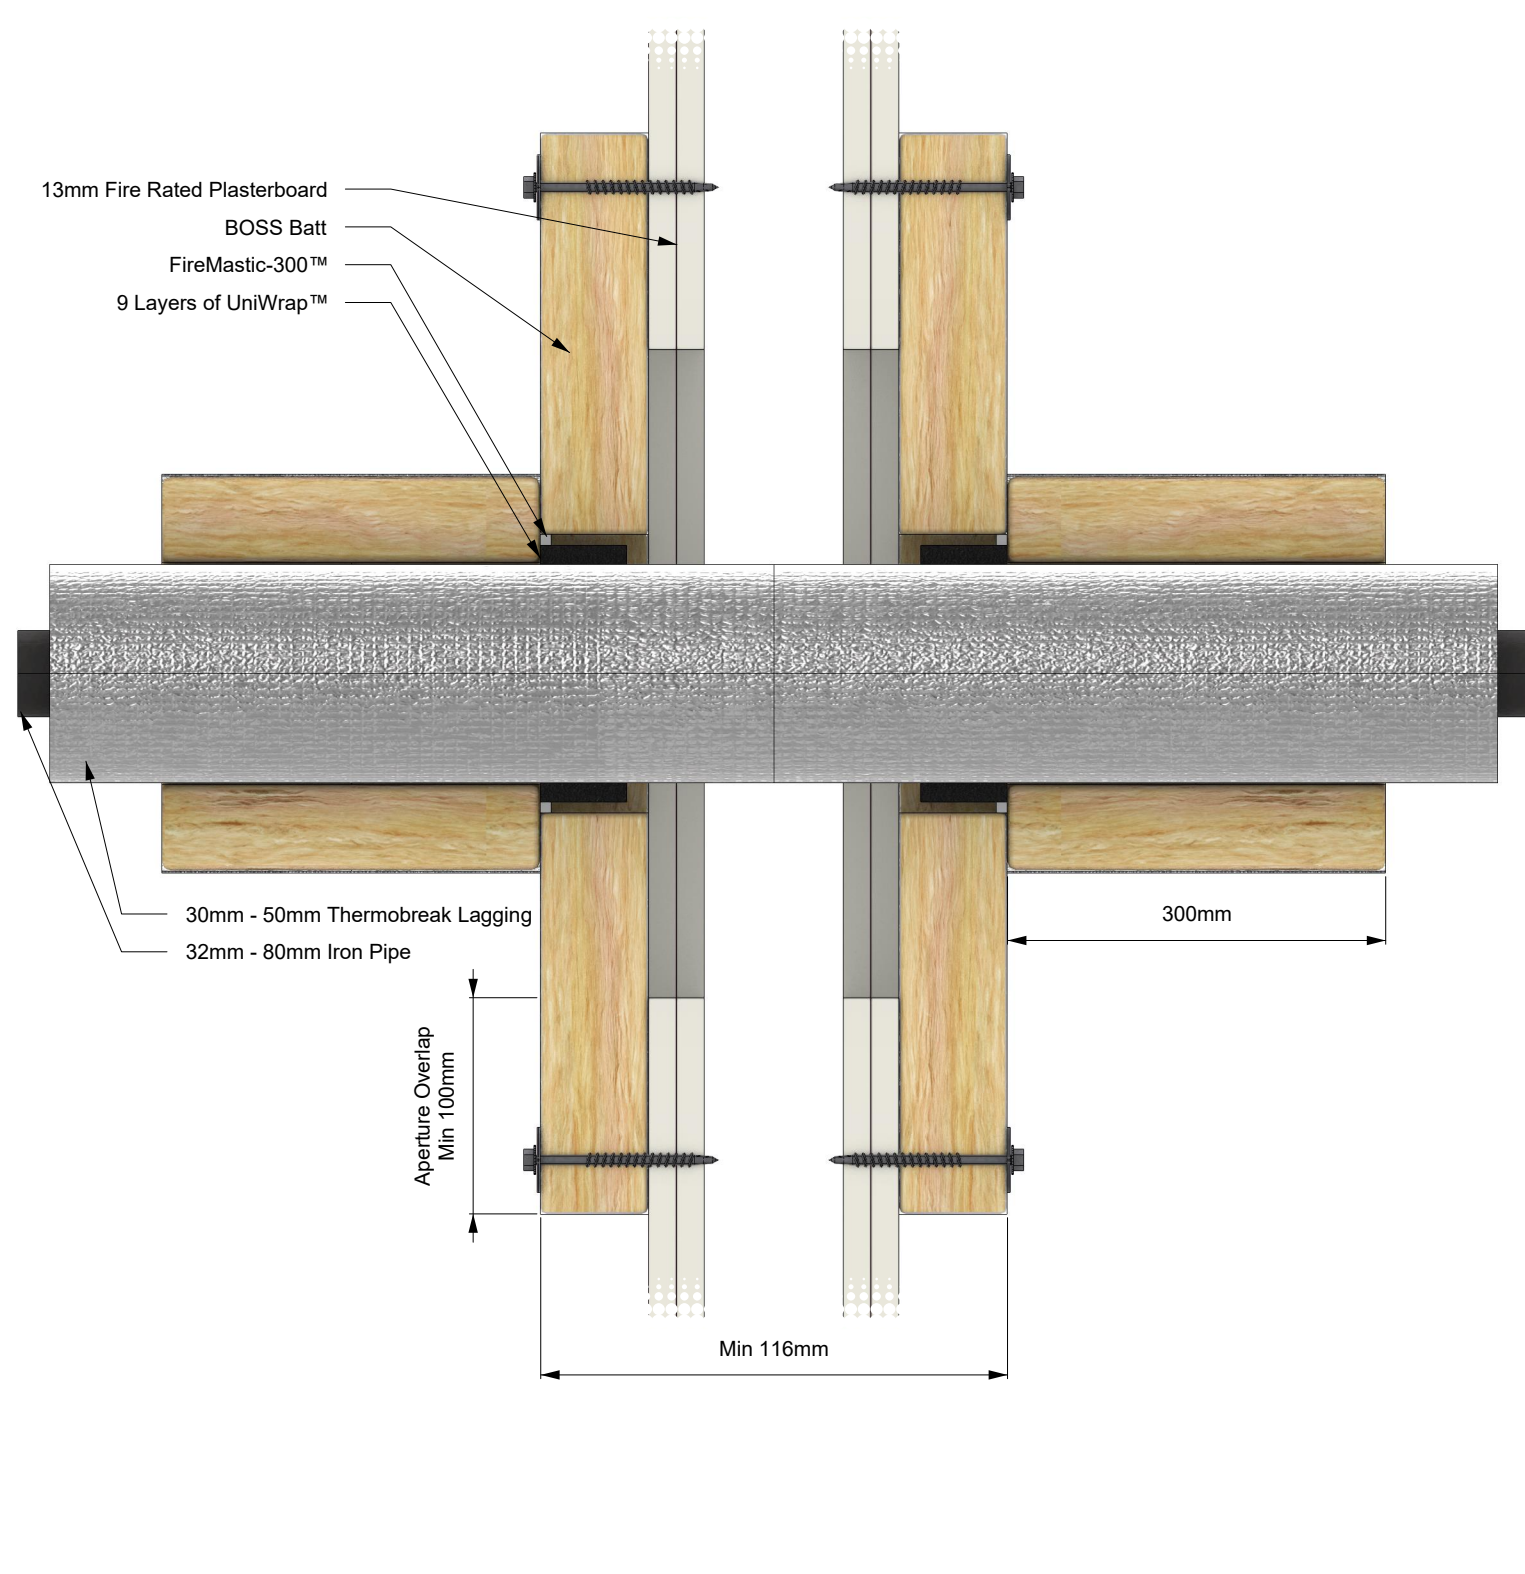

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS P40-MAK Wrap™	32 mm - 80 mm Iron pipe with continuous 30 - 50 mm Thermobreak tube lagging. Sealant 5 mm deep in 5 mm annular gap both sides. BOSS UniWrap™ installed on both sides. P40-MAK Wrap™ 300 mm to both sides. Aperture up to 1100 mm x 1100 mm with 1 layer of BOSS Batt™ pattress fitted over the aperture on both sides with 100 mm overlap of the aperture on all sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS UniWrap™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Insulated Iron Pipes	BOSS FireMastic-300™	-		Report Reference:		WF FAS 190346	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2283.2	
Min Substrate Thickness (mm):	116	up to 1100 x 1100	5		Date:	26/02/25	Rev:	01
Sealant Depth (mm):	5	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0	-						
Wrap Length (mm):	300							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.