


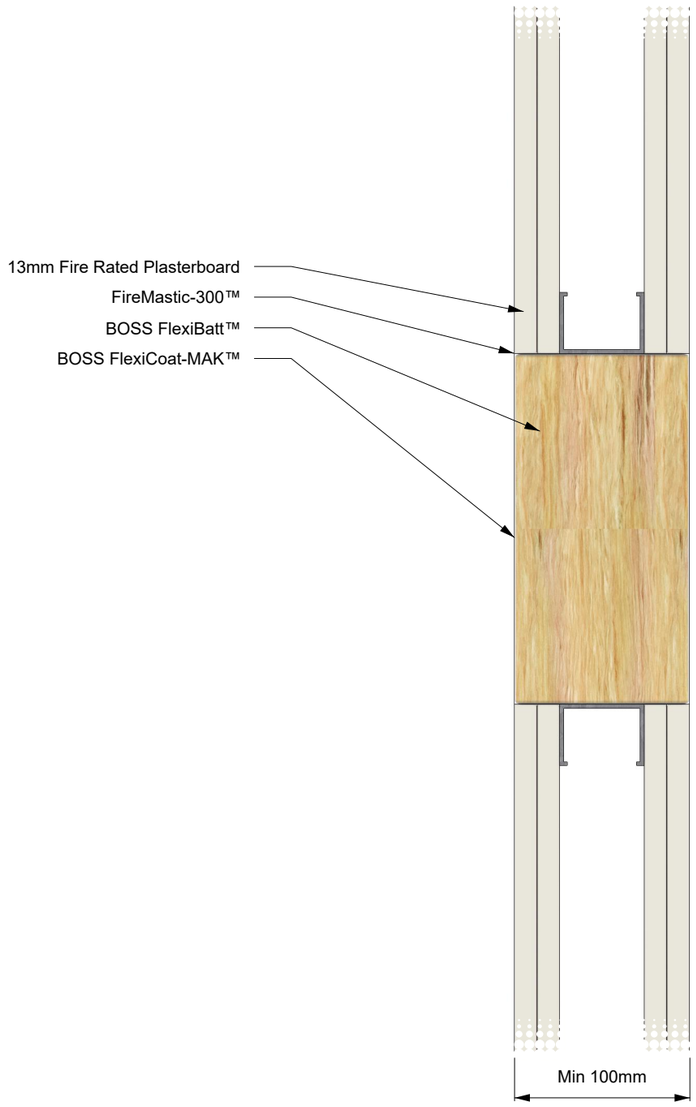

SYSTEM DESCRIPTION	
Orientation:	Wall
Trade / Type:	Construction (Linear Gaps / Blank Seals)
Service:	-
Substrate:	Double Layer Fire Rated Plasterboard System
Min Substrate Thickness (mm):	100
Sealant Depth (mm):	0
Sealant Fillet (mm):	0
Wrap Length (mm):	-
FRL / FRR:	-/240/180

FIRE STOPPING INFORMATION	
BOSS FlexiBatt™	-
BOSS FlexiCoat-MAK™	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
200 gap x Unlimited length	-
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

100 mm thick layer of FlexiBatt™ friction fitted into an aperture up to 200 mm gap x Unlimited length coated with 1 mm DFT BOSS FlexiCoat-MAK™.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	FAR 4572		
Drawing Number:	BF-2307.2		
Date:	01/09/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.