
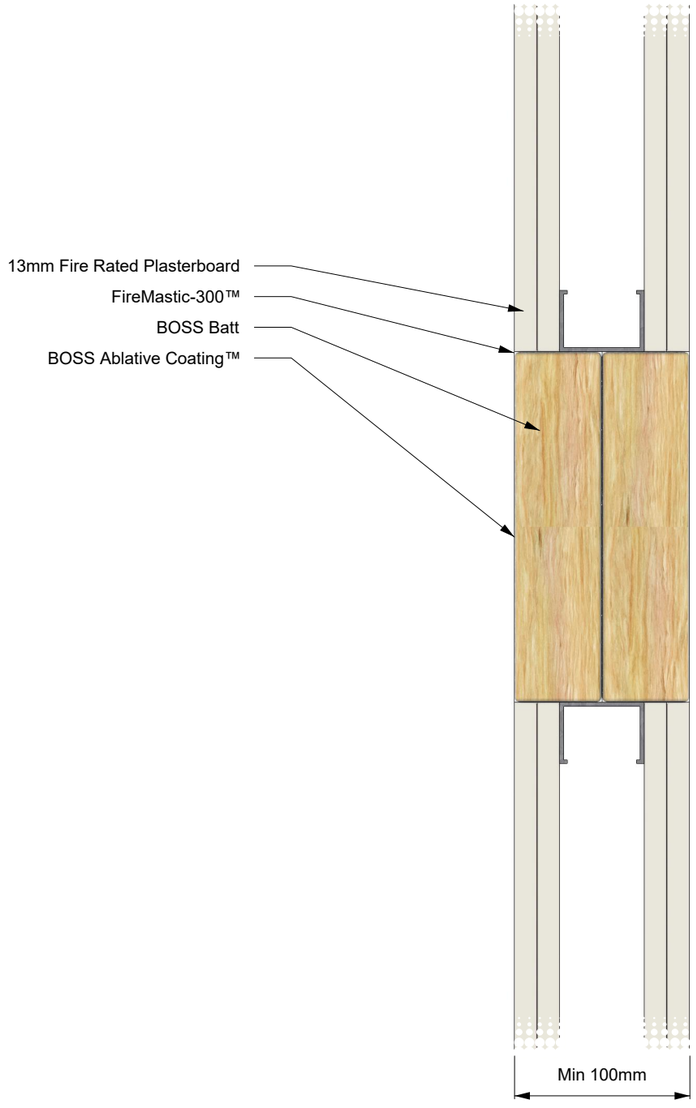


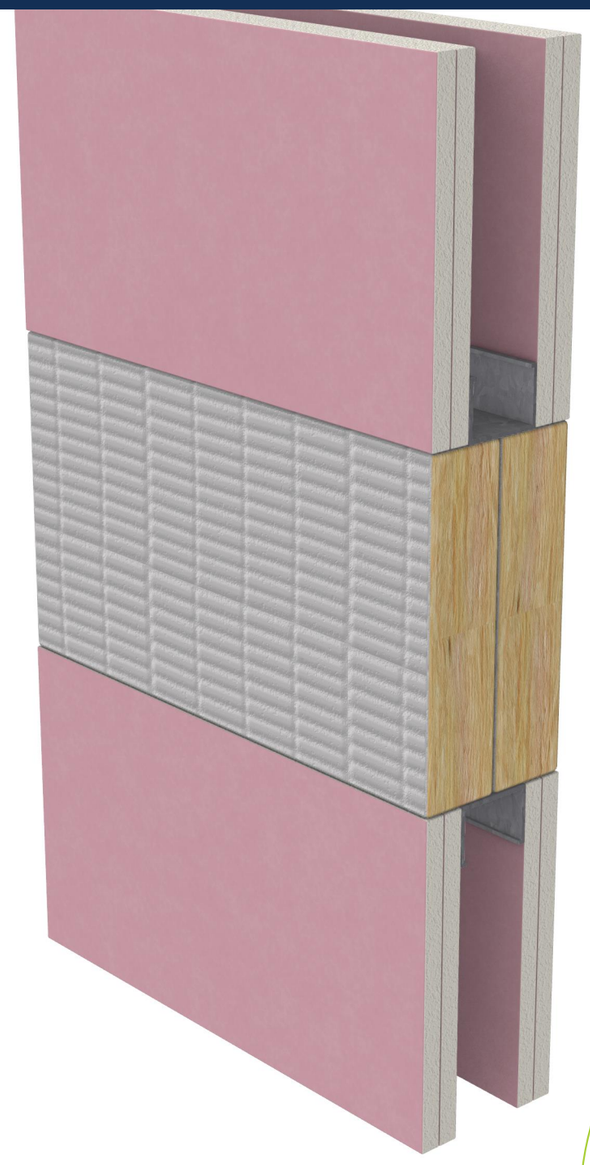

SYSTEM DESCRIPTION	
Orientation:	Wall
Trade / Type:	Construction (Linear Gaps / Blank Seals)
Service:	-
Substrate:	Double Layer Fire Rated Plasterboard System
Min Substrate Thickness (mm):	100
Sealant Depth (mm):	Fill Gaps
Sealant Fillet (mm):	0
Wrap Length (mm):	-
FRL / FRR:	-/240/180

FIRE STOPPING INFORMATION	
BOSS Batt™	-
BOSS Ablative Coating™	-
BOSS FireMastic-300™	-
APERTURE (mm)	**ANNULAR GAP (mm)**
200 gap x unlimited legth	-
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

100 mm thick double layer of BossBatt™ friction fitted into an aperture up to 200 mm gap x Unlimited length, coated with 1 mm DFT BOSS Ablative Coating™. A bead of sealant is applied to the edges of the batt and the separating element to both sides.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	FAR 4572		
Drawing Number:	BF-2308.2		
Date:	01/09/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.