
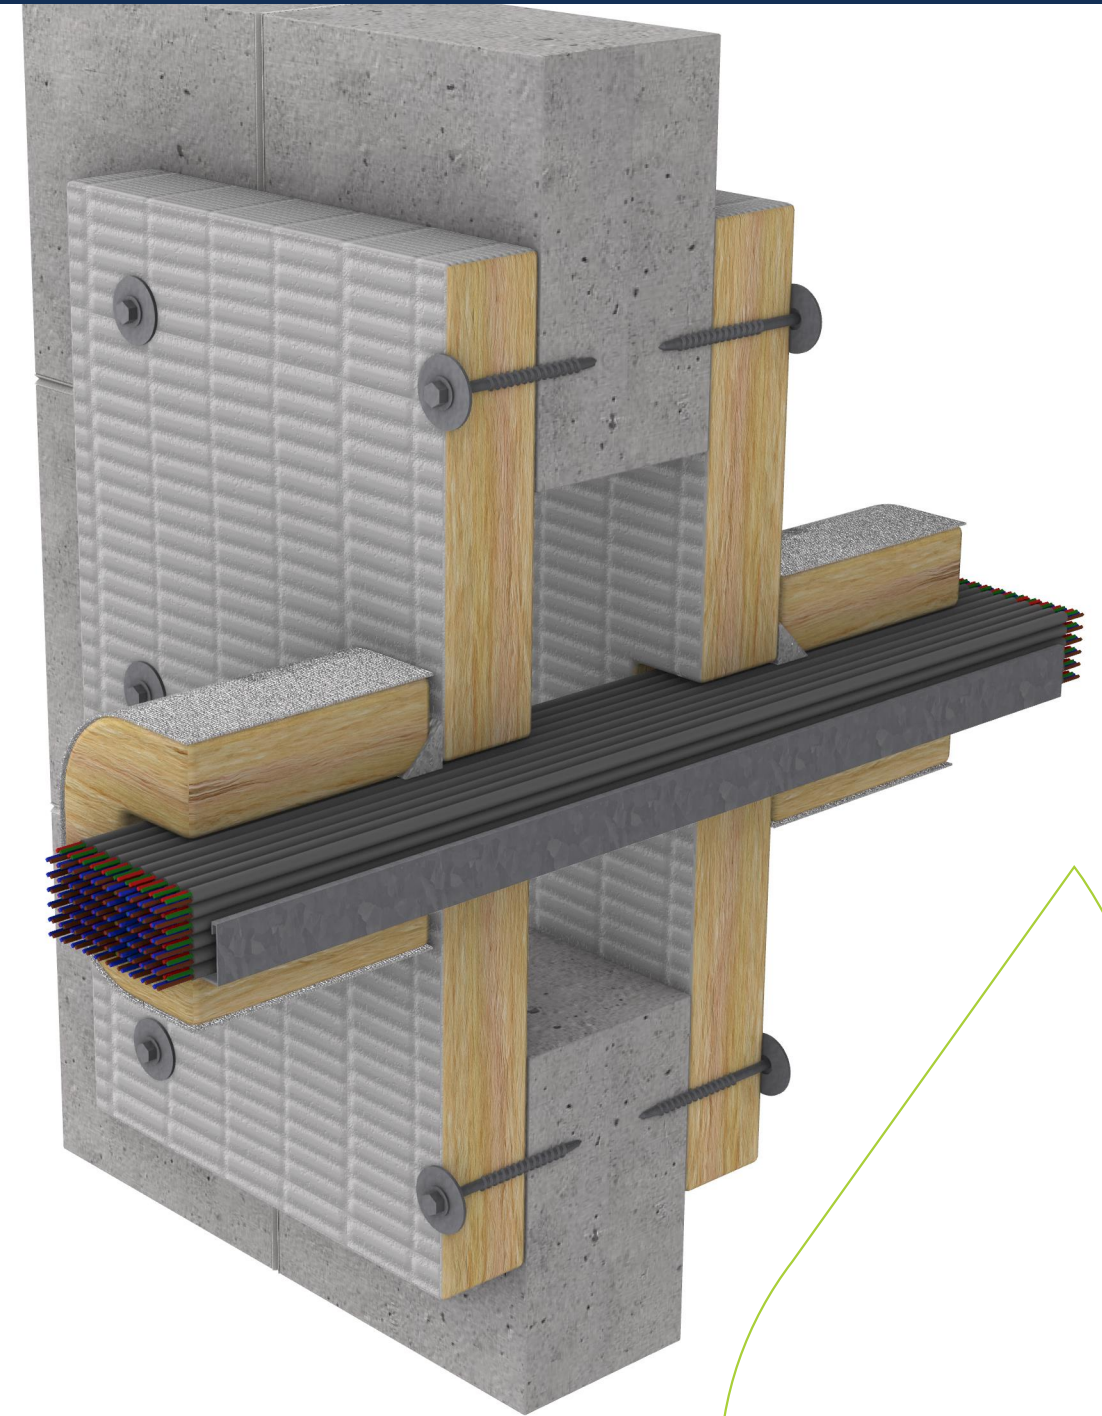


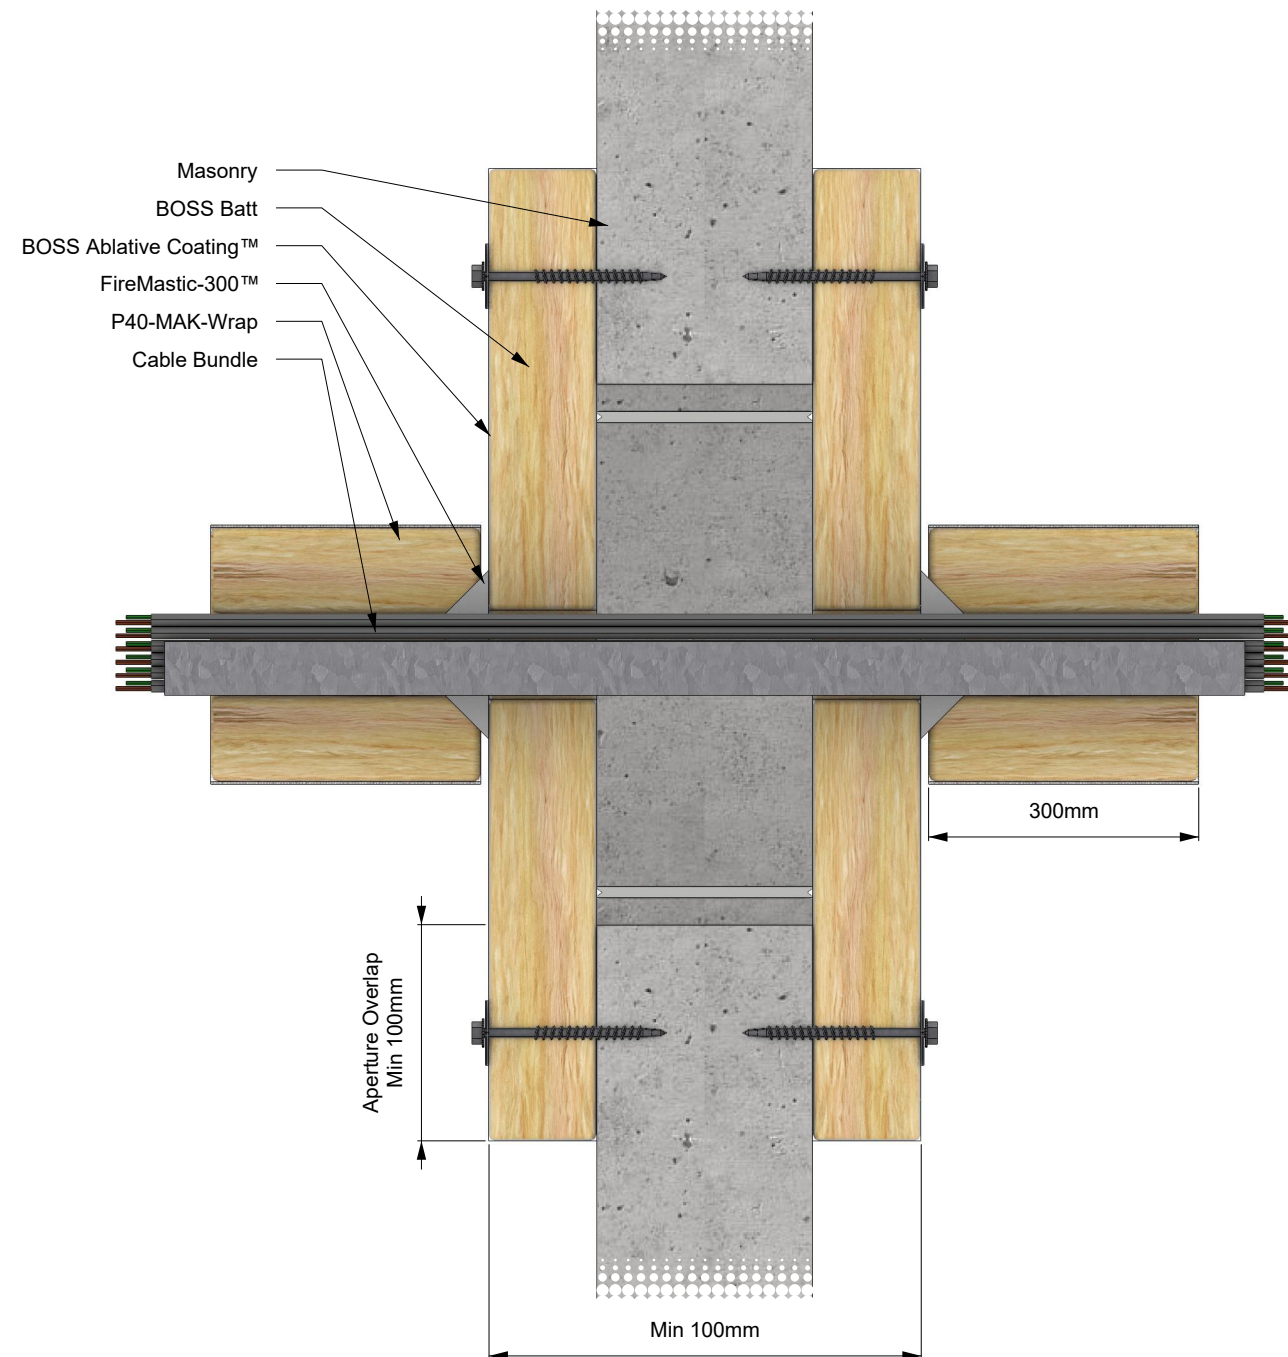

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS P40-MAK Wrap™	Appendix D2 Group B cable configuration, consisting of 60 x 50 pair telecommunication cables, installed onto a tray up to 500 mm wide. The tray penetrated 2 layers of BossBatt™ protecting an aperture up to 1100 mm x 1100 mm and was sealed with a 20 mm x 20 mm fillet of BOSS FireMastic-300™ on both sides. The system was then wrapped with BOSS P40-MAK Wrap for 300 mm on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Appendix D2 Config	BOSS FireMastic-300™	-		Report Reference:		FAR 4572	
Substrate:	Masonry	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2309.5	
Min Substrate Thickness (mm):	100	up to 1100 x 1100	-		Date:	01/09/25	Rev:	01
Sealant Depth (mm):	0	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	20	-						
Wrap Length (mm):	300							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.