
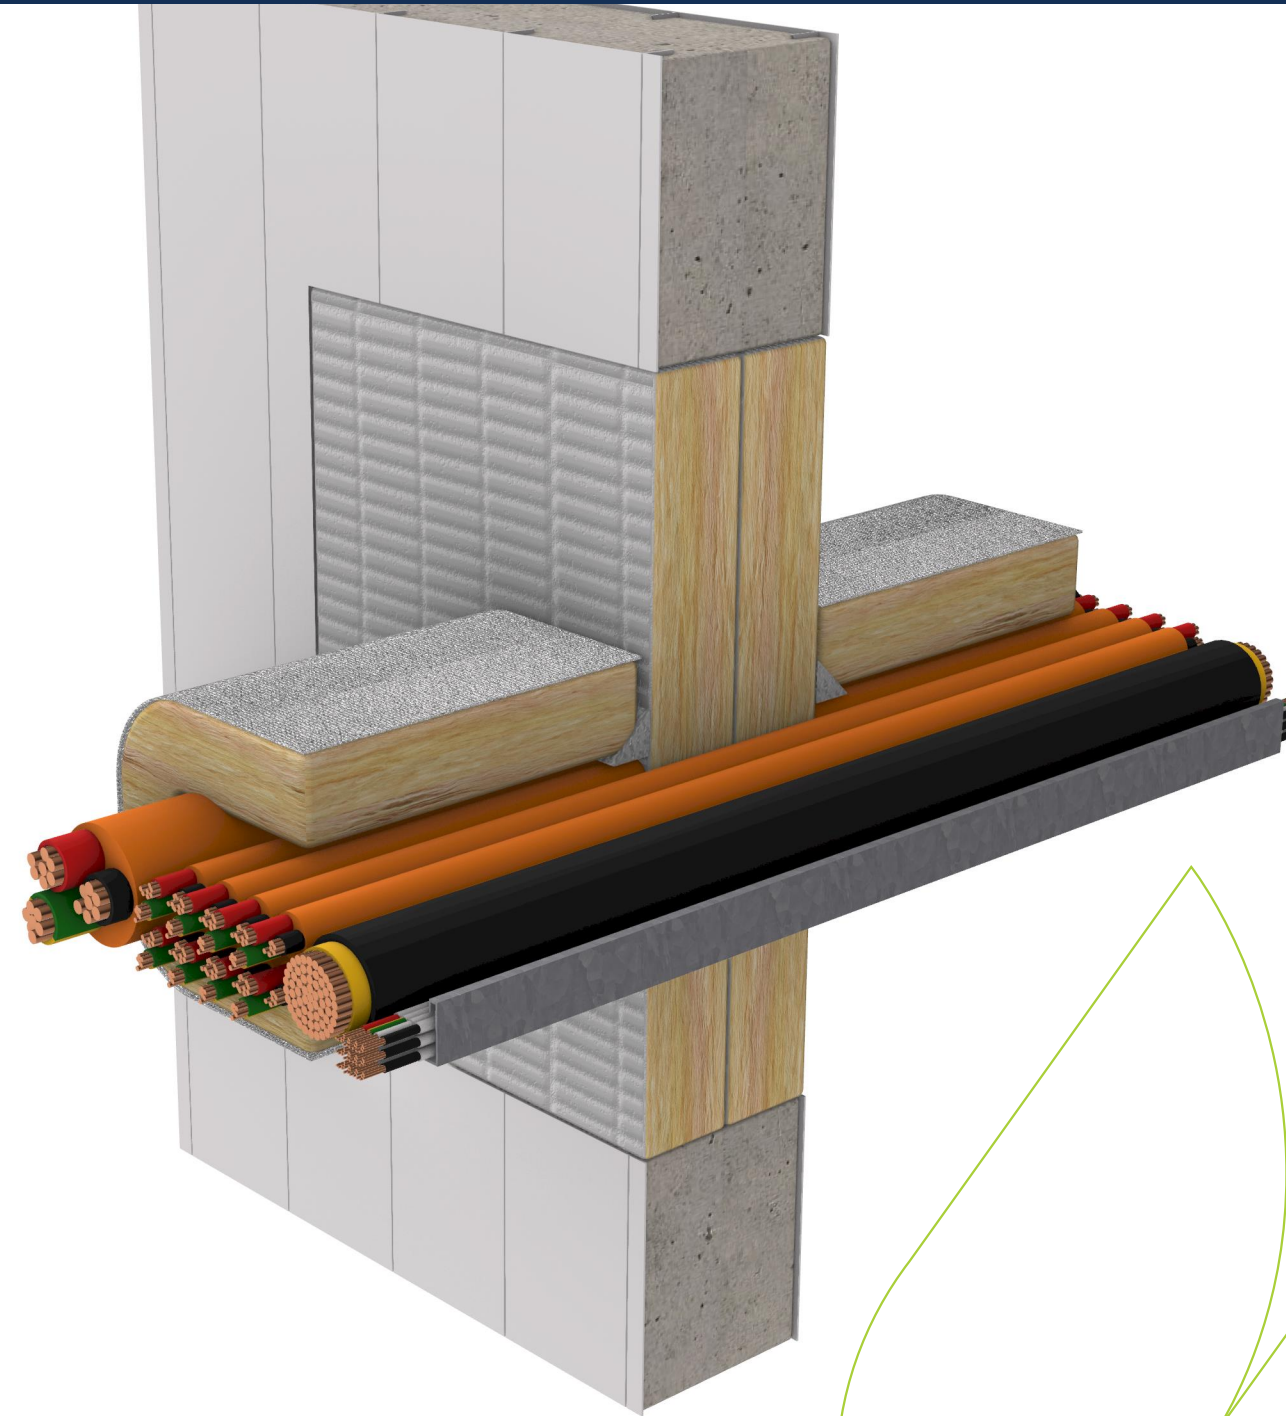


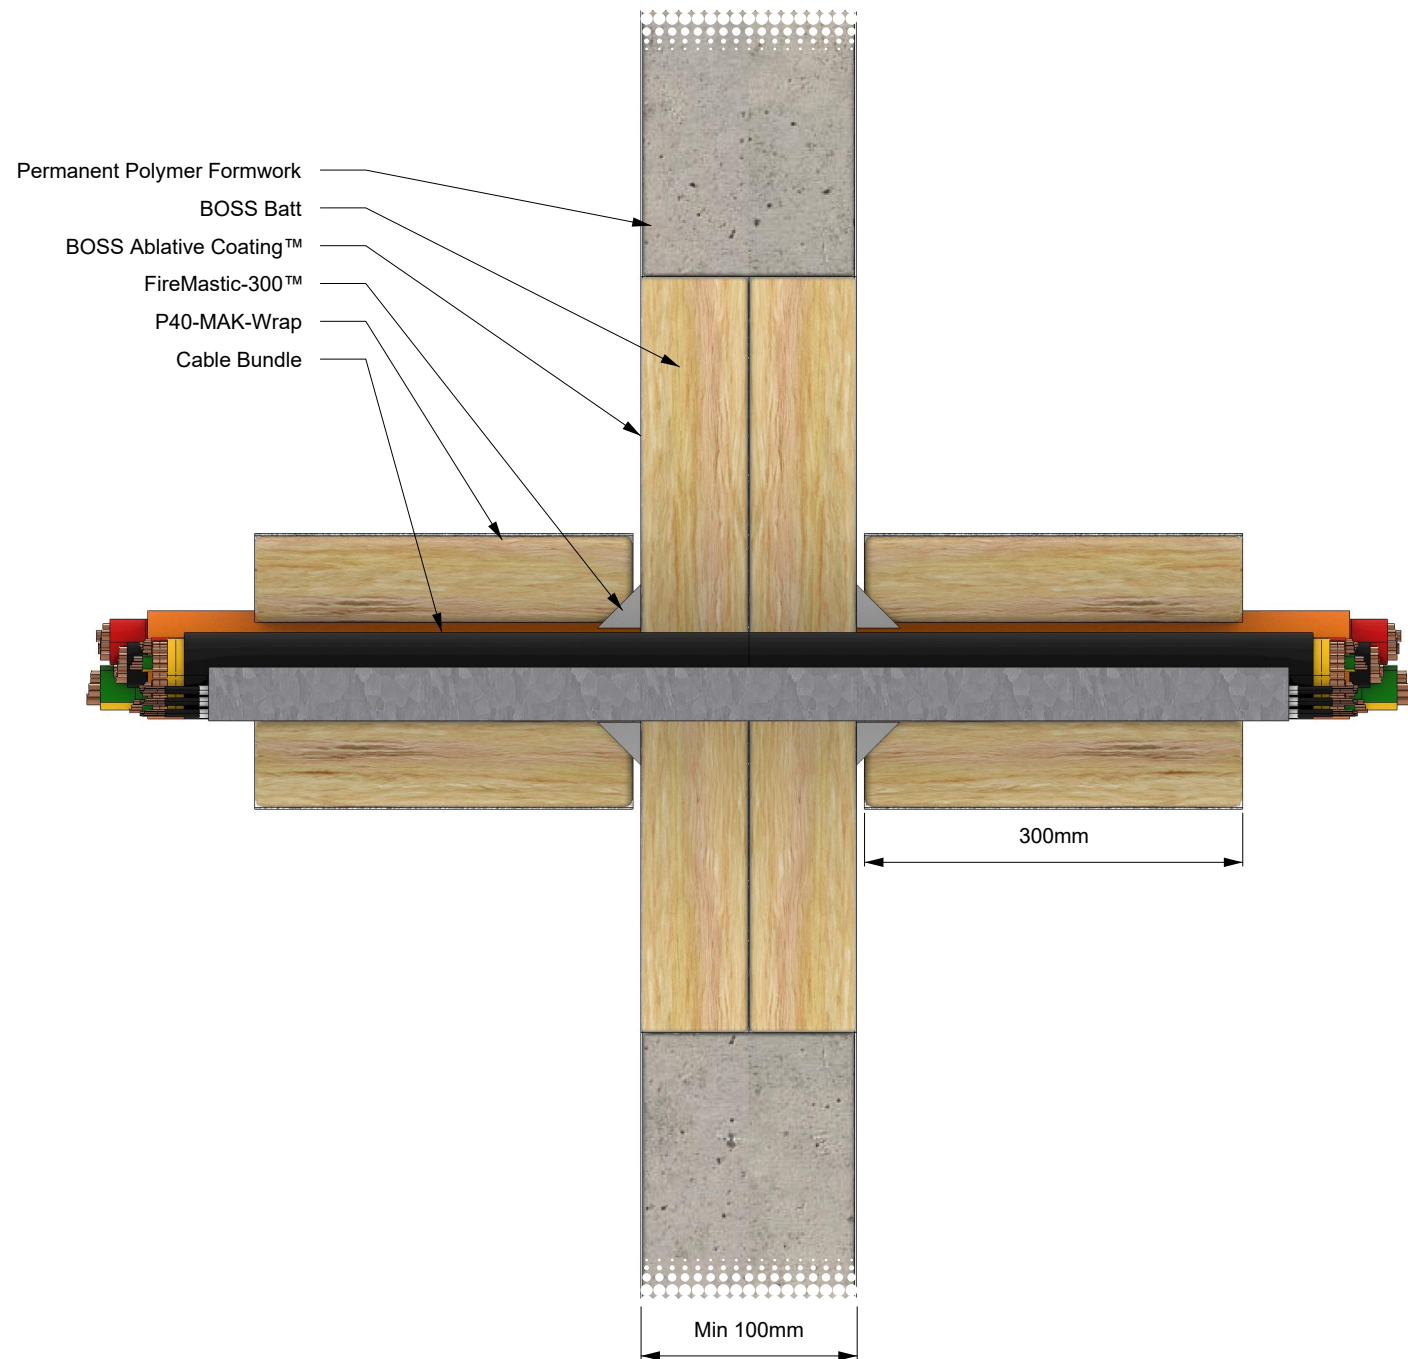

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS P40-MAK Wrap™	Appendix D1 Group A cable configuration, consisting of - 1 single core 630 mm² cable - 1 3C+E 185 mm² cable - 3 3C+E 6 mm² cables - 8 3C+E 16 mm² cables Cable were installed onto a tray up to 500 mm wide. The tray penetrated 2 layers of BossBatt™ protecting an aperture up to 1100 mm x 1100 mm and was sealed with a 20 mm x 20 mm fillet of BOSS FireMastic-300™ on both sides. The system was then wrapped with BOSS P40-MAK Wrap for 300 mm on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Appendix D1 Config	BOSS FireMastic-300™	-		Report Reference:		FAR 4572	
Substrate:	Permanent Polymer Formwork	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2311.21	
Min Substrate Thickness (mm):	100	up to 1100 x 1100	-		Date:	01/09/25	Rev:	01
Sealant Depth (mm):	0	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	20							
Wrap Length (mm):	300							
FRL / FRR:	-/120/120							