
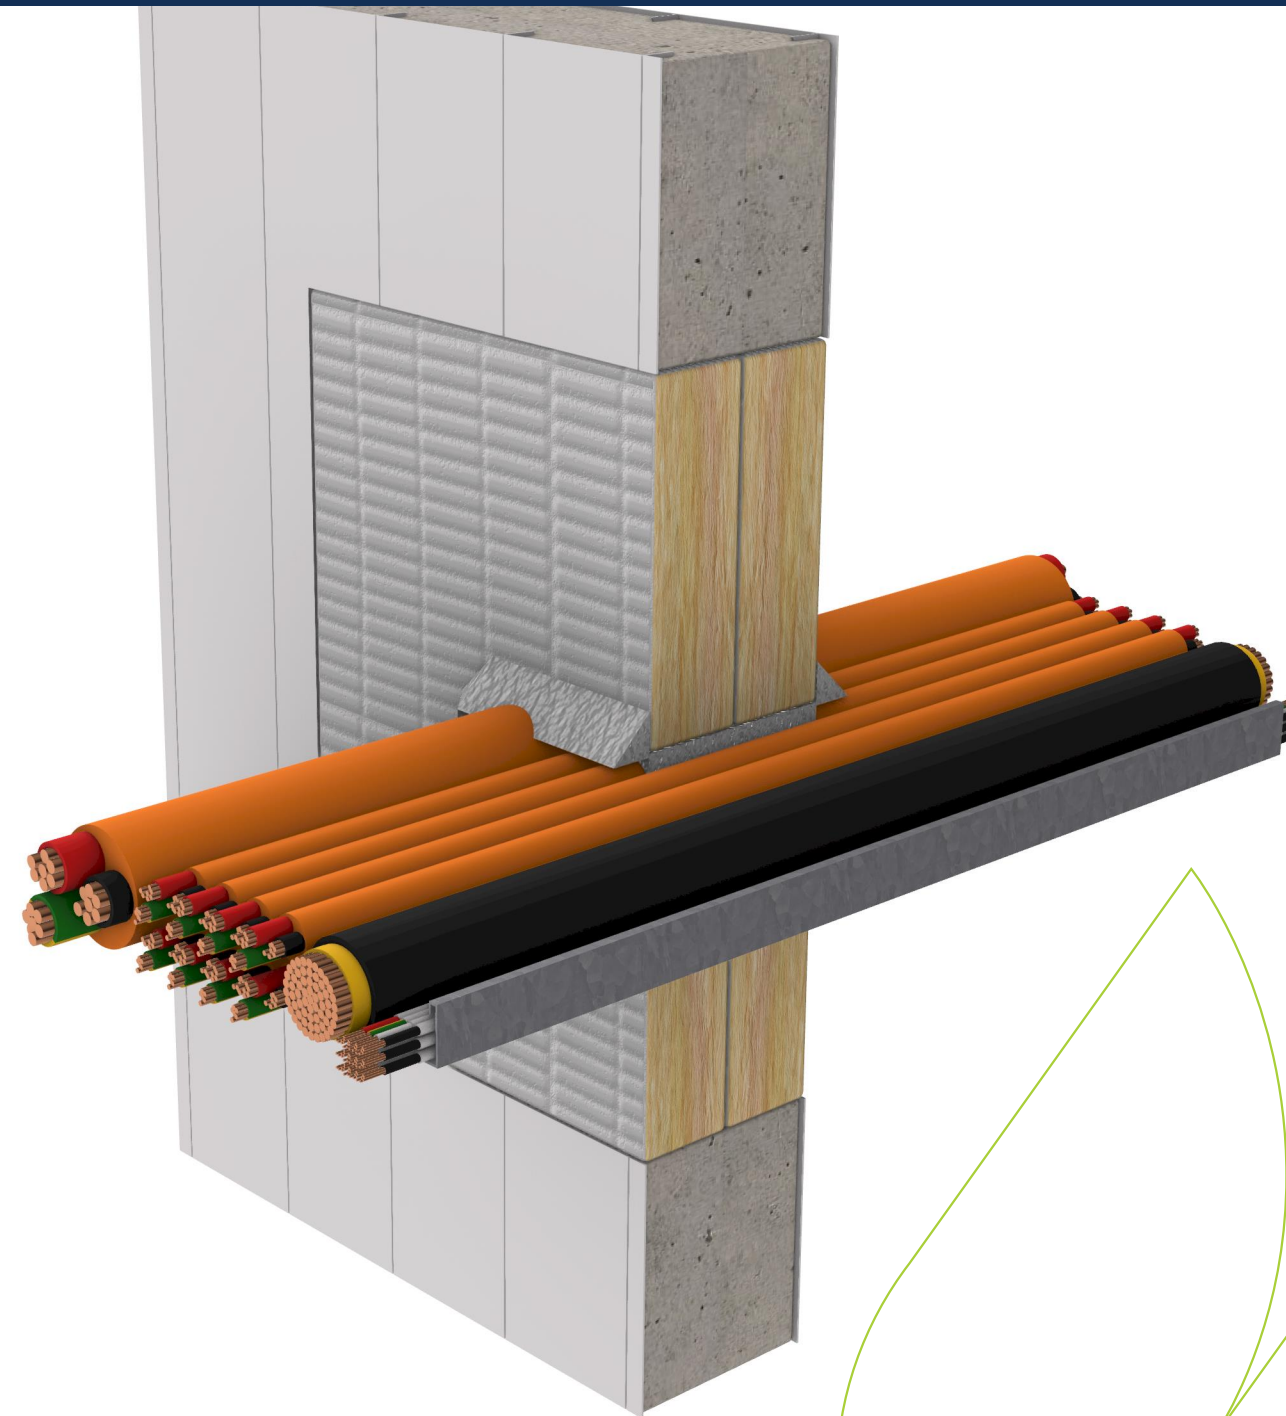


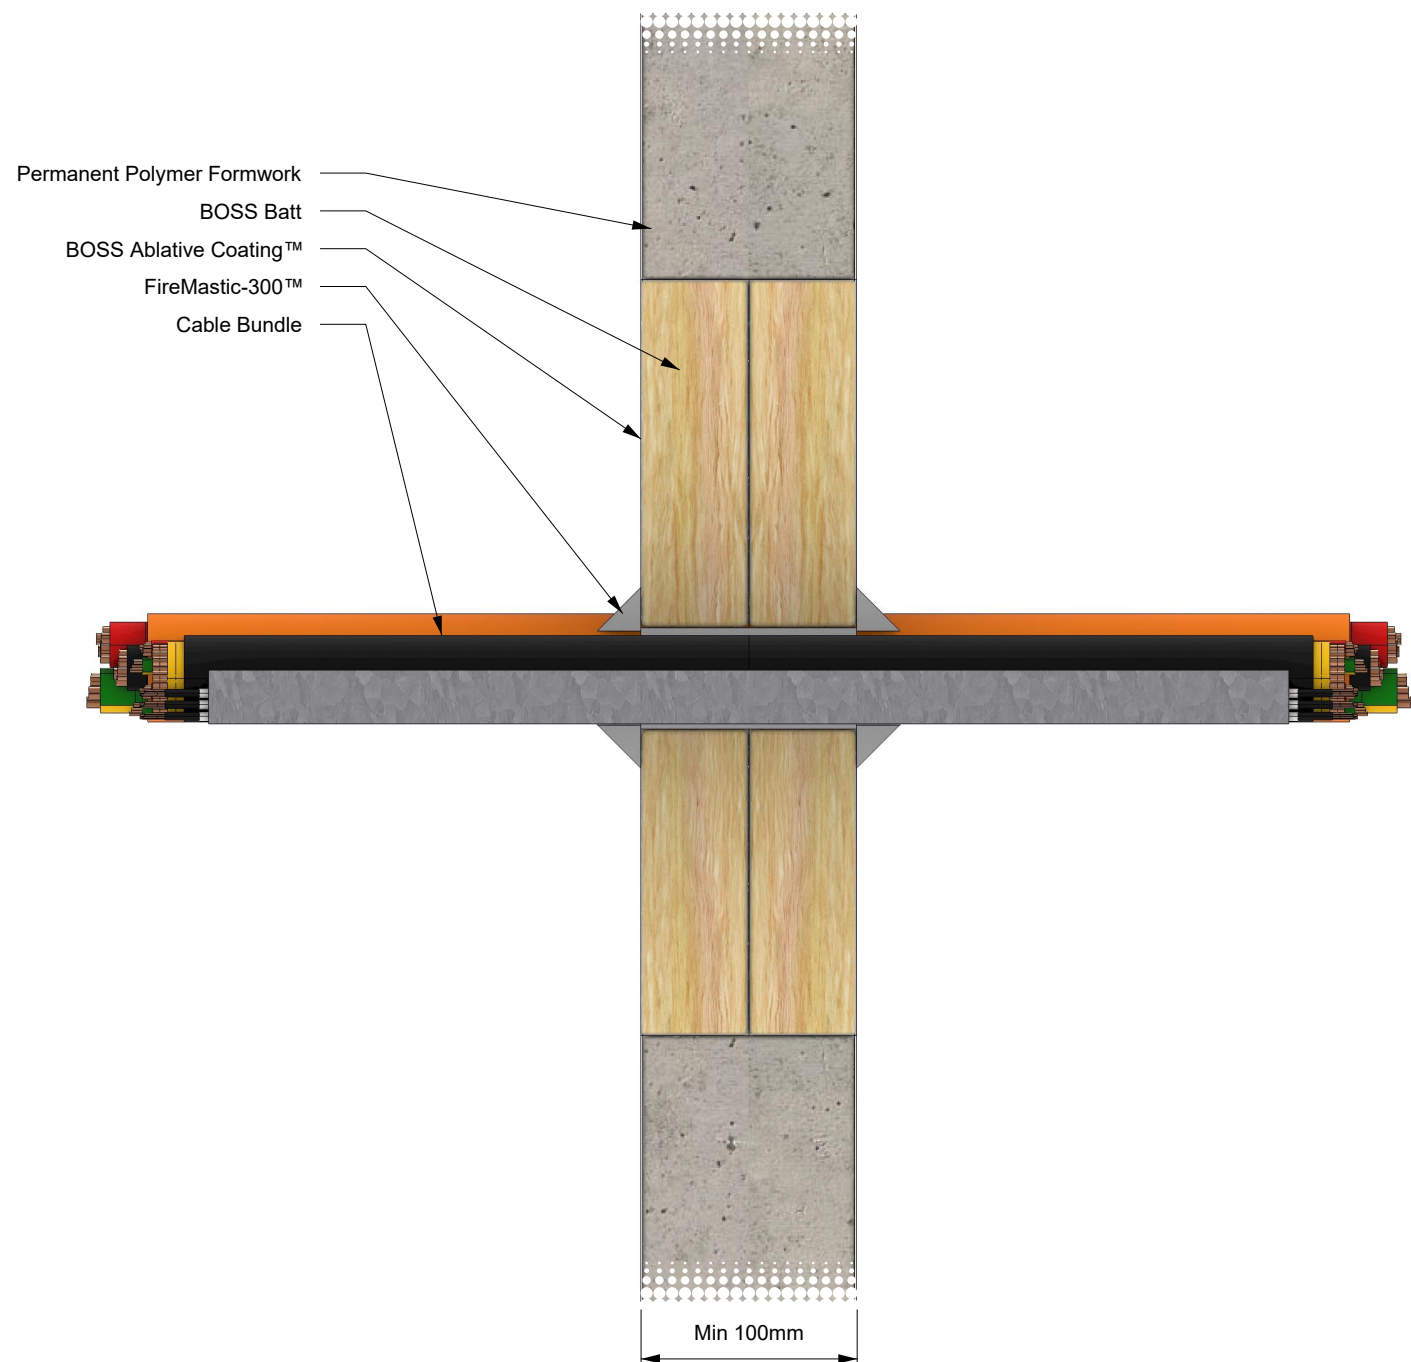

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	-	Appendix D1 Group A cable configuration, consisting of - 1 single core 630 mm² cable - 1 3C+E 185 mm² cable - 3 3C+E 6 mm² cables - 8 3C+E 16 mm² cables Cable were installed onto a tray up to 500 mm wide. The tray penetrated 2 layers of BossBatt™ protecting an aperture up to 1100 mm x 1100 mm and was sealed to the full depth of 100mm with a 20 mm x 20 mm fillet of BOSS FireMastic-300™ on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Appendix D1 Config	BOSS FireMastic-300™	-		Report Reference:		FAR 4572	
Substrate:	Permanent Polymer Formwork	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2312.21	
Min Substrate Thickness (mm):	100	up to 1100 x 1100	-		Date:	01/09/25	Rev:	01
Sealant Depth (mm):	100	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	20	-						
Wrap Length (mm):	-							
FRL / FRR:	-/120/-							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.