
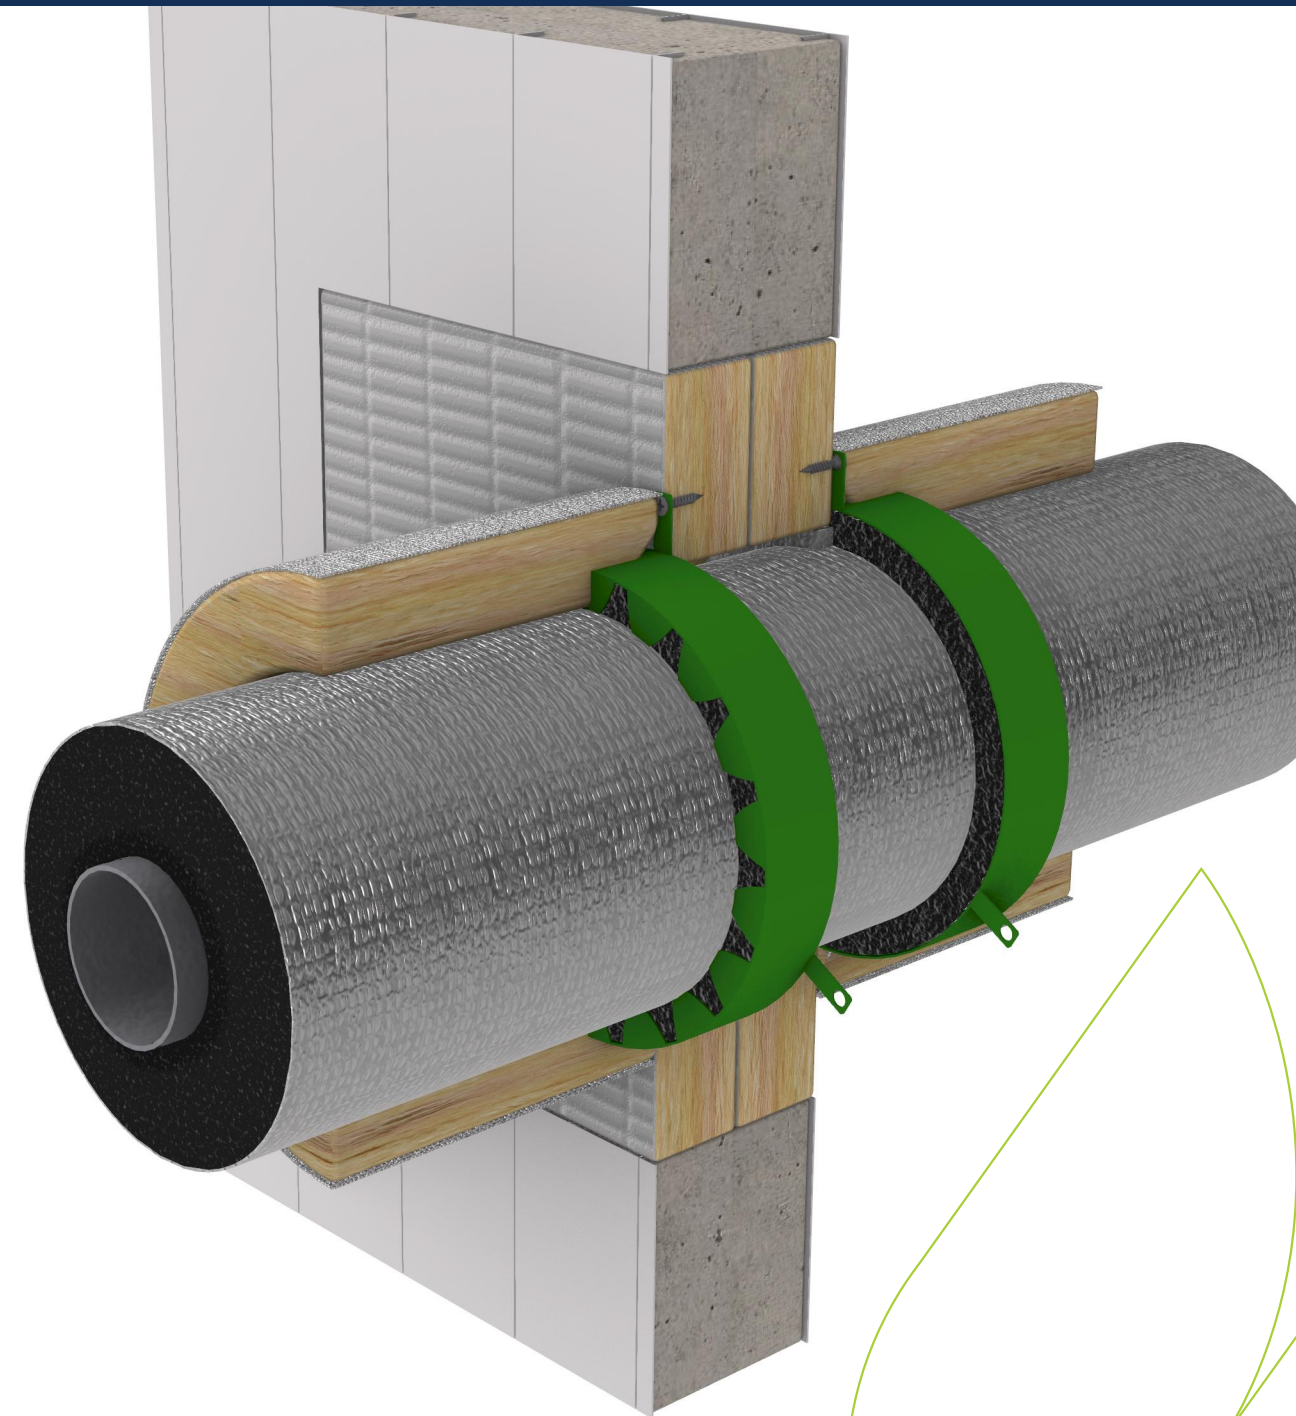


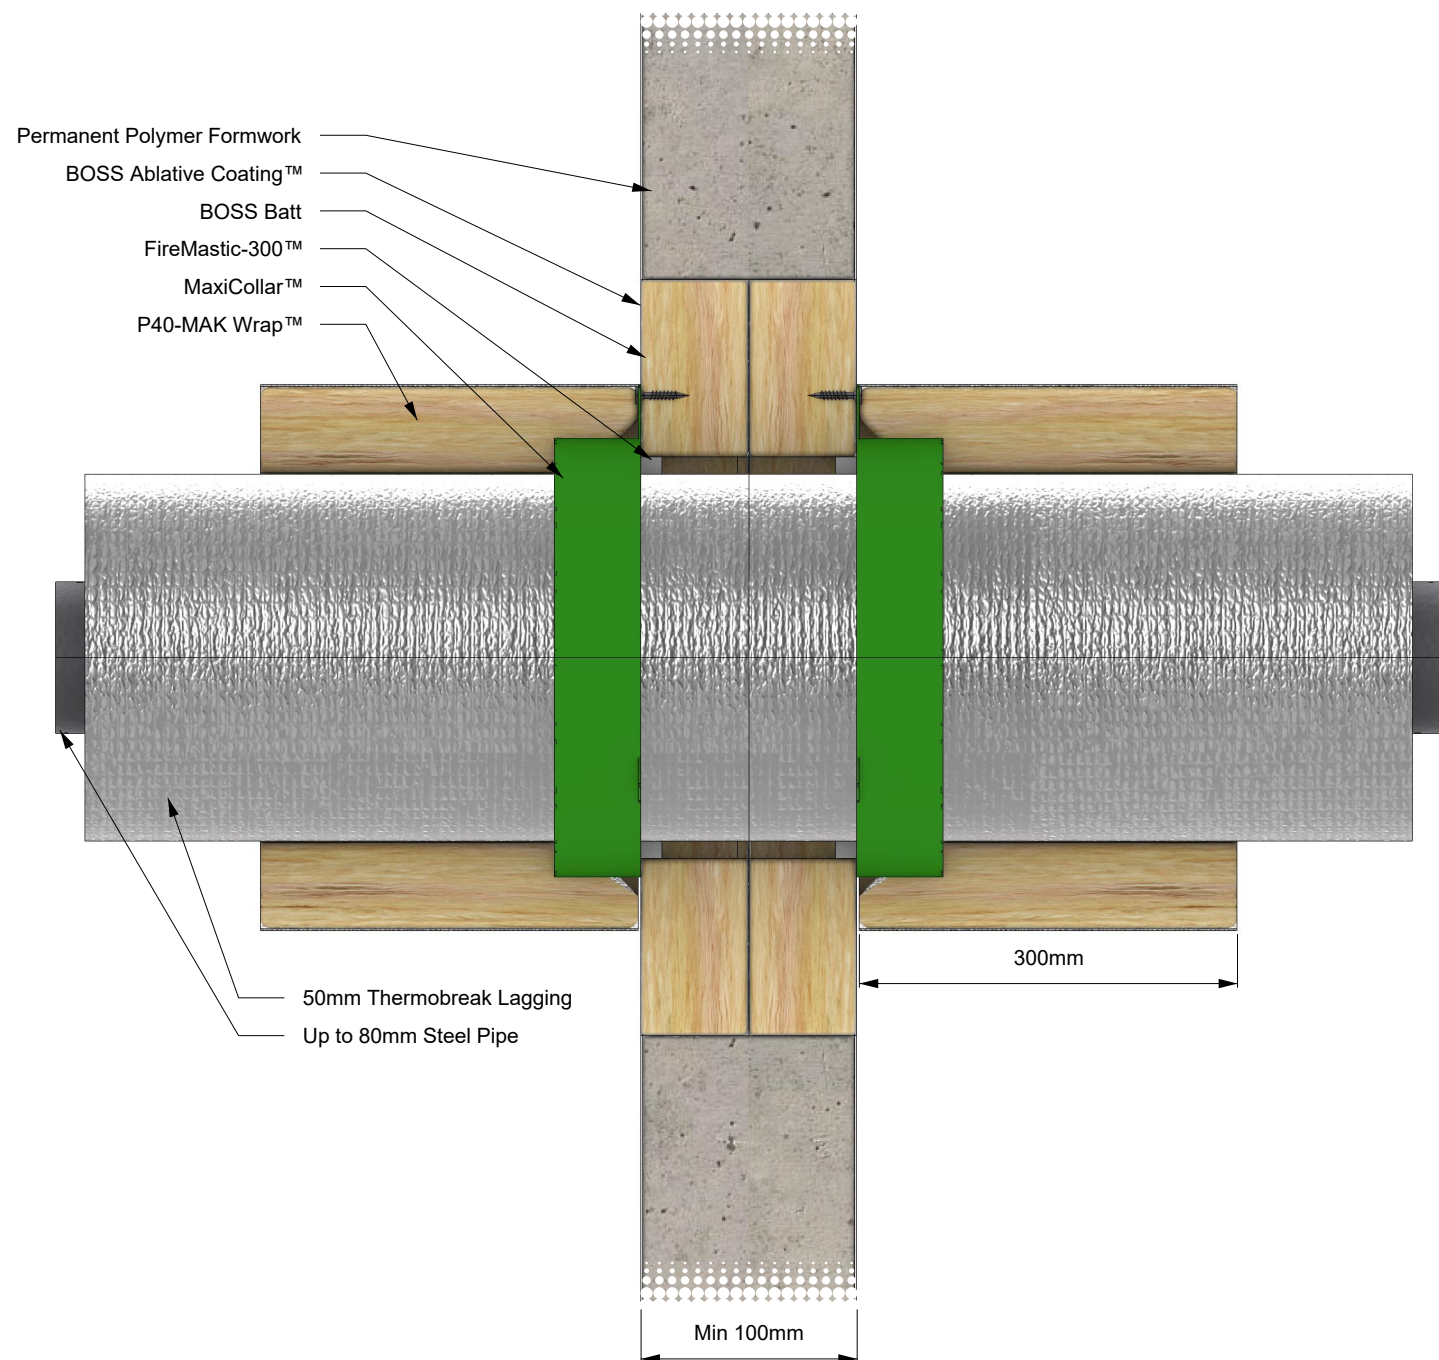

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS P40-MAK Wrap™	Up to 80 mm steel pipe with continuous 50 mm Thermobreak tube lagging, penetrating 2 layers of BossBatt™ protecting an aperture up to 1100 mm x 1100 mm, with P40-MAK Wrap™ insulation 300 mm to both sides. FireMastic-300™ is applied to any gaps around the pipe and a 150 mm BOSS MaxiCollar™ is installed to both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	BOSS MaxiCollar™		Supplementary Standard:		AS 4072.1-2005	
Service:	Insulated Steel Pipes	BOSS FireMastic-300™	-		Report Reference:		FAR 4572	
Substrate:	Permanent Polymer Formwork	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2325.21	
Min Substrate Thickness (mm):	100	up to 1100 x 1100	-		Date:	01/09/25	Rev:	01
Sealant Depth (mm):	Fill Gaps	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0	-						
Wrap Length (mm):	300							
FRL / FRR:	-/120/120							