
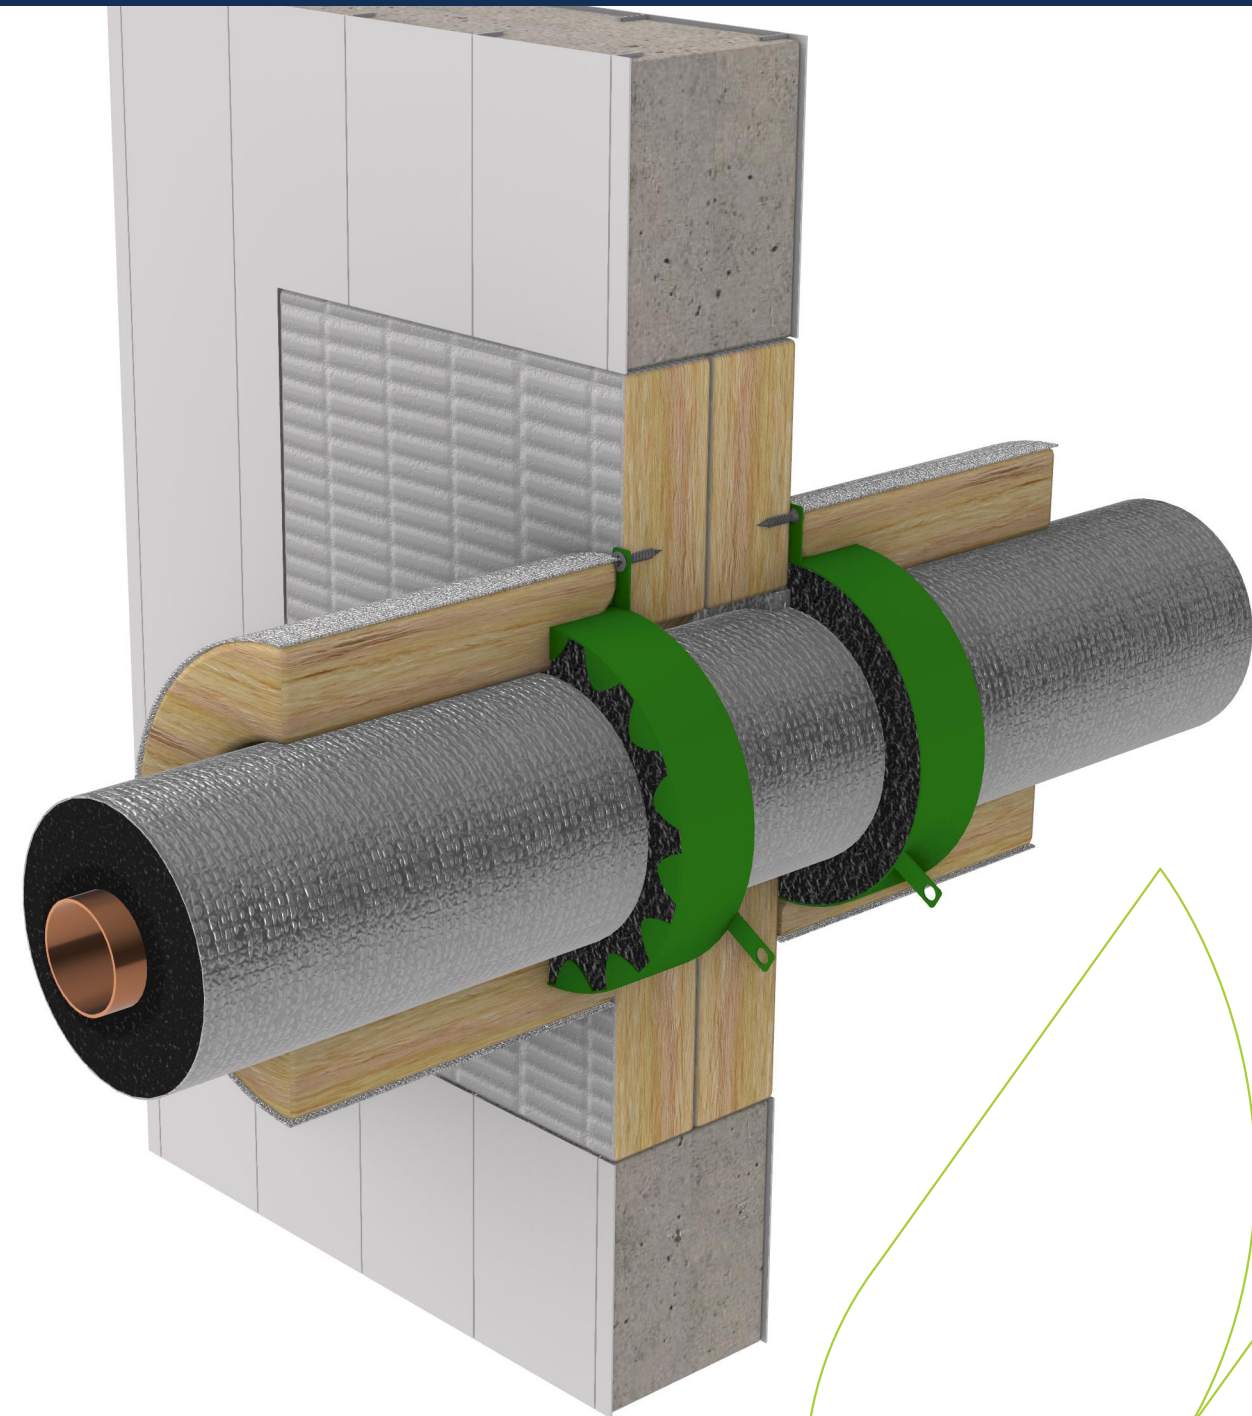


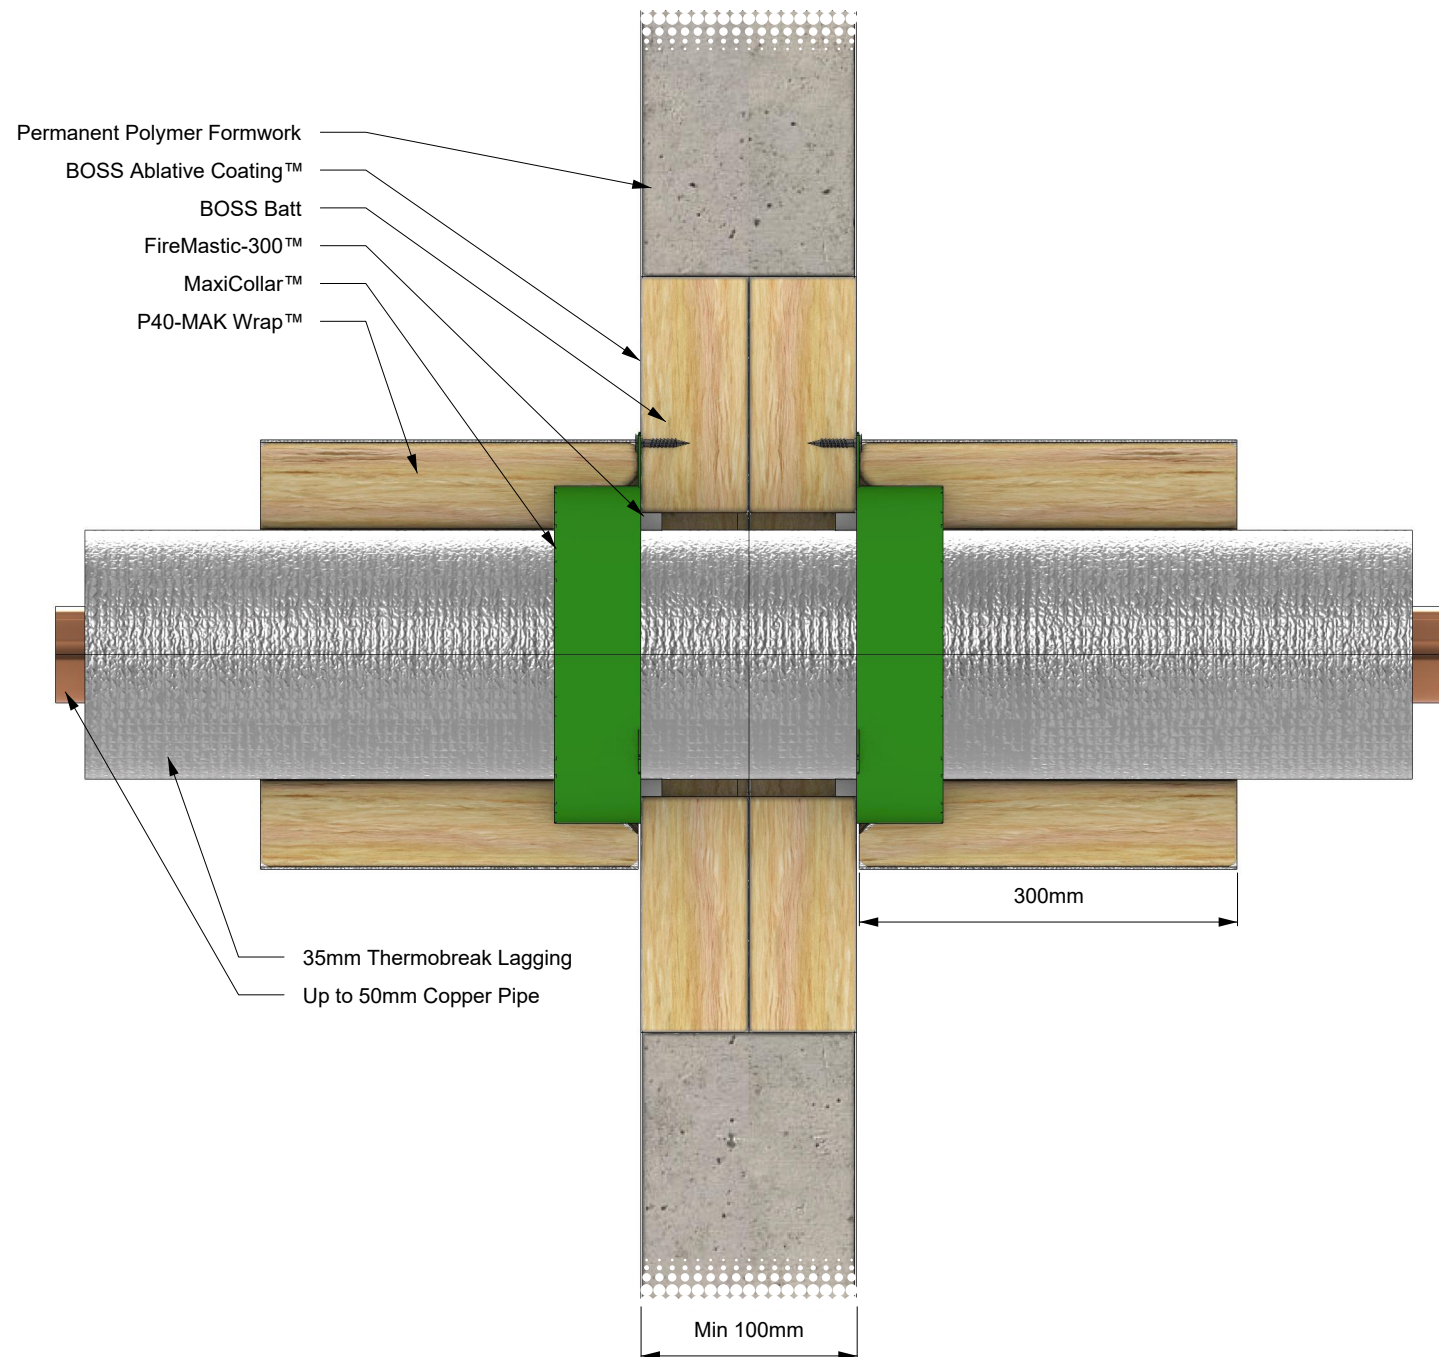

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS P40-MAK Wrap™	Up to 50 mm copper pipe with continuous 35 mm Thermobreak tube lagging, penetrating 2 layers of BossBatt™ protecting an aperture up to 1100 mm x 1100 mm, with P40-MAK Wrap™ insulation 300 mm to both sides. FireMastic-300™ is applied to any gaps around the pipe and a 100 mm BOSS MaxiCollar™ is installed to both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	BOSS MaxiCollar™		Supplementary Standard:		AS 4072.1-2005	
Service:	Insulated Copper Pipes	BOSS FireMastic-300™	-		Report Reference:		FAR 4572	
Substrate:	Permanent Polymer Formwork	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2331.21	
Min Substrate Thickness (mm):	100	up to 1100 x 1100	-		Date:	01/09/25	Rev:	01
Sealant Depth (mm):	Fill Gaps	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0	-						
Wrap Length (mm):	300							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.