
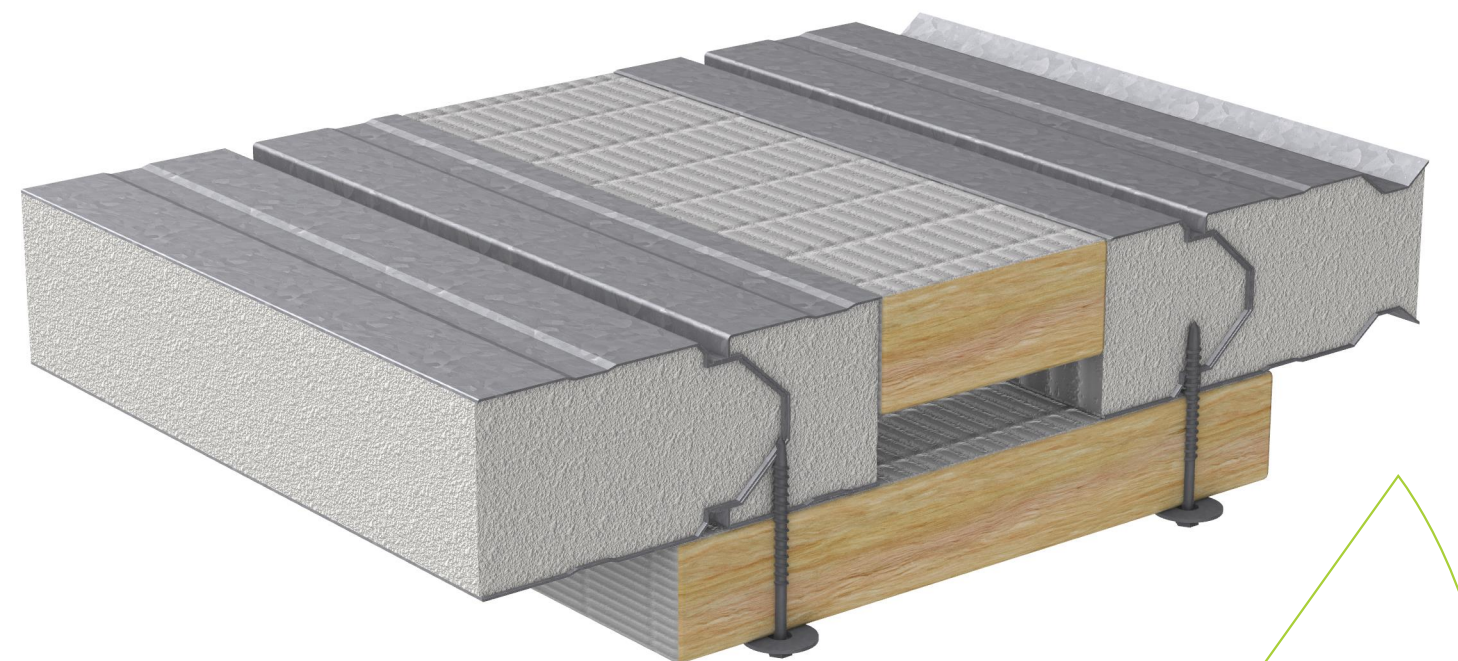


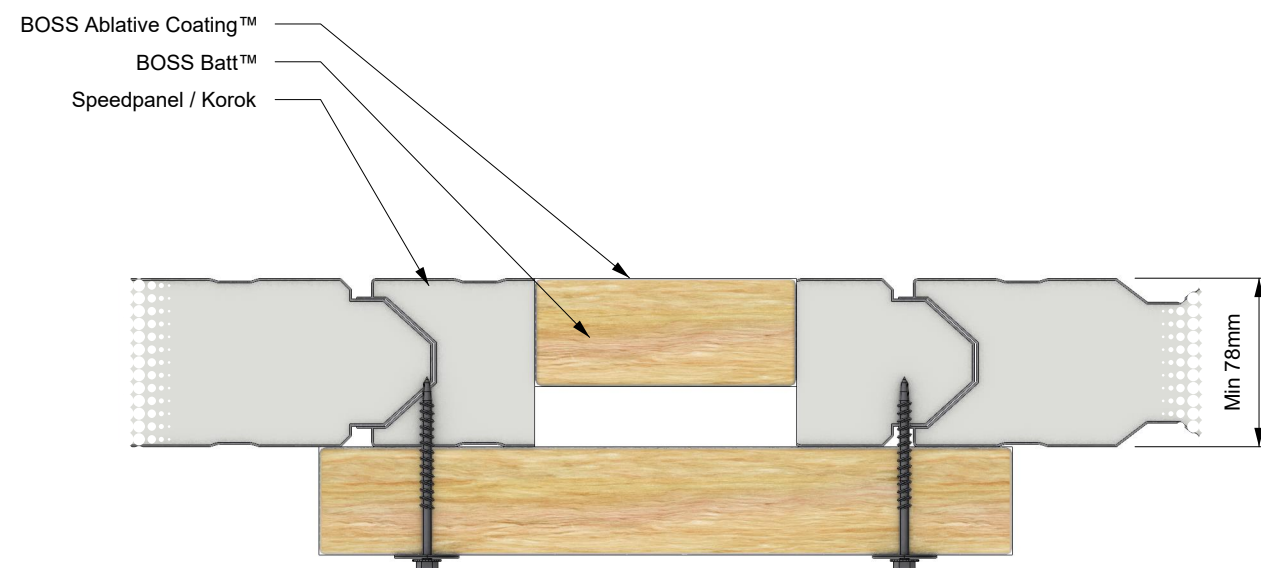

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS Batt™	-	100 mm thick double layer of BossBatt™ friction fitted into an aperture up to 200 mm gap x Unlimited length, coated with 1 mm DFT BOSS Ablative Coating™. A bead of sealant is applied to the edges of the batt and the separating element to both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Construction (Linear Gaps / Blank Seals)	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	BOSS FireMastic-300™	-		Report Reference:		FAR 4572	
Substrate:	Speedpanel / Korok (Horiz)	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2338.32	
Min Substrate Thickness (mm):	100	200 gap x Unlimited length	-		Date:	28/05/25	Rev:	01
Sealant Depth (mm):	Fill Gaps	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0	-						
Wrap Length (mm):	-							
FRL / FRR:	-/240/180							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.