
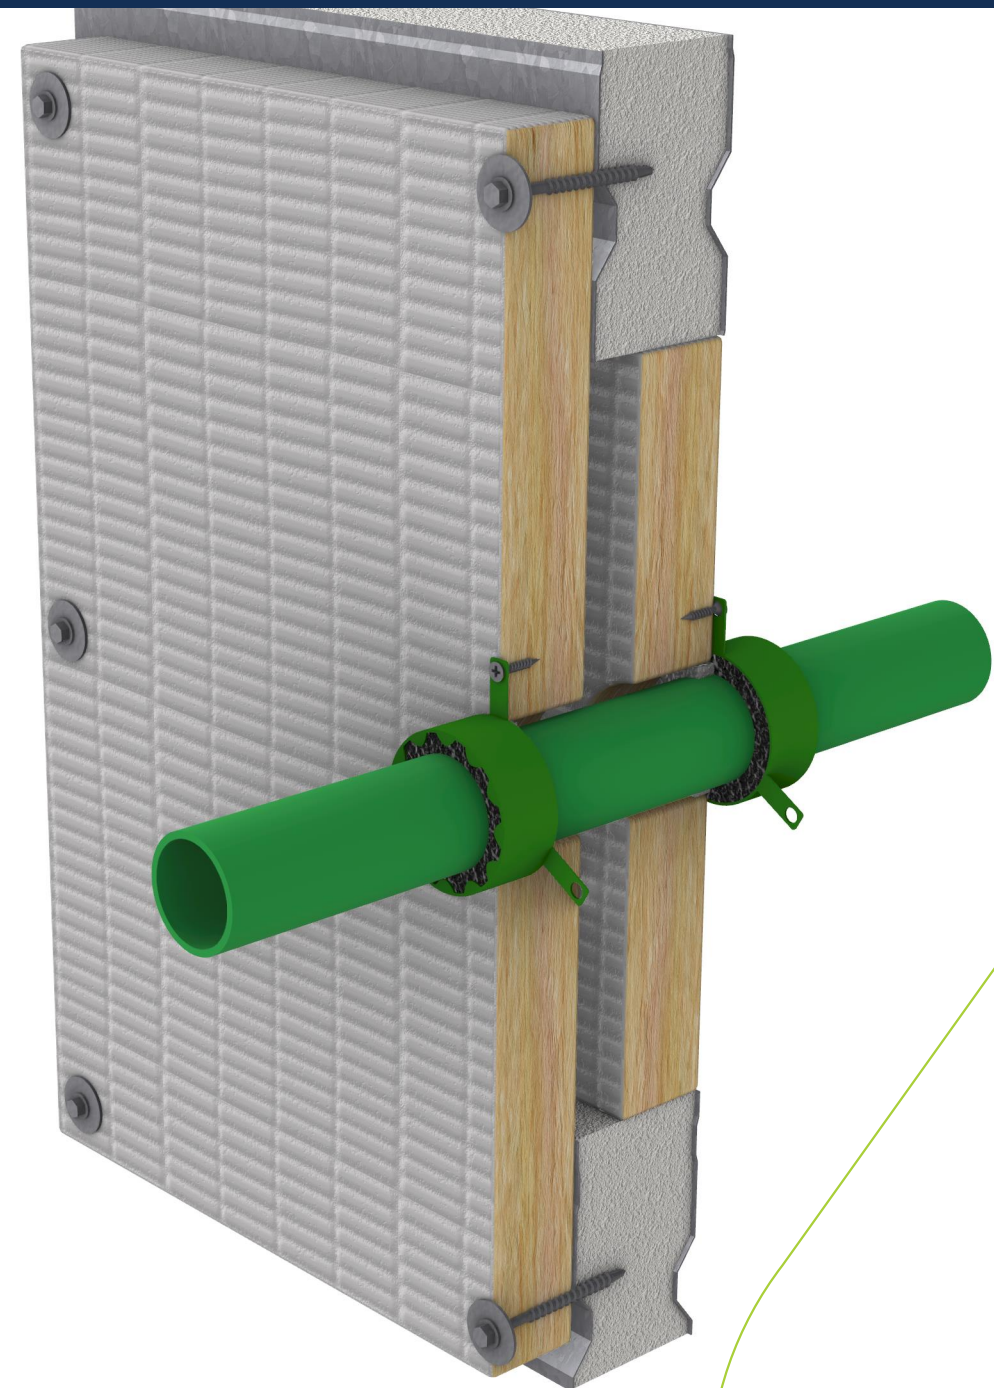


Speedpanel / Korok
BOSS Batt
BOSS Ablative Coating™
BOSS FireMastic-300™
BOSS MaxiCollar™
Up to 50mm PP/PPR Pipe

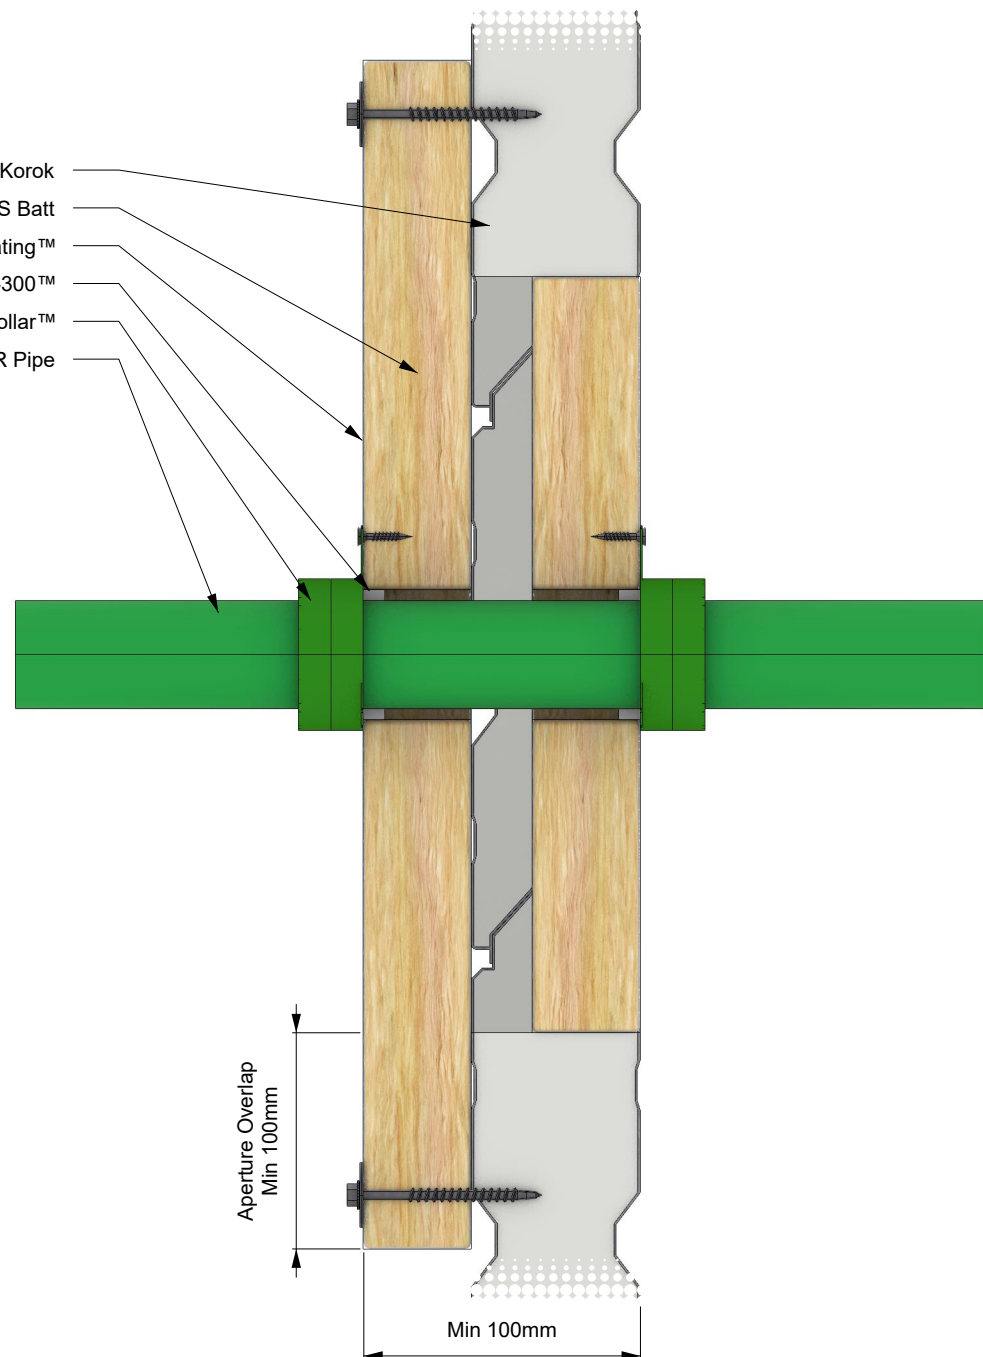

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS FireMastic-300™	Up to 50 mm PP/PPR pipe with 2.0 mm wall thickness, penetrating 2 layers of BossBatt™ protecting an aperture up to 1200 mm x 500 mm. Sealant installed around service 10 mm deep in 10 mm annular gap finished flush both sides. The system includes a 50 mm BOSS MaxiCollar™ installed to both sides. Installed in min 100 mm thick walls.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PPR	BOSS MaxiCollar™	-		Report Reference:		WF FAS 210203	
Substrate:	Speedpanel / Korok	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2347.6	
Min Substrate Thickness (mm):	100	Up to 1200 x 500	10		Date:		28/05/25	Rev: 01
Sealant Depth (mm):	10	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0	-						
Wrap Length (mm):	-							
FRL / FRR:	-/120/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.