
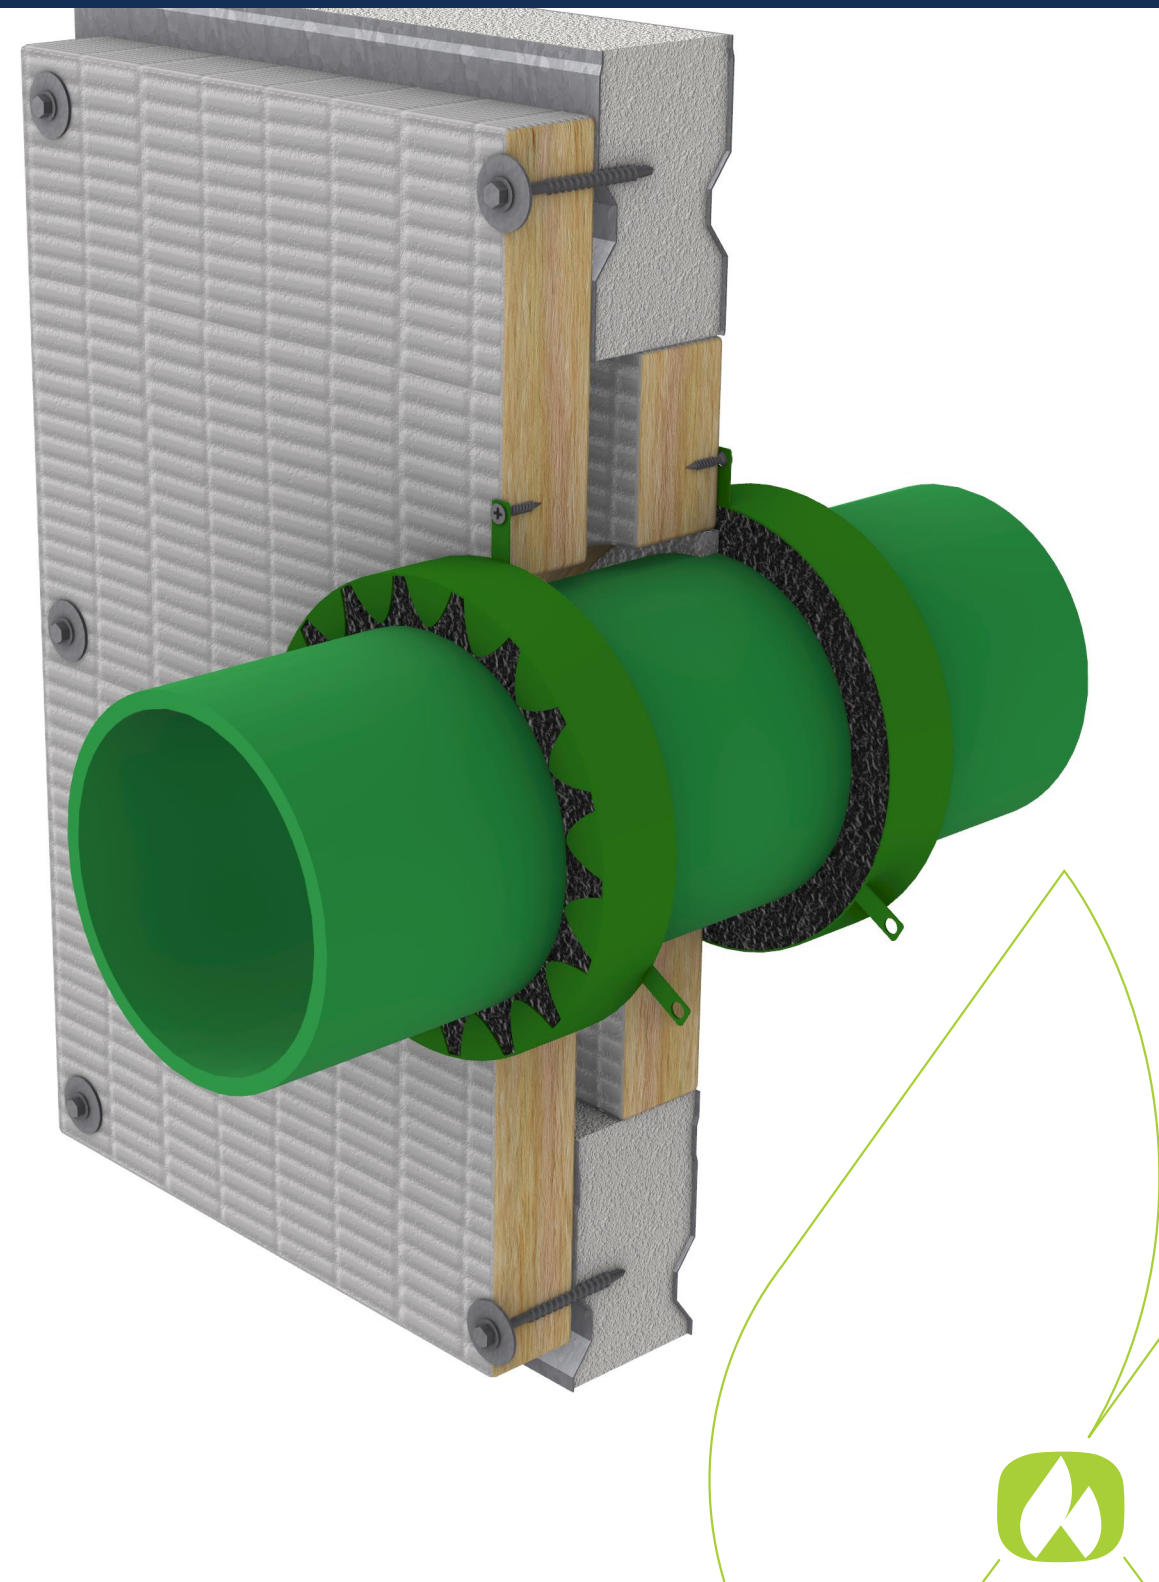


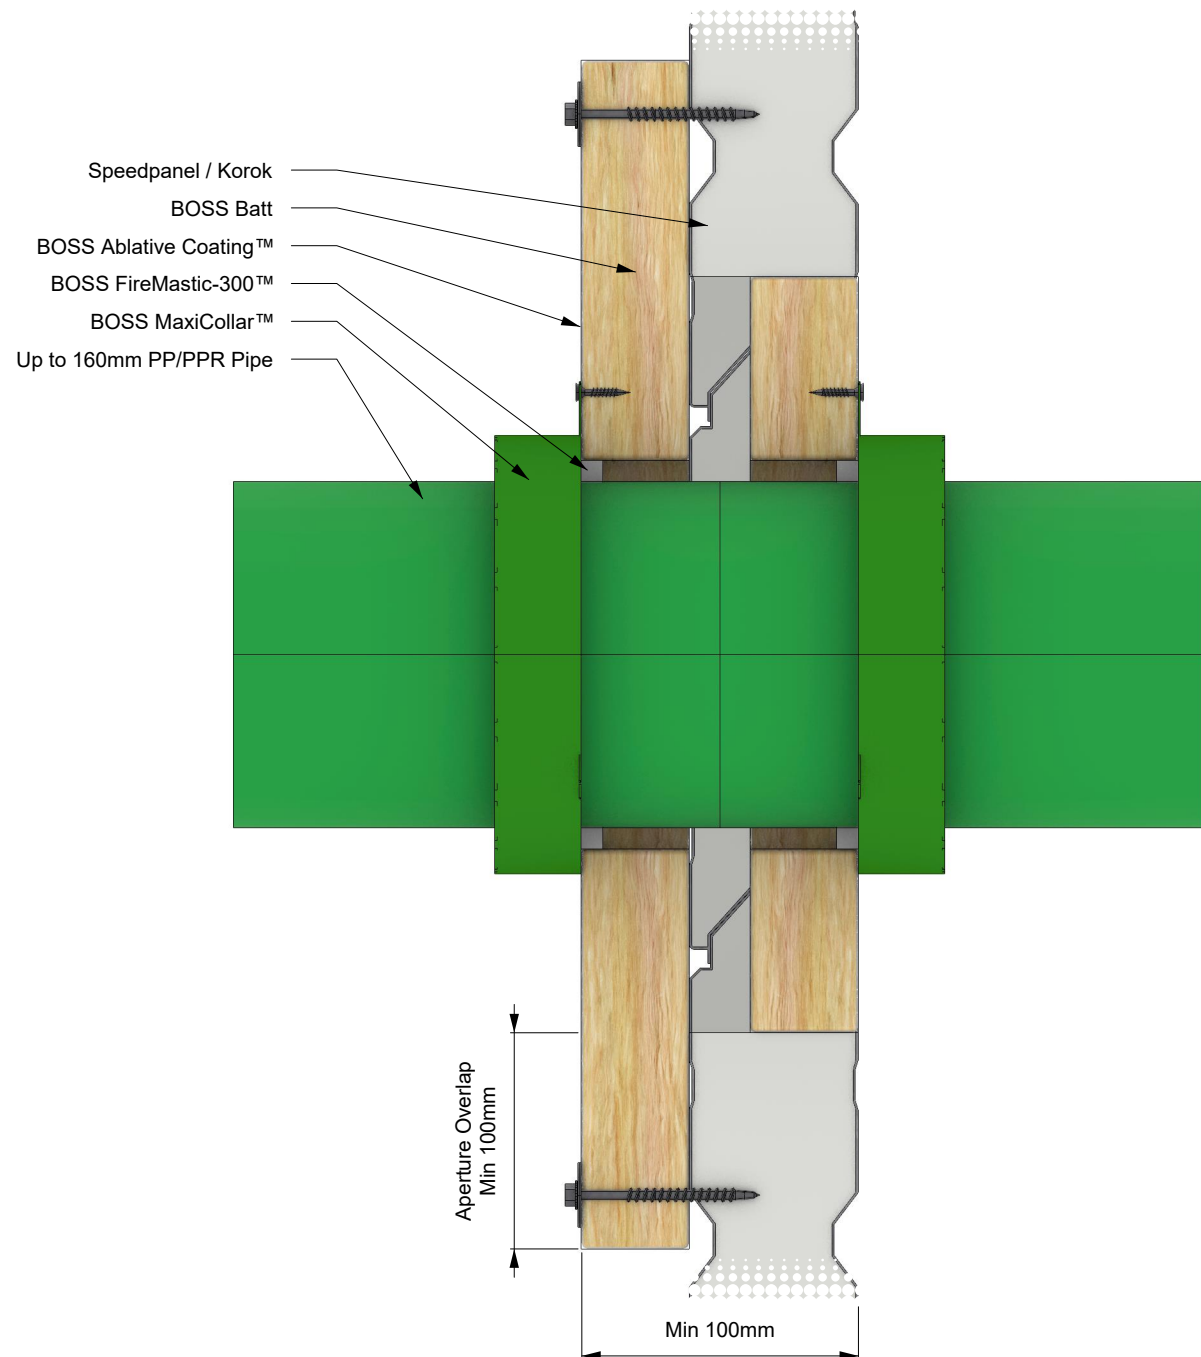

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS FireMastic-300™	Up to 160 mm PP/PPR pipe with 9.1 mm wall thickness, penetrating 2 layers of BossBatt™ protecting an aperture up to 1200 mm x 500 mm. Sealant installed around service 10 mm deep in 10 mm annular gap finished flush both sides. The system includes a 160 mm BOSS MaxiCollar™ installed to both sides. Installed in min 100 mm thick walls.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PPR	BOSS MaxiCollar™	-		Report Reference:		WF FAS 210203	
Substrate:	Speedpanel / Korok	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2355.6	
Min Substrate Thickness (mm):	100	Up to 1200 x 500	10		Date:		28/05/25	Rev:
Sealant Depth (mm):	10	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	0	-						
Wrap Length (mm):	-							
FRL / FRR:	-/15/15							