BOSS BF-2367-7

AU: 1300 502 677 | NZ: 0800 502 677 www.bossfire.com

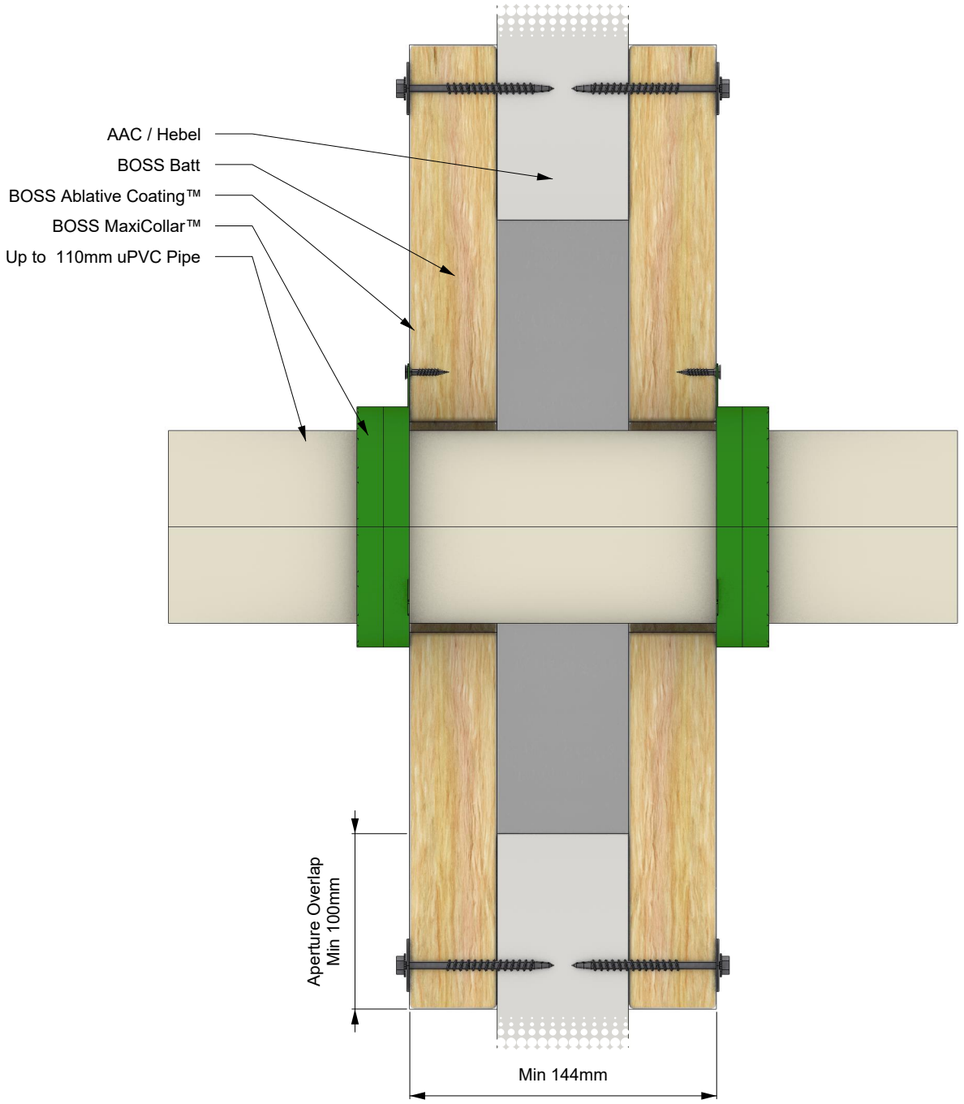

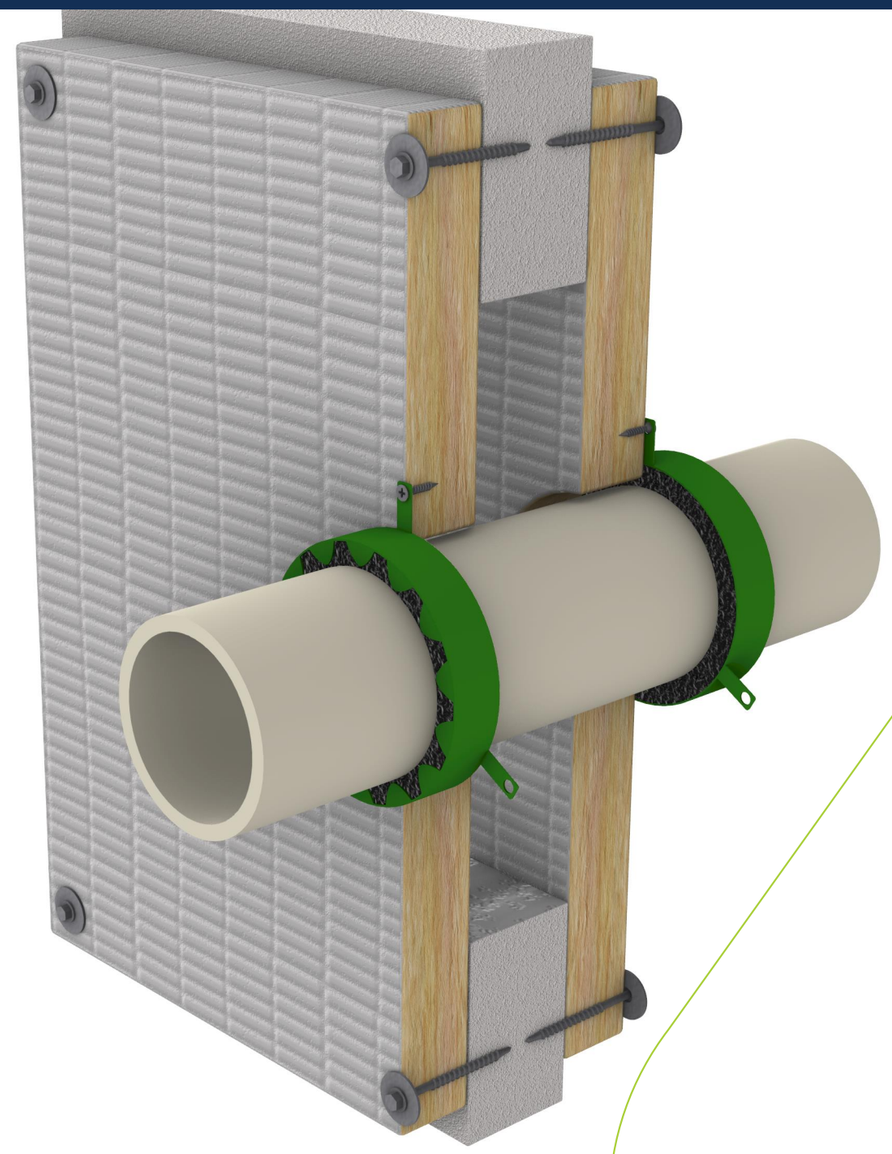

SYSTEM DESCRIPTION	
Orientation:	Wall
Trade / Type:	Plumbing / Hydraulic / Active Fire
Service:	UPVC
Substrate:	AAC / Hebel
Min Substrate Thickness (mm):	144
Sealant Depth (mm):	0
Sealant Fillet (mm):	0
Wrap Length (mm):	-
FRL / FRR:	-/120/120

FIRE STOPPING INFORMATION	
BOSS Batt™	-
BOSS Ablative Coating™	-
BOSS MaxiCollar™	-
APERTURE (mm)	**ANNULAR GAP (mm)**
Up to 1200 x 500	5
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

100 mm uPVC pipe with 3.2 mm wall thickness, penetrating 2 layers of BossBatt™ protecting an aperture up to 1200 mm x 500 mm. The system includes a 100 mm BOSS MaxiCollar™ installed to both sides. Installed in min 144 mm thick walls.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	WF FAS 210203		
Drawing Number:	BF-2367.7		
Date:	28/05/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.