
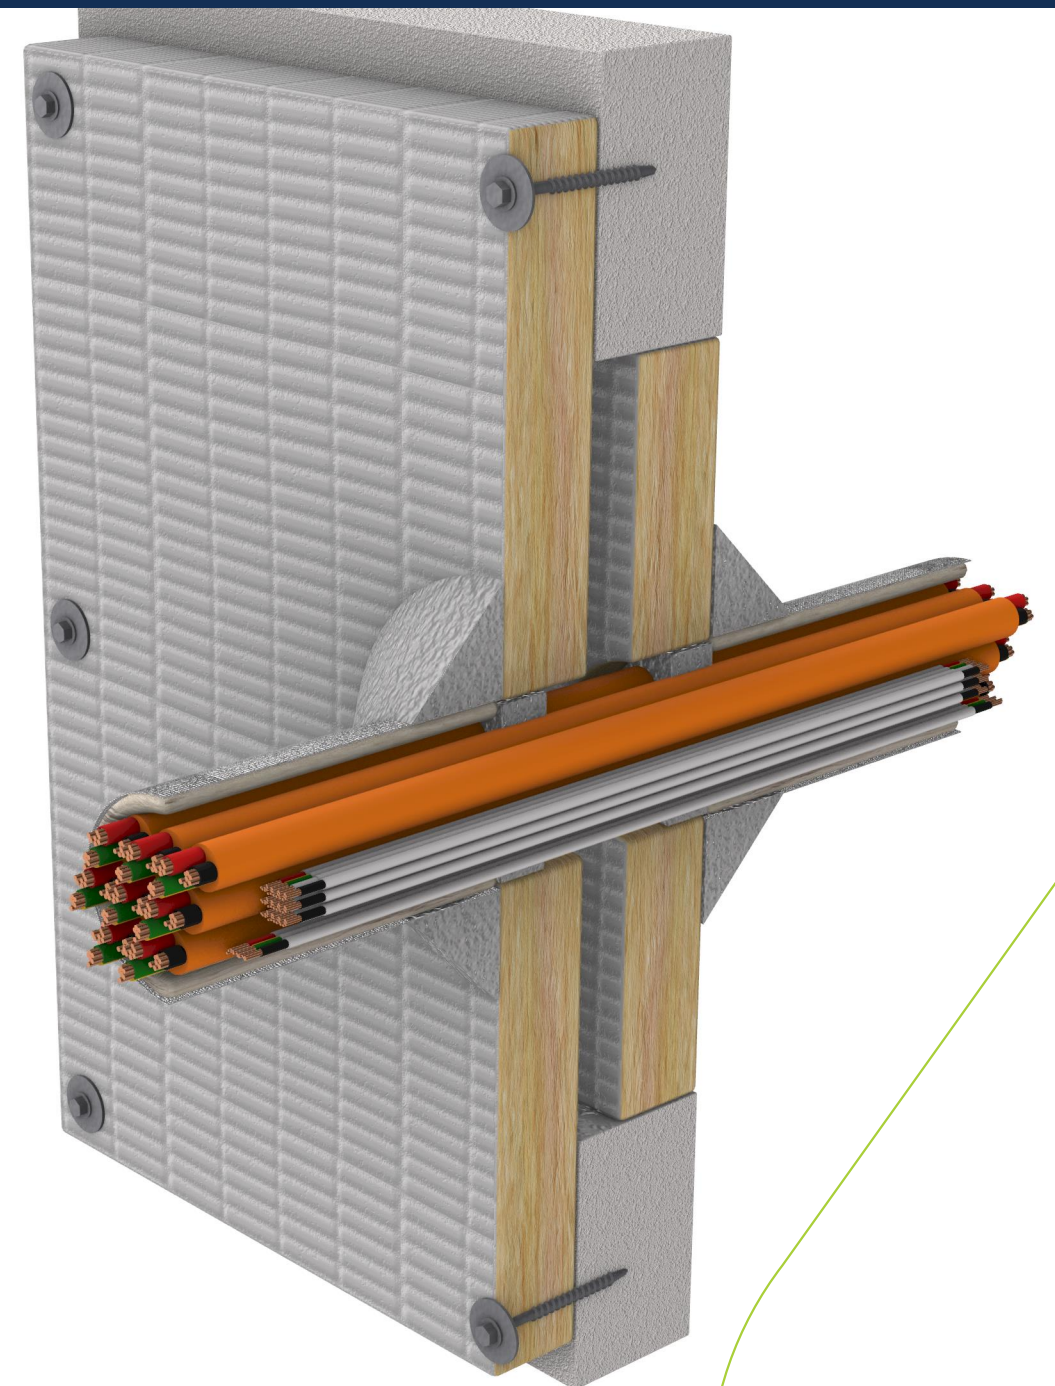


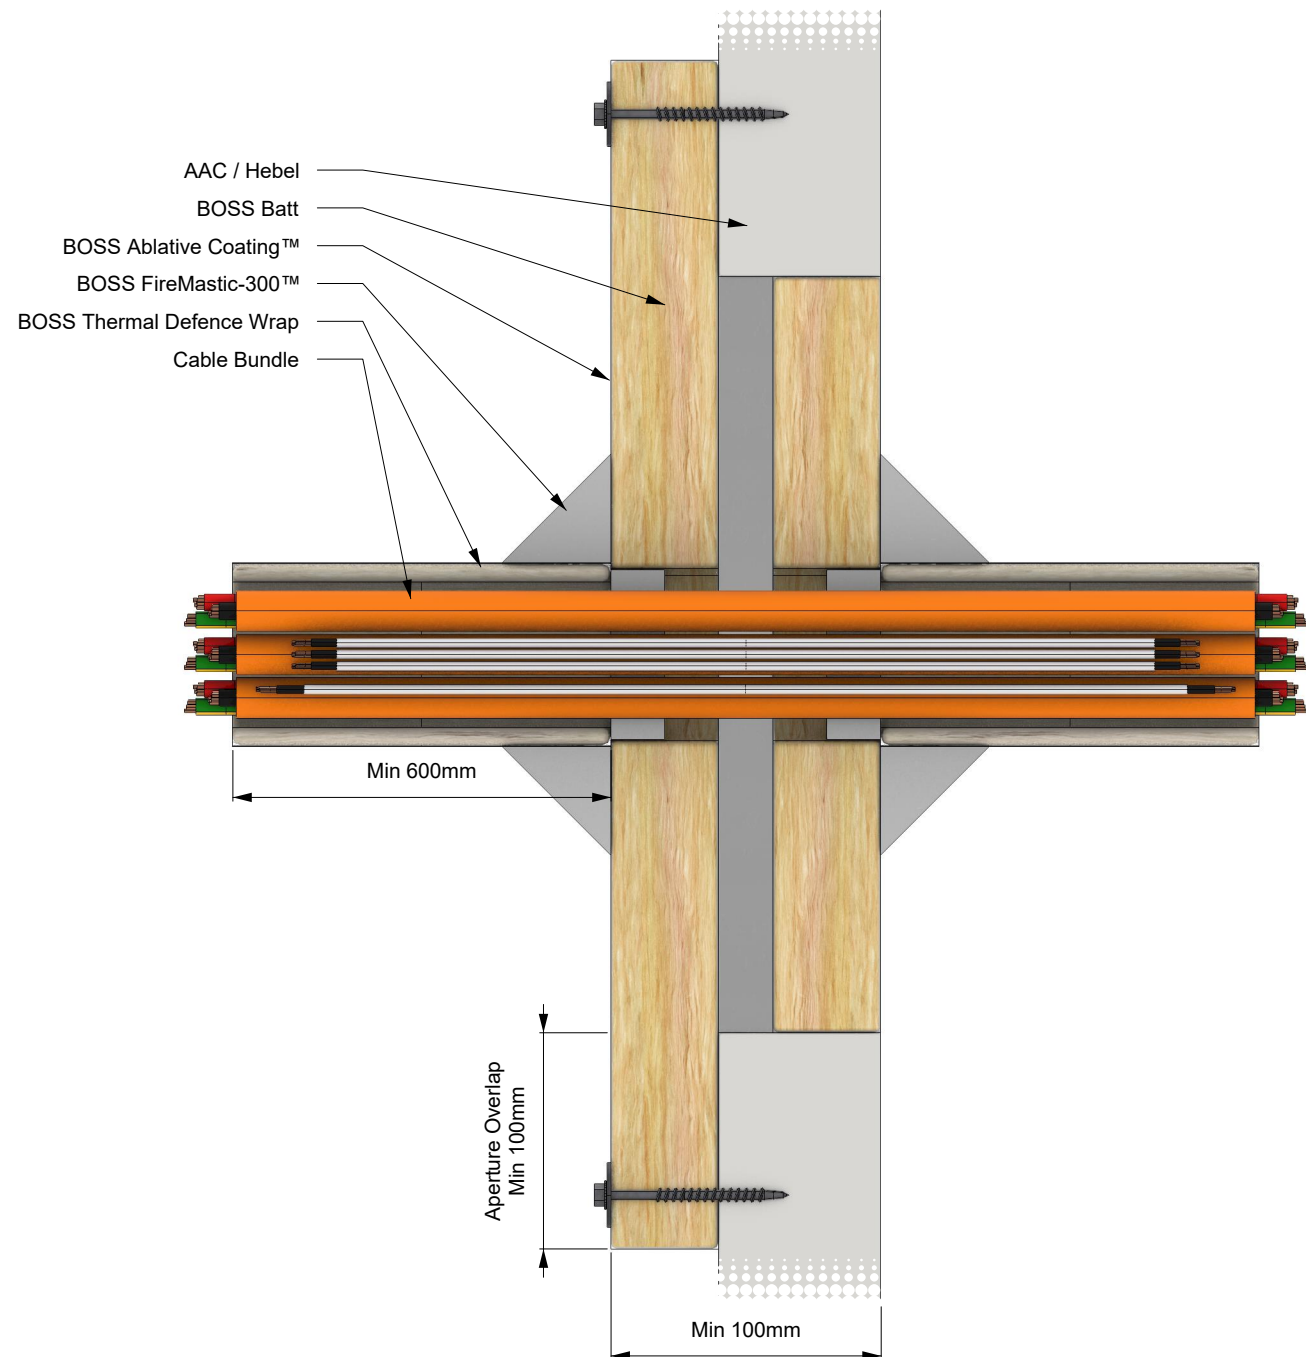

SYSTEM DESCRIPTION

Orientation:	Wall
Trade / Type:	Electrical
Service:	Multi Core / Orange Circular / Mains
Substrate:	AAC / Hebel
Min Substrate Thickness (mm):	100
Sealant Depth (mm):	25
Sealant Fillet (mm):	50
Wrap Length (mm):	600
FRL / FRR:	-/90/90

FIRE STOPPING INFORMATION

BOSS Batt™	BOSS Thermal Defence
BOSS Ablative Coating™	-
BOSS FireMastic-300™	-
APERTURE (mm)	ANNULAR GAP (mm)
Up to 1100 x 1100	Up to 20
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

Cable bundle
-Up to 2.5mm² 2C+E Power Cable
-Up to 3 x 6mm² 3C+E Power Cables
-Up to 8 x 16mm² 3C+E Power Cables
FireMastic-300™ Sealant installed 25mm deep in annular gap up to 20mm wide, finished with a 50 mm x 50 mm fillet both sides. 600mm of Thermal Defence Wrap each side of the wall.

SUPPORTING INFORMATION

Reference Standard:		AS 1530.4:2014	
Supplementary Standard:		AS 4072.1-2005	
Report Reference:		WF FAS 200332	
Drawing Number:		BF-2372.7	
Date:	10/04/25	Rev:	01