
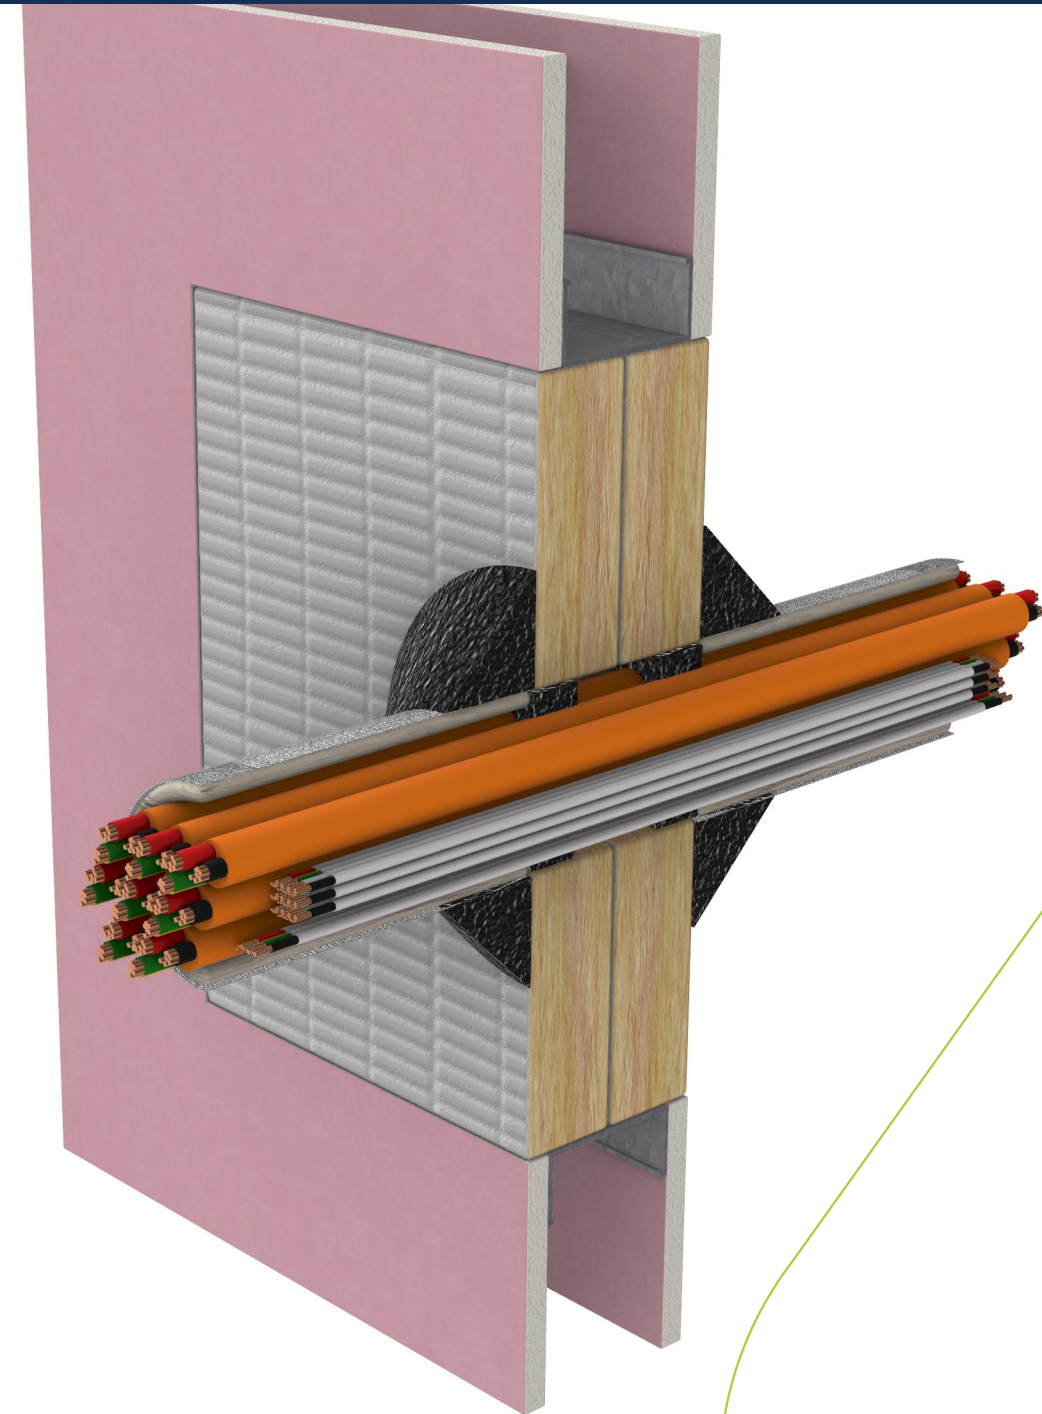


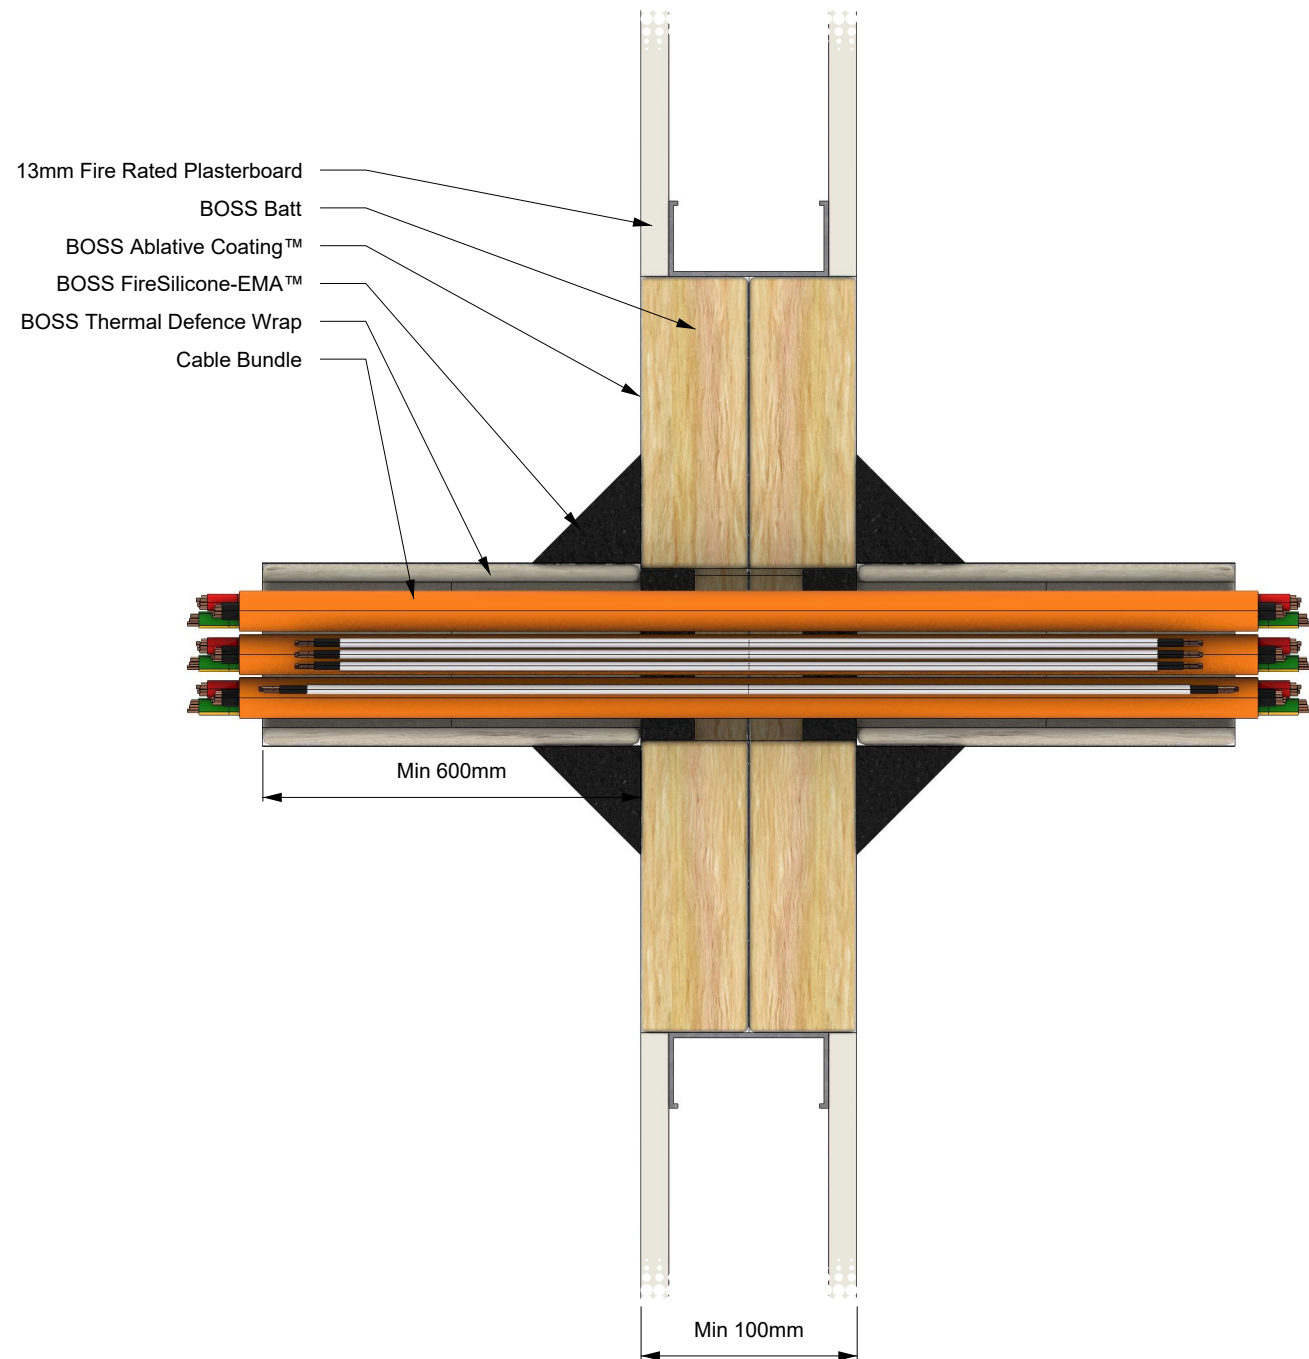

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS Thermal Defence	Cable bundle -Up to 2.5mm² 2C+E Power Cable -Up to 3 x 6mm² 3C+E Power Cables -Up to 8 x 16mm² 3C+E Power Cables FireSilicone-EMA™ Sealant installed 25mm deep in annular gap up to 20mm wide, finished with a 50 mm x 50 mm fillet both sides. 600mm of Thermal Defence Wrap each side of the wall.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Multi Core / Orange Circular / Mains	BOSS FireSilicone-EMA™	-		Report Reference:		WF FAS 200332	
Substrate:	Single Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2380.1	
Min Substrate Thickness (mm):	100	Up to 1100 x 1100	Up to 20		Date:	10/04/25	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	50	-						
Wrap Length (mm):	600							
FRL / FRR:	-/90/90							