
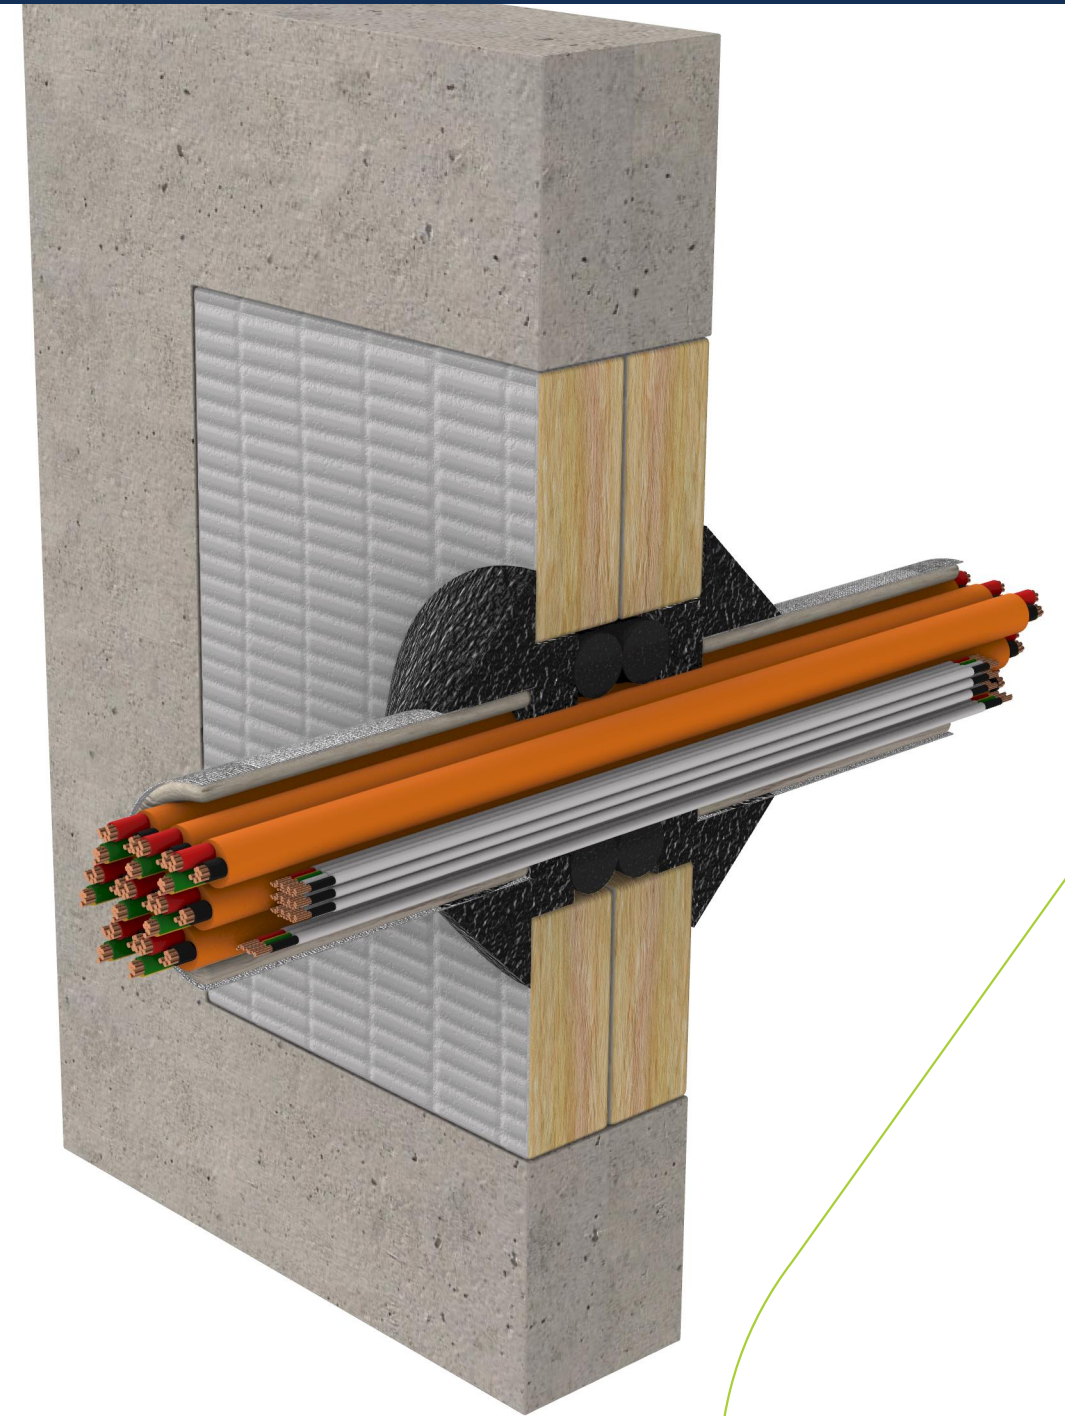


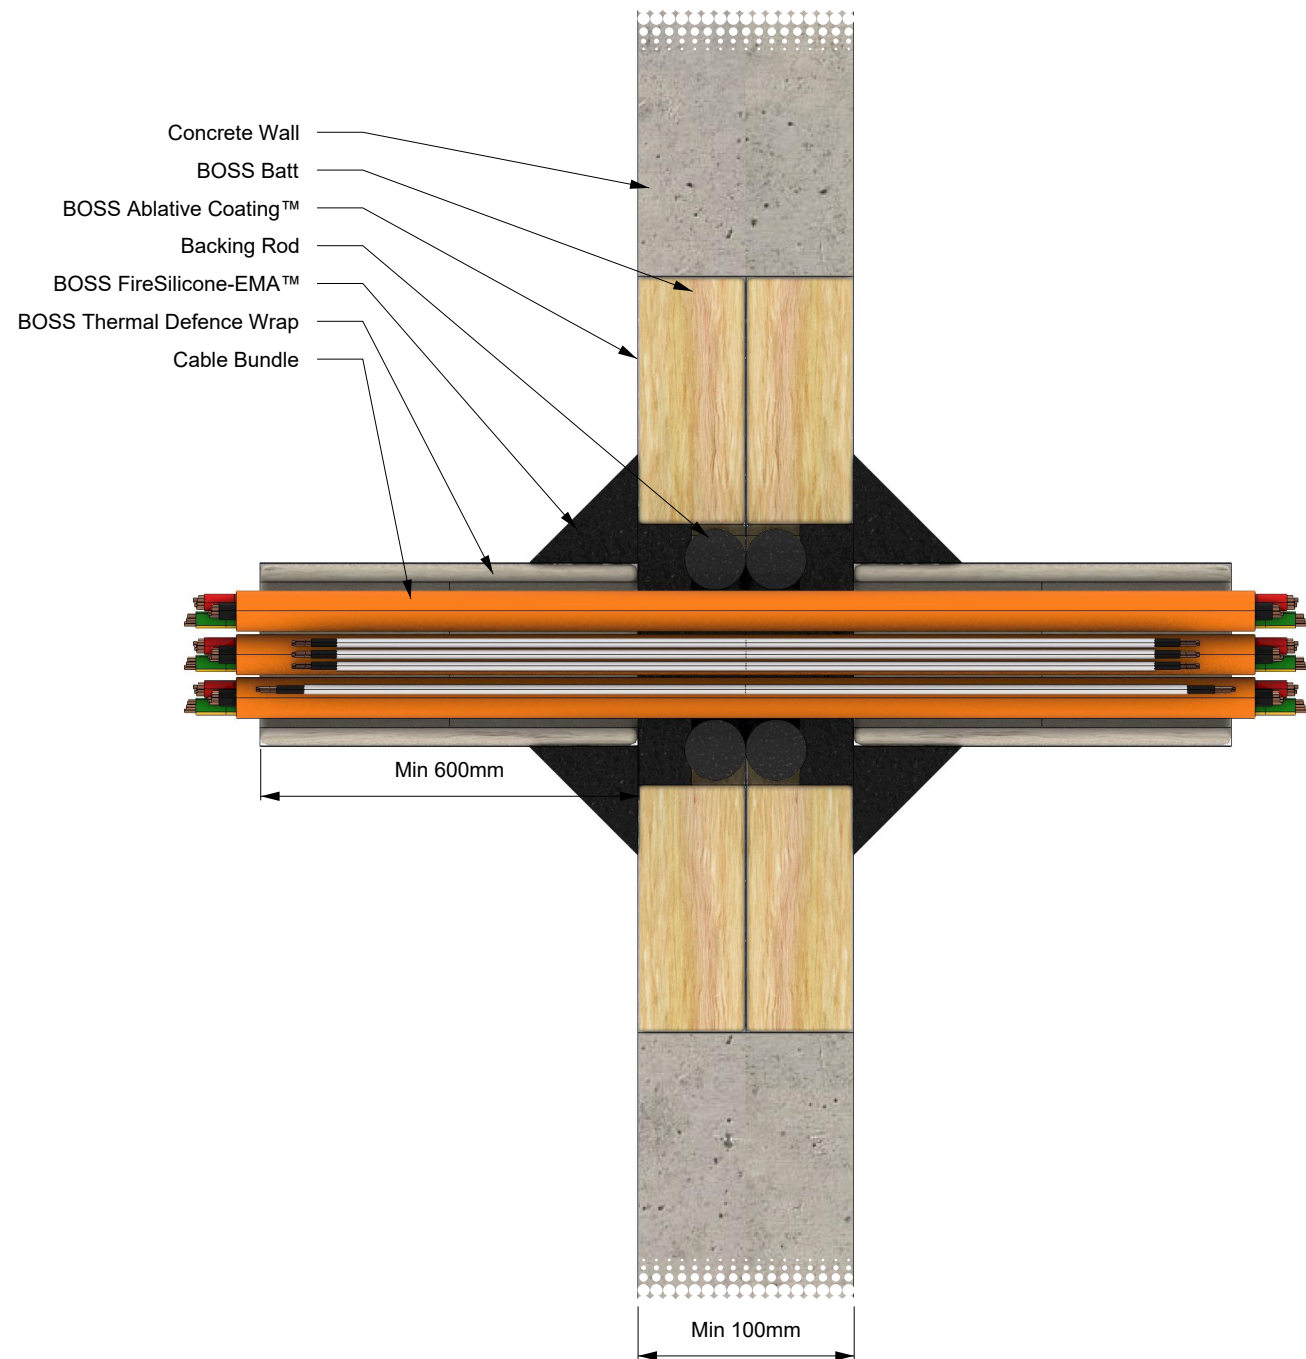

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS Thermal Defence	Cable bundle -Up to 2.5mm ² 2C+E Power Cable -Up to 3 x 6mm ² 3C+E Power Cables -Up to 8 x 16mm ² 3C+E Power Cables FireSilicone-EMA™ Sealant installed 25mm deep in annular gap. For annular gaps larger than 20mm and up to 50 mm, a mineral wool backing rod must be used to back the applied sealant. The service is to be finished with a 50 mm x 50 mm fillet both sides. 600mm of Thermal Defence Wrap each side of the wall.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Multi Core / Orange Circular / Mains	BOSS FireSilicone-EMA™	-		Report Reference:		WF FAS 200332	
Substrate:	Concrete wall	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2381.4	
Min Substrate Thickness (mm):	100	Up to 1100 x 1100	20 - 50		Date:	10/04/25	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	50	-						
Wrap Length (mm):	600							
FRL / FRR:	-/90/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.