
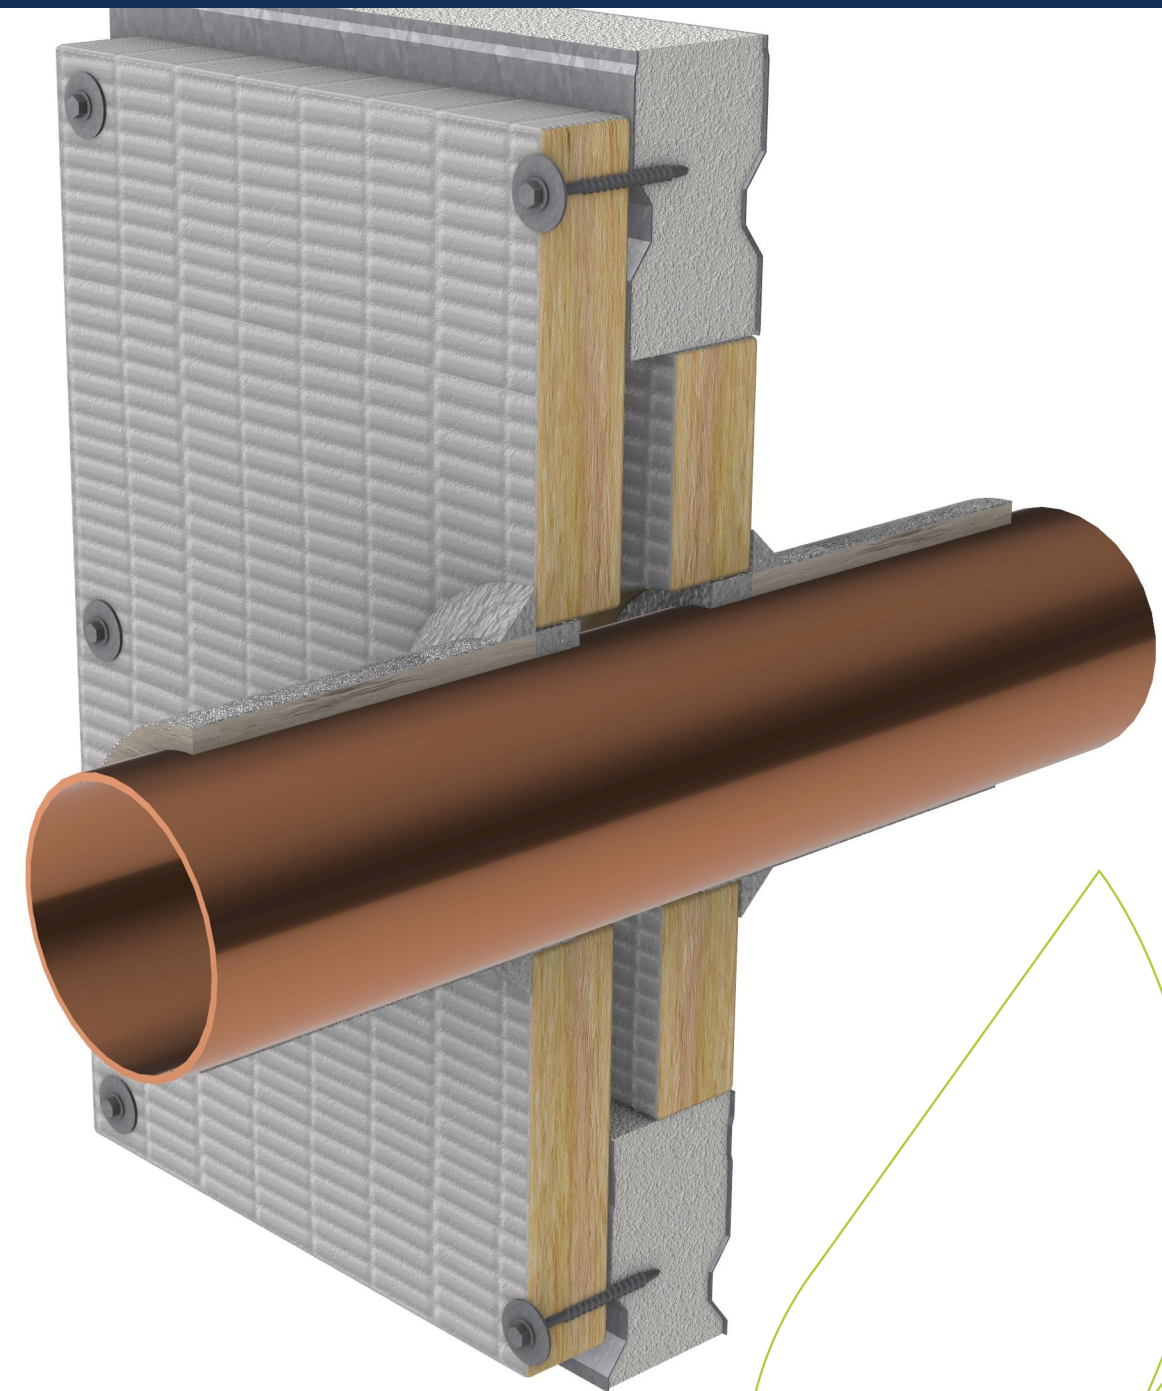


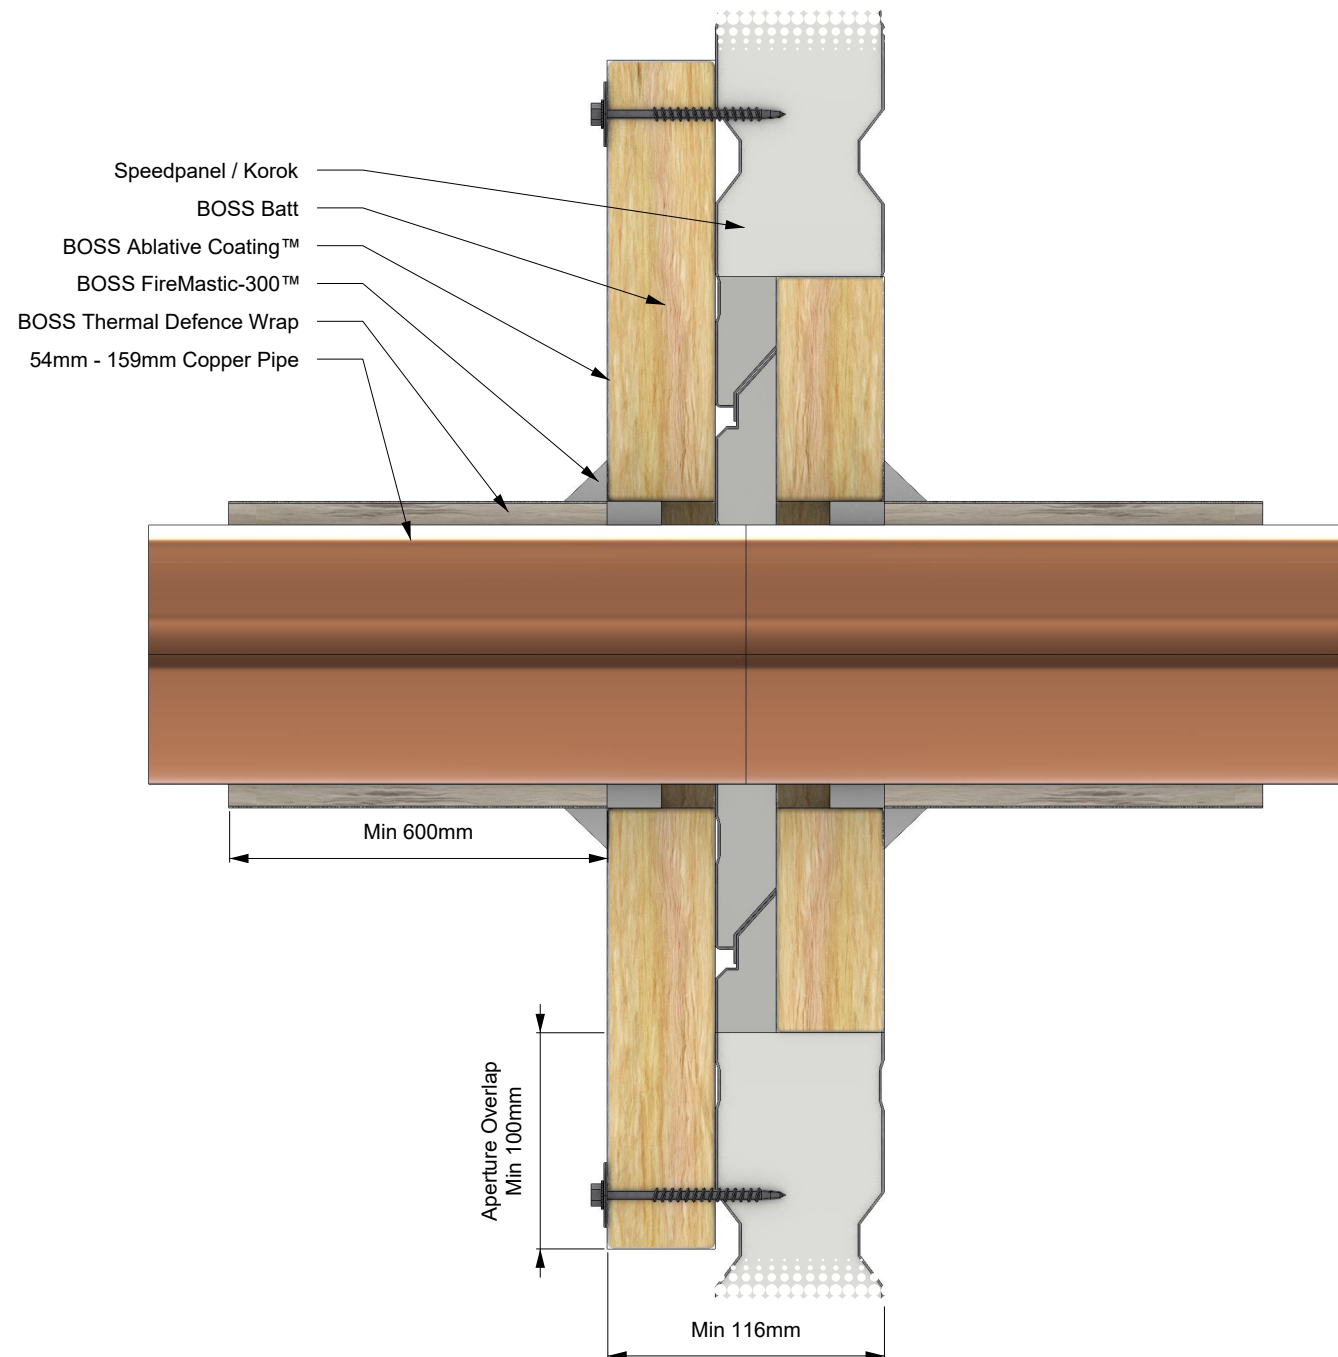

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Wall	BOSS Batt™	BOSS Thermal Defence	54mm - 159mm Copper pipe with maximum wall thickness of 1.0mm. FireMastic-300™ Sealant installed 25mm deep in annular gap up to 20mm wide, finished with a 20 mm x 20 mm fillet both sides. 600mm of Thermal Defence Wrap each side of the wall.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005		
Service:	Copper Pipes	BOSS FireMastic-300™	-		Report Reference:		WF FAS 200332		
Substrate:	Speedpanel / Korok	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2425.6		
Min Substrate Thickness (mm):	116	Up to 1100 x 1100	Up to 20		Date:	15/04/25	Rev:	01	
Sealant Depth (mm):	25	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	20	-							
Wrap Length (mm):	600								
FRL / FRR:	-/120/120								

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.