
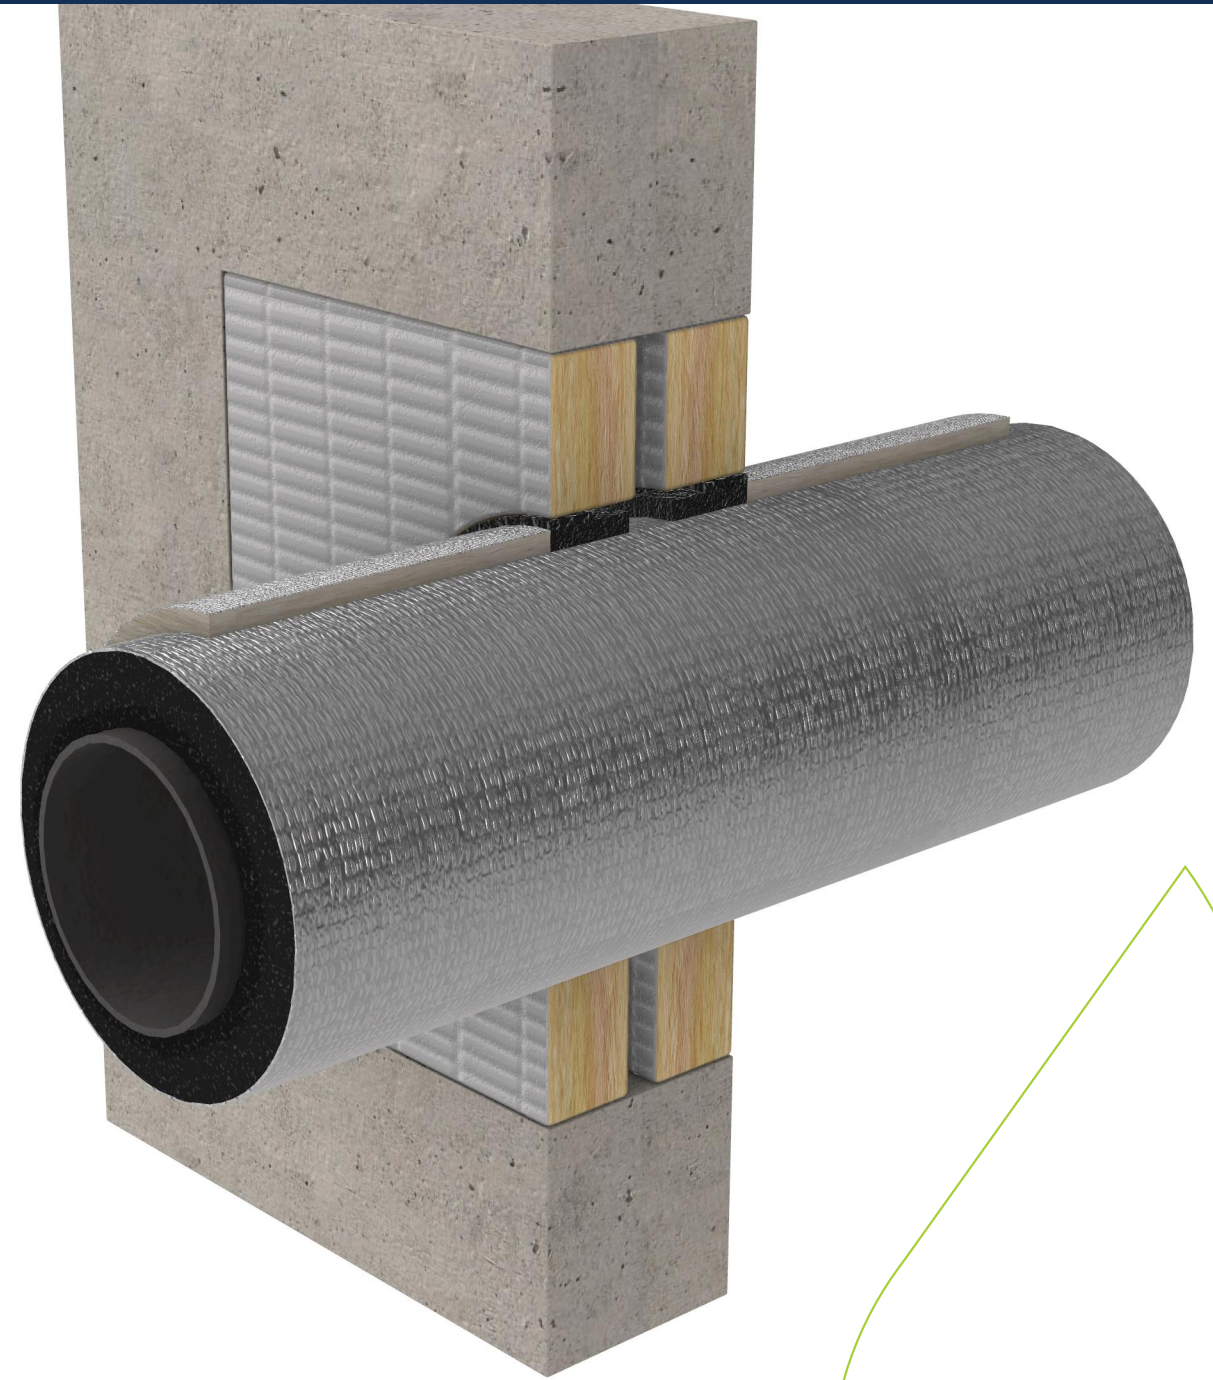


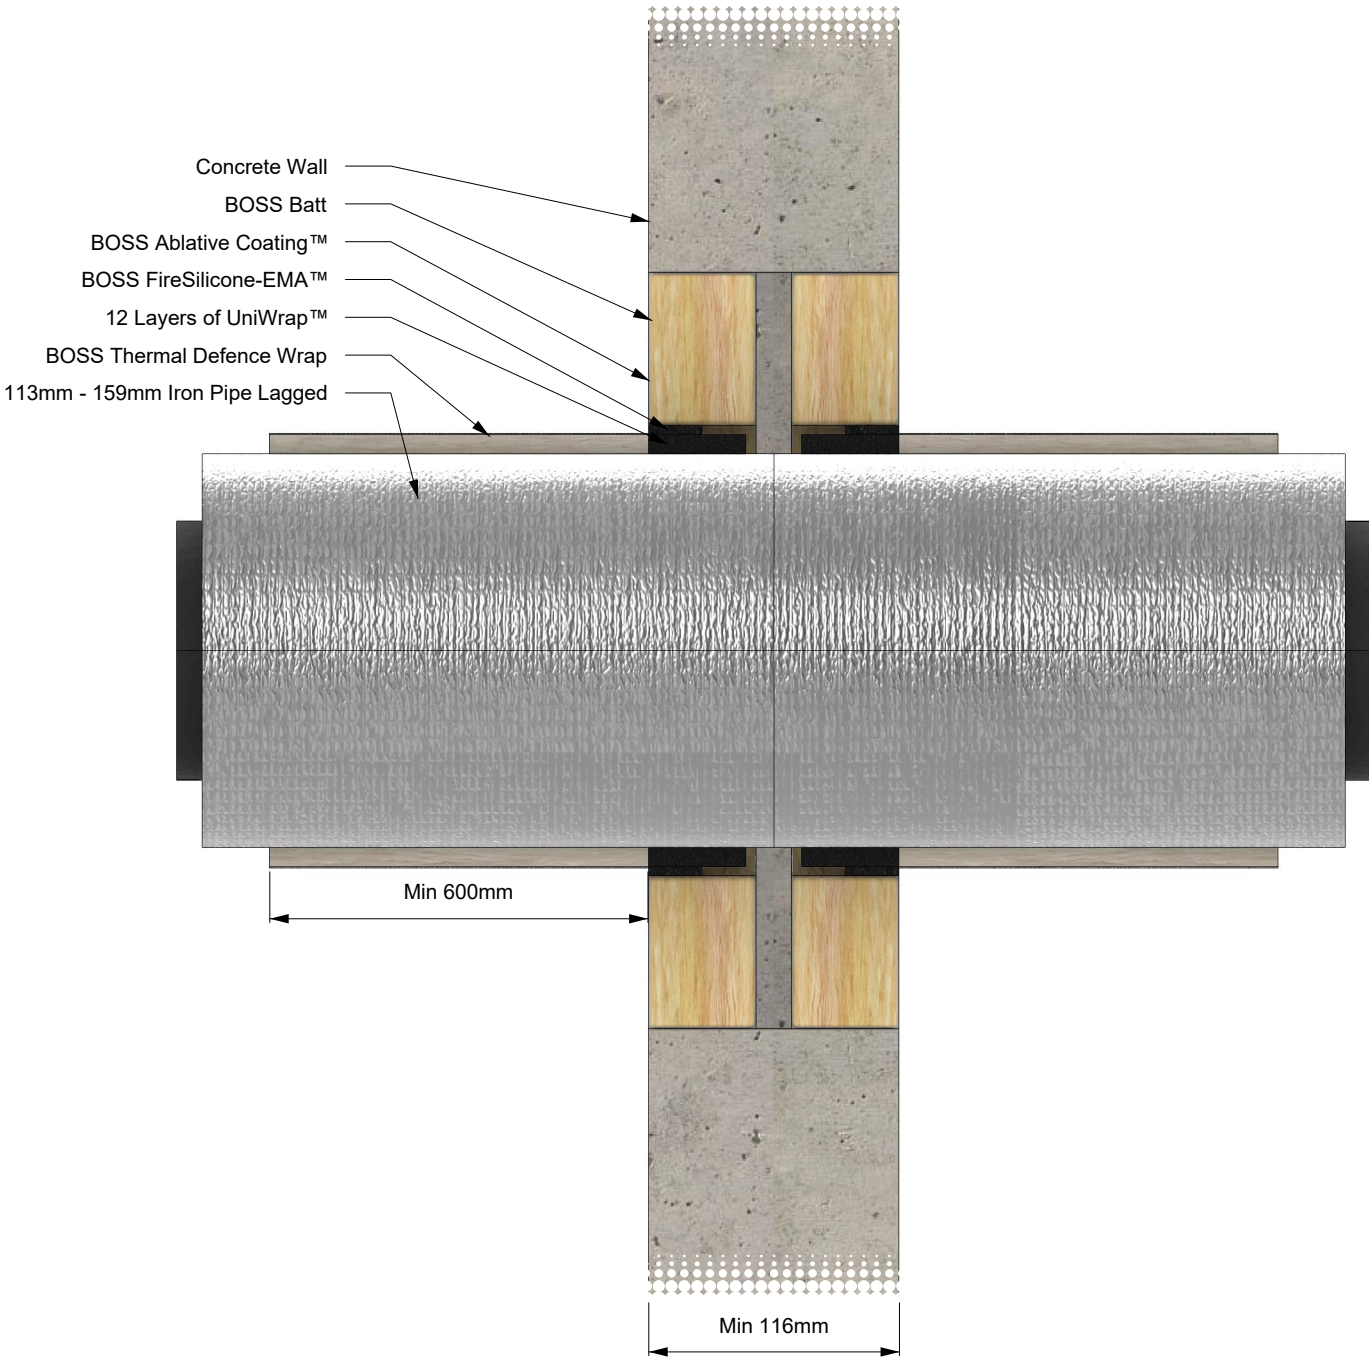

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS Thermal Defence	113mm - 159mm Iron pipe with maximum wall thickness of 4.5mm. 30 - 50 mm lagging. UniWrap™ installed over the Thermobreak lagging with multiple layers, flush on both sides to a minimum 40mm depth. FireSilicone-EMA™ Sealant installed in annular gap flush on both sides. 600mm of Thermal Defence Wrap each side of the wall.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	BOSS UniWrap™		Supplementary Standard:		AS 4072.1-2005	
Service:	Iron Pipes	BOSS FireSilicone-EMA™	-		Report Reference:		WF FAS 200332	
Substrate:	Concrete wall	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2435.4	
Min Substrate Thickness (mm):	116	Up to 1100 x 1100	Up to 20		Date:	15/04/25	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0	-						
Wrap Length (mm):	600							
FRL / FRR:	-/120/120							