


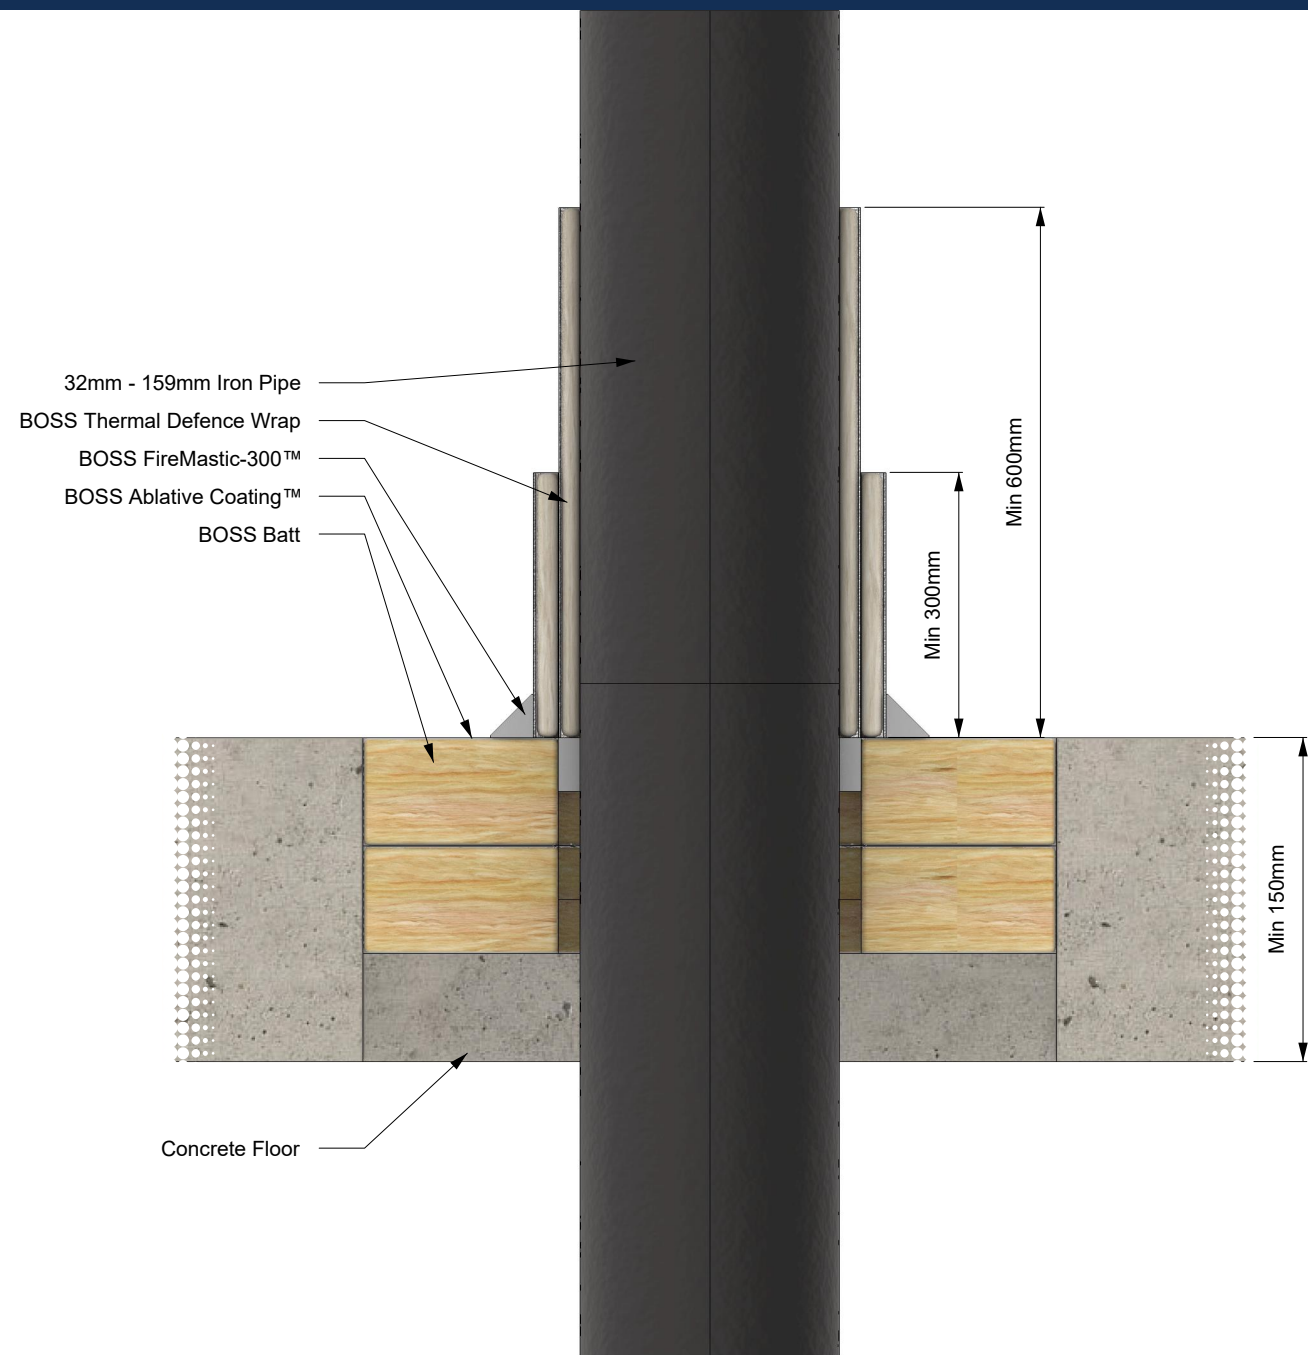

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS Batt™	BOSS Thermal Defence	32mm - 159mm Iron pipe with maximum wall thickness of 4.5mm. FireMas-tic-300™ Sealant installed 25mm deep in annular gap up to 20mm wide, finished with a 20 mm x 20 mm fillet on the top side. Thermal Defence Wrap on the top side of the floor with a 600mm 1st layer and 300mm 2nd layer.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Iron Pipes	BOSS FireMastic-300™	-		Report Reference:		WF FAS 200332	
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2444.25	
Min Substrate Thickness (mm):	150	Up to 1100 x 1100	Up to 20		Date:	12/05/25	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	20	-						
Wrap Length (mm):	600 with 2nd layer 300							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.