
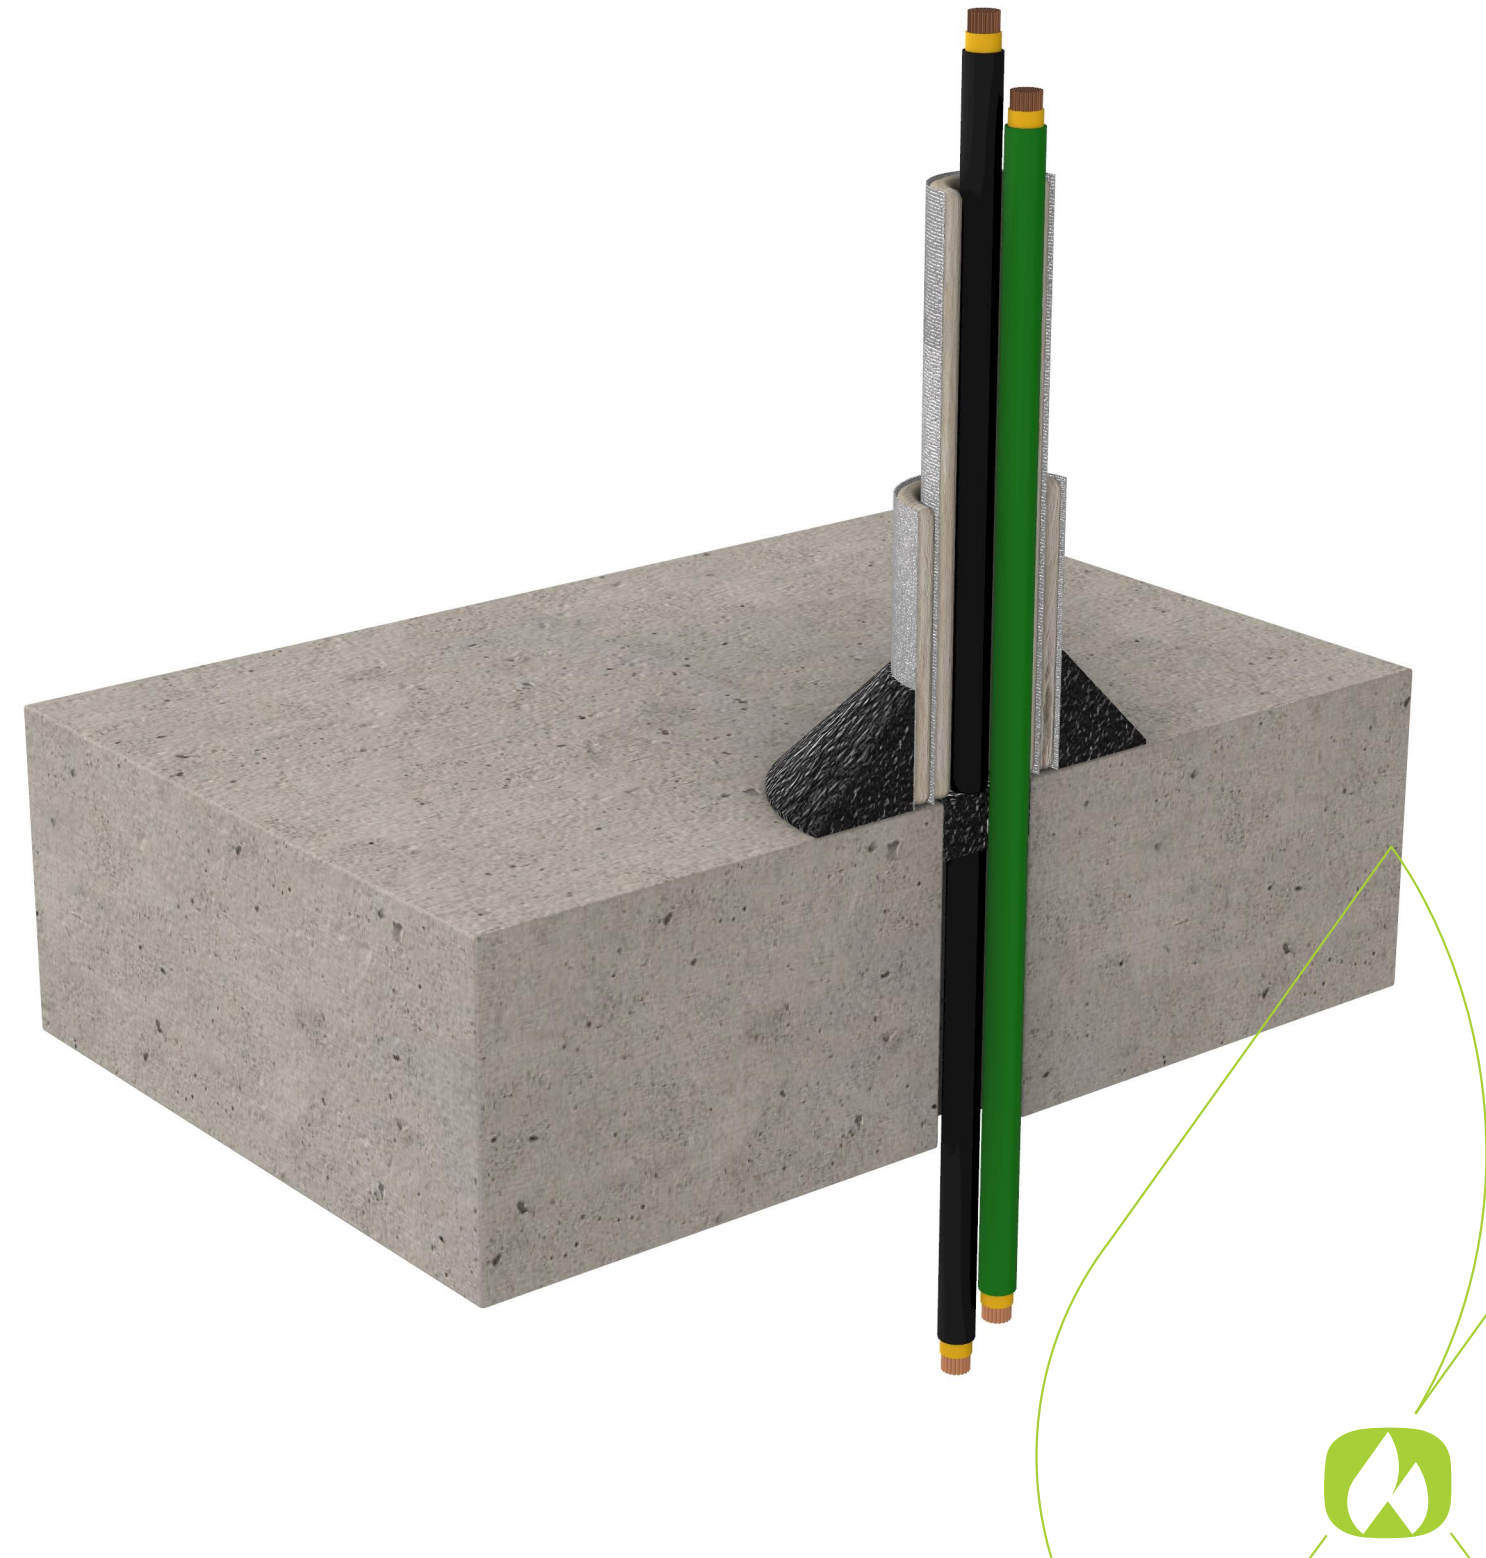


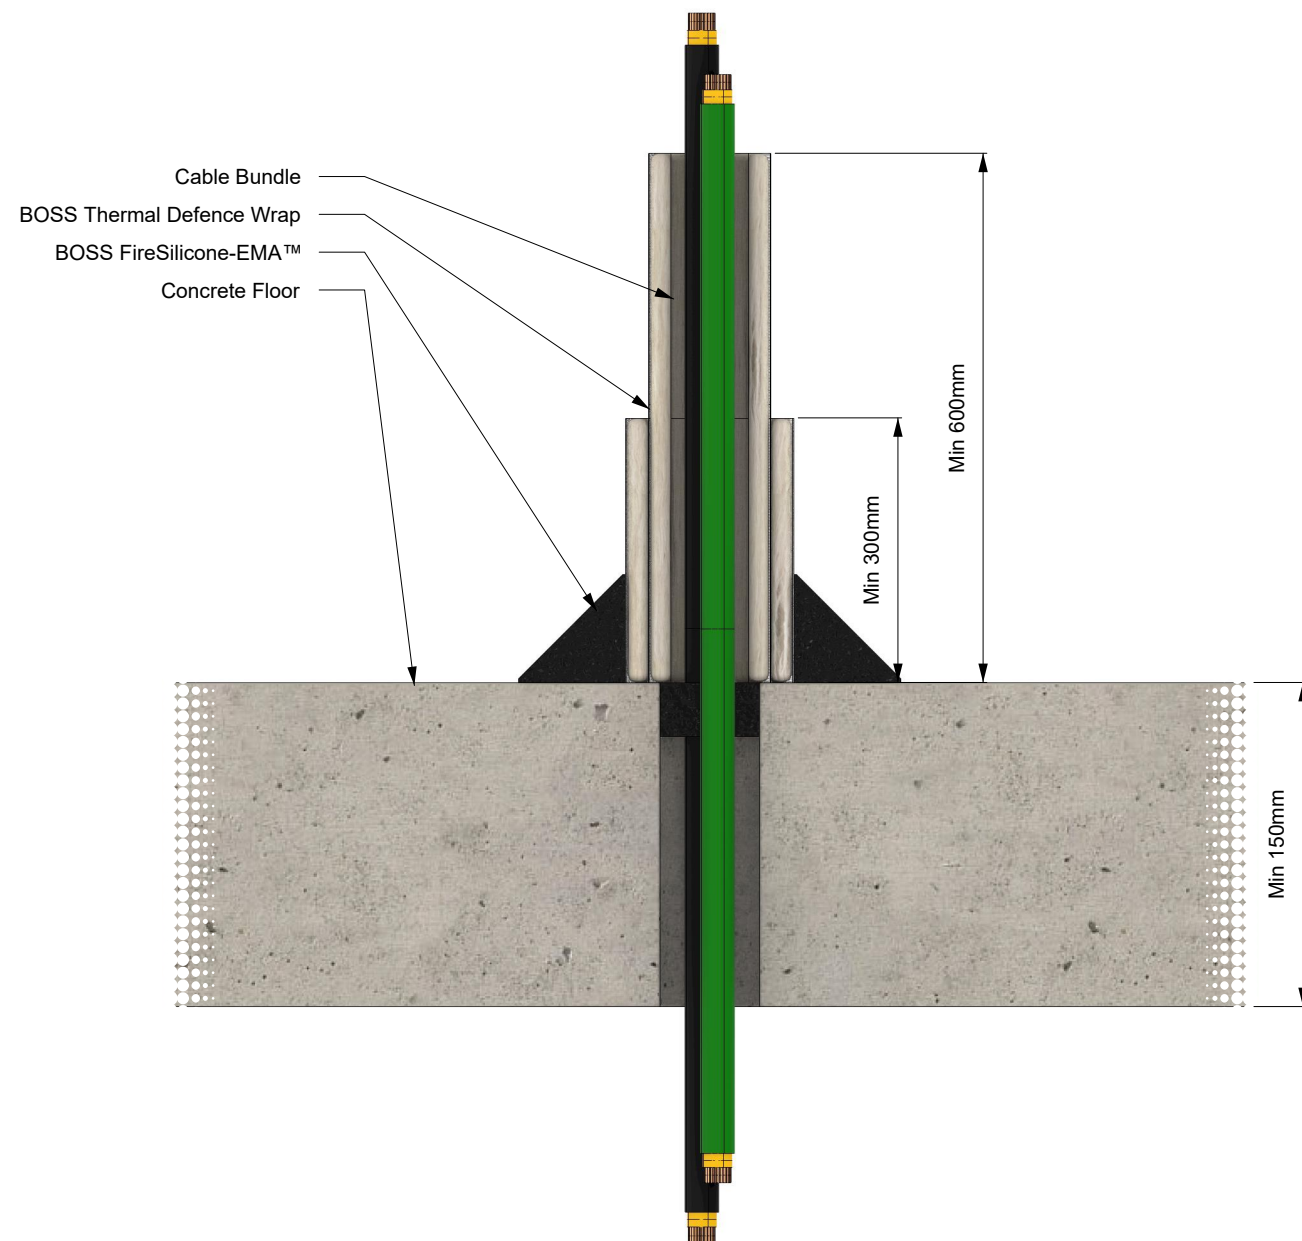

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS FireSilicone-EMA™	-	Telecommunications Cables: G1 – PVC/- 1mm x 95mm ² – Approx. Dia 14.1-17.1mm G2 – PVC/- 1mm x 185mm ² – Approx. Dia 19.3-23.3mm FireSilicone-EMA™ Sealant installed 25mm deep in annular gap up to 20mm wide, finished with a 50 mm x 50 mm fillet on the top side. Thermal Defence Wrap on the top side of the floor with a 600mm 1st layer and 300mm 2nd layer.	Reference Standard:	AS 1530.4:2014		
Trade / Type:	Electrical	BOSS Thermal Defence	-		Supplementary Standard:	AS 4072.1-2005		
Service:	Telecommunications	-	-		Report Reference:	WF FAS 200332		
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:	BF-2471.25		
Min Substrate Thickness (mm):	150	-	Up to 20		Date:	02/05/25	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	50							
Wrap Length (mm):	600 with 2nd layer 300							
FRL / FRR:	-/120/120							