
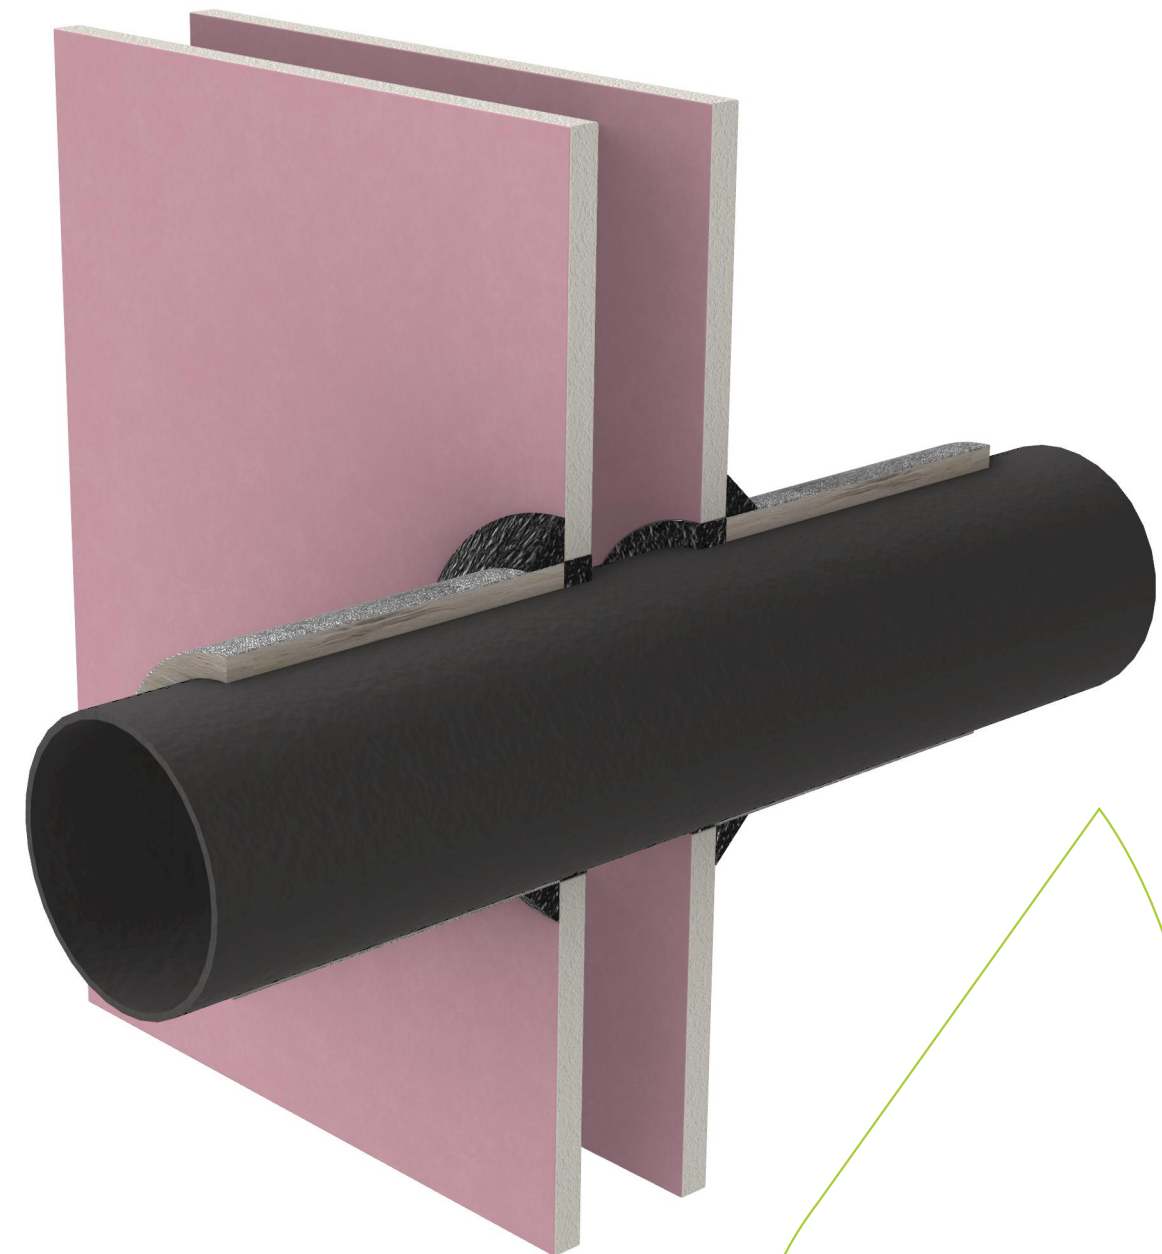


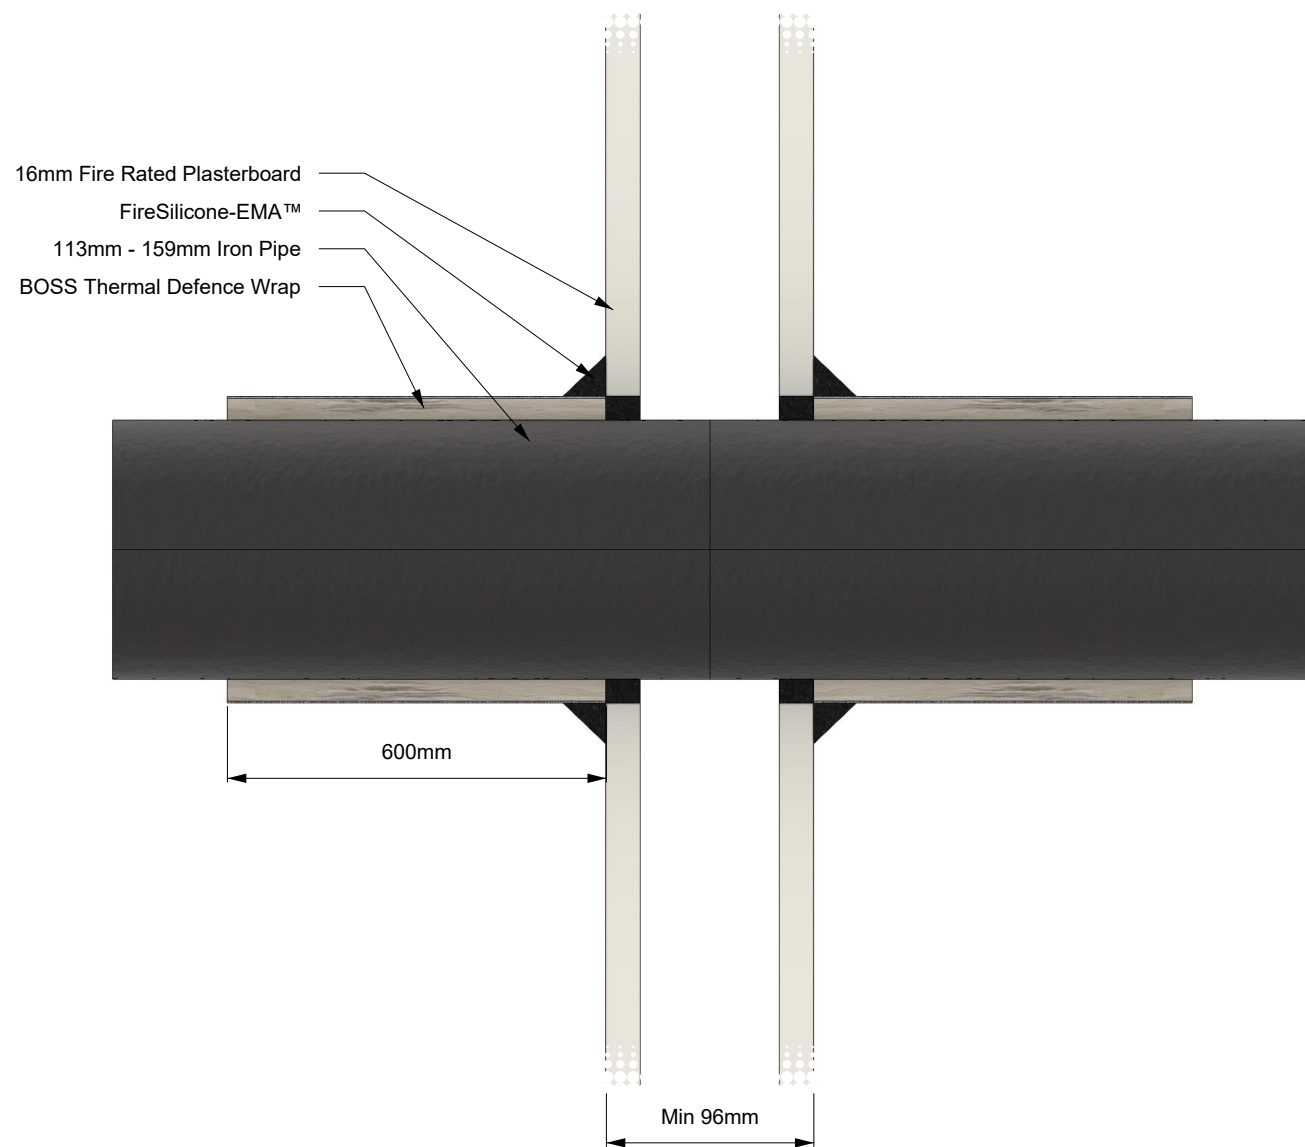

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireSilicone-EMA™	-	113mm - 159mm Iron pipe with maximum wall thickness of 4.5mm. FireSili-cone-EMA™ Sealant installed 16mm deep in annular gap up to 20mm wide, finished with a 20 mm x 20 mm fillet both sides. 600mm of Thermal Defence Wrap each side of the wall.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Thermal Defence	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Iron Pipes	-	-		Report Reference:		WF FAS 200332	
Substrate:	Single Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2489.1	
Min Substrate Thickness (mm):	96	-	Up to 20		Date:	02/05/25	Rev:	01
Sealant Depth (mm):	16	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	20	-						
Wrap Length (mm):	600							
FRL / FRR:	-/90/90							