
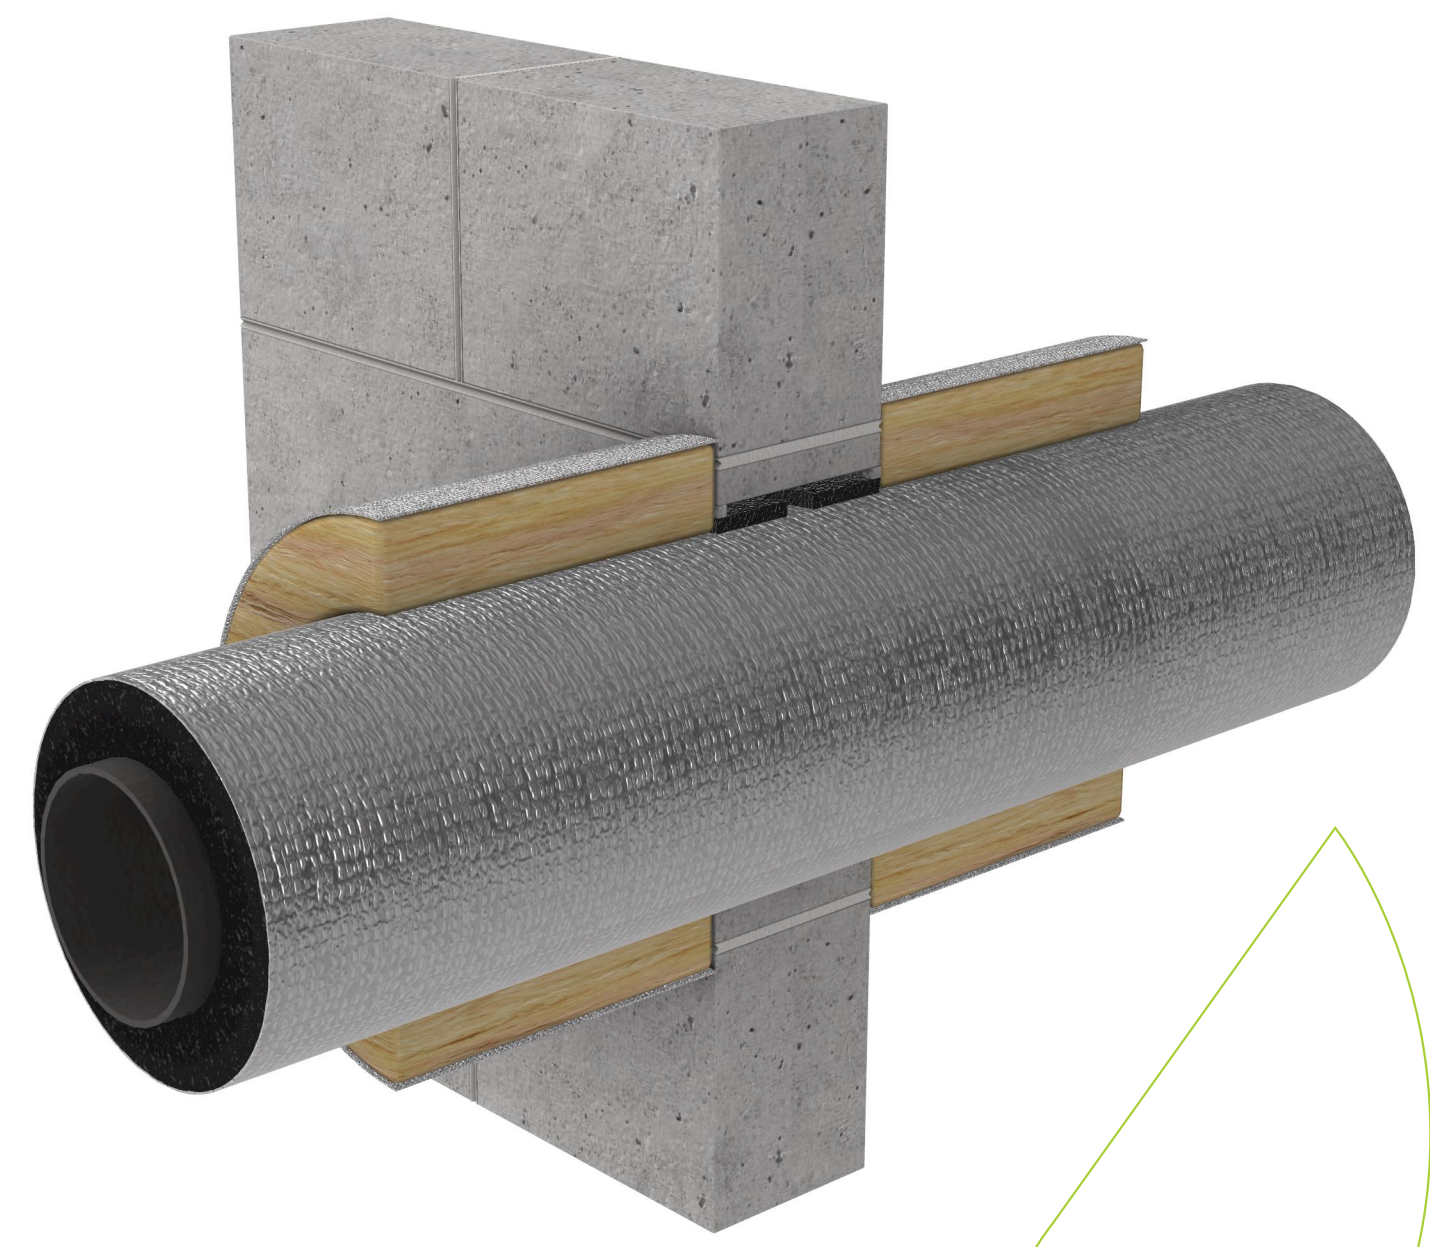


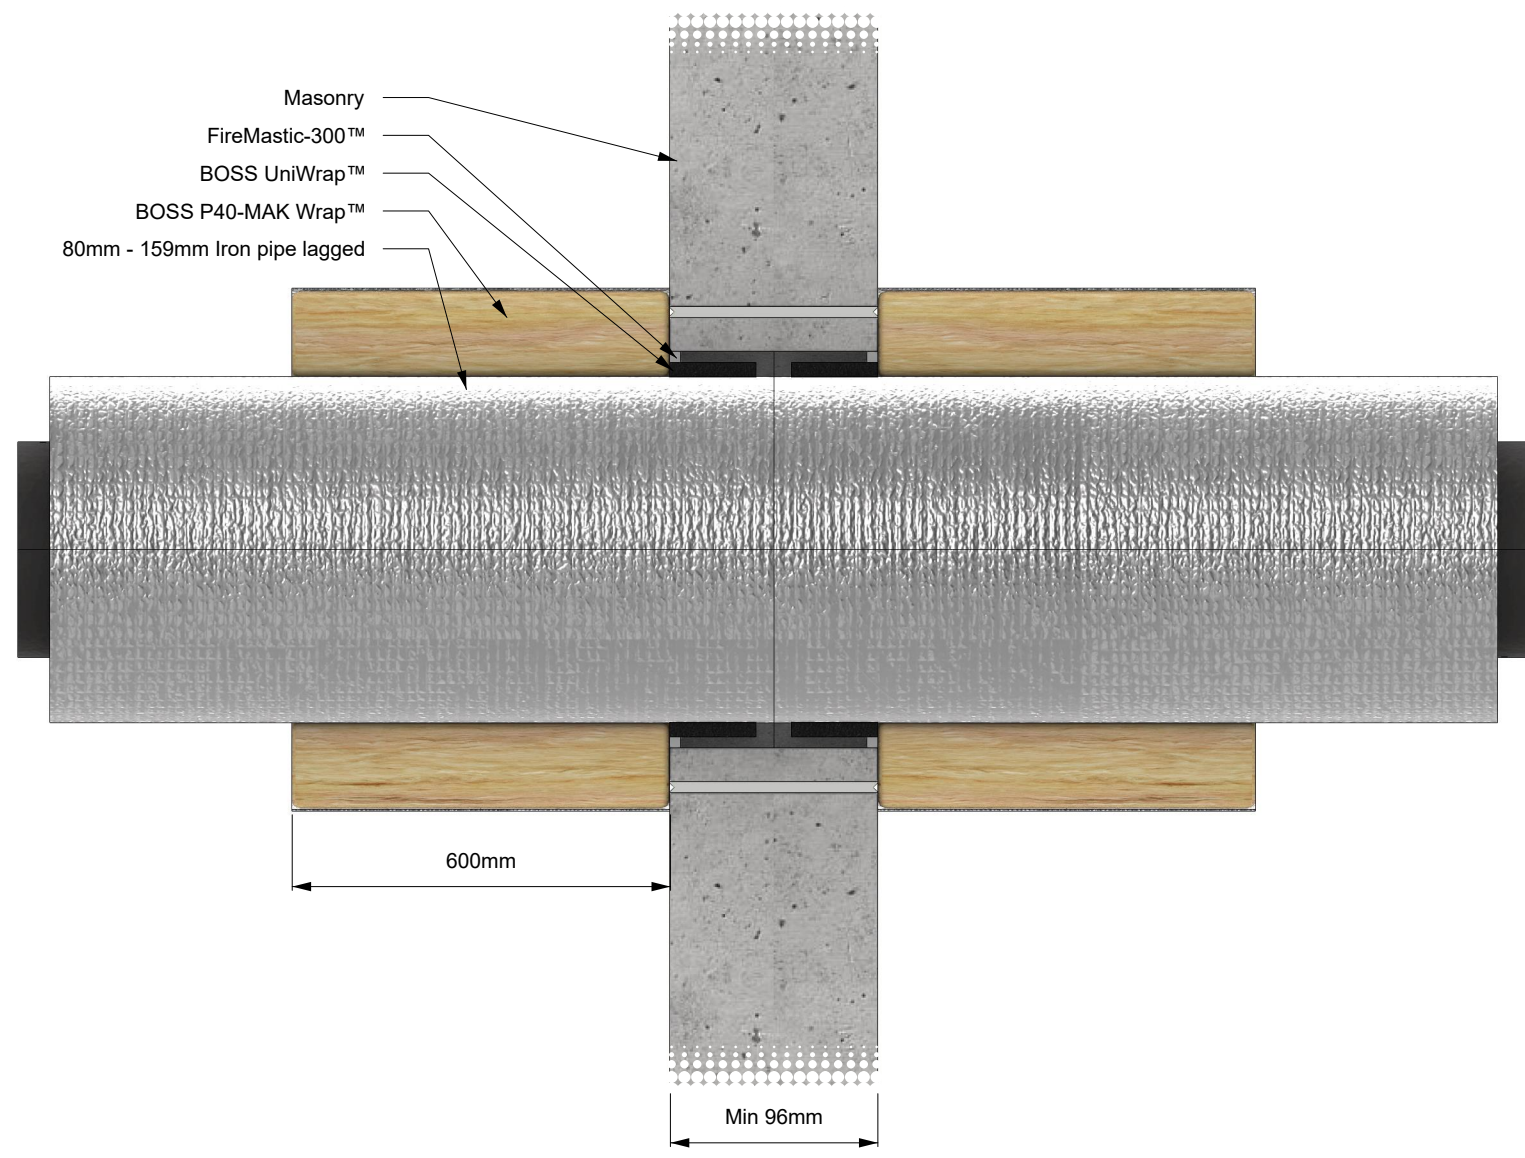

SYSTEM DESCRIPTION

Orientation:	Wall
Trade / Type:	Plumbing / Hydraulic / Active Fire
Service:	Insulated Iron Pipes
Substrate:	Masonry
Min Substrate Thickness (mm):	96
Sealant Depth (mm):	5
Sealant Fillet (mm):	0
Wrap Length (mm):	600
FRL / FRR:	-/90/90

FIRE STOPPING INFORMATION

BOSS UniWrap™	-
BOSS FireMastic-300™	-
BOSS P40-MAK Wrap™	-
APERTURE (mm)	ANNULAR GAP (mm)
-	5
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

80 mm - 159 mm Iron pipe with continuous 30 - 50 mm Thermobreak tube lagging. Sealant 5 mm deep in 5 mm annular gap both sides. BOSS UniWrap™ installed on both sides. P40-MAK Wrap™ 600 mm to both sides.	
--	--

SUPPORTING INFORMATION

Reference Standard:		AS 1530.4:2014	
Supplementary Standard:		AS 4072.1-2005	
Report Reference:		WF FAS 190346	
Drawing Number:		BF-2561.5	
Date:	12/05/25	Rev:	01