


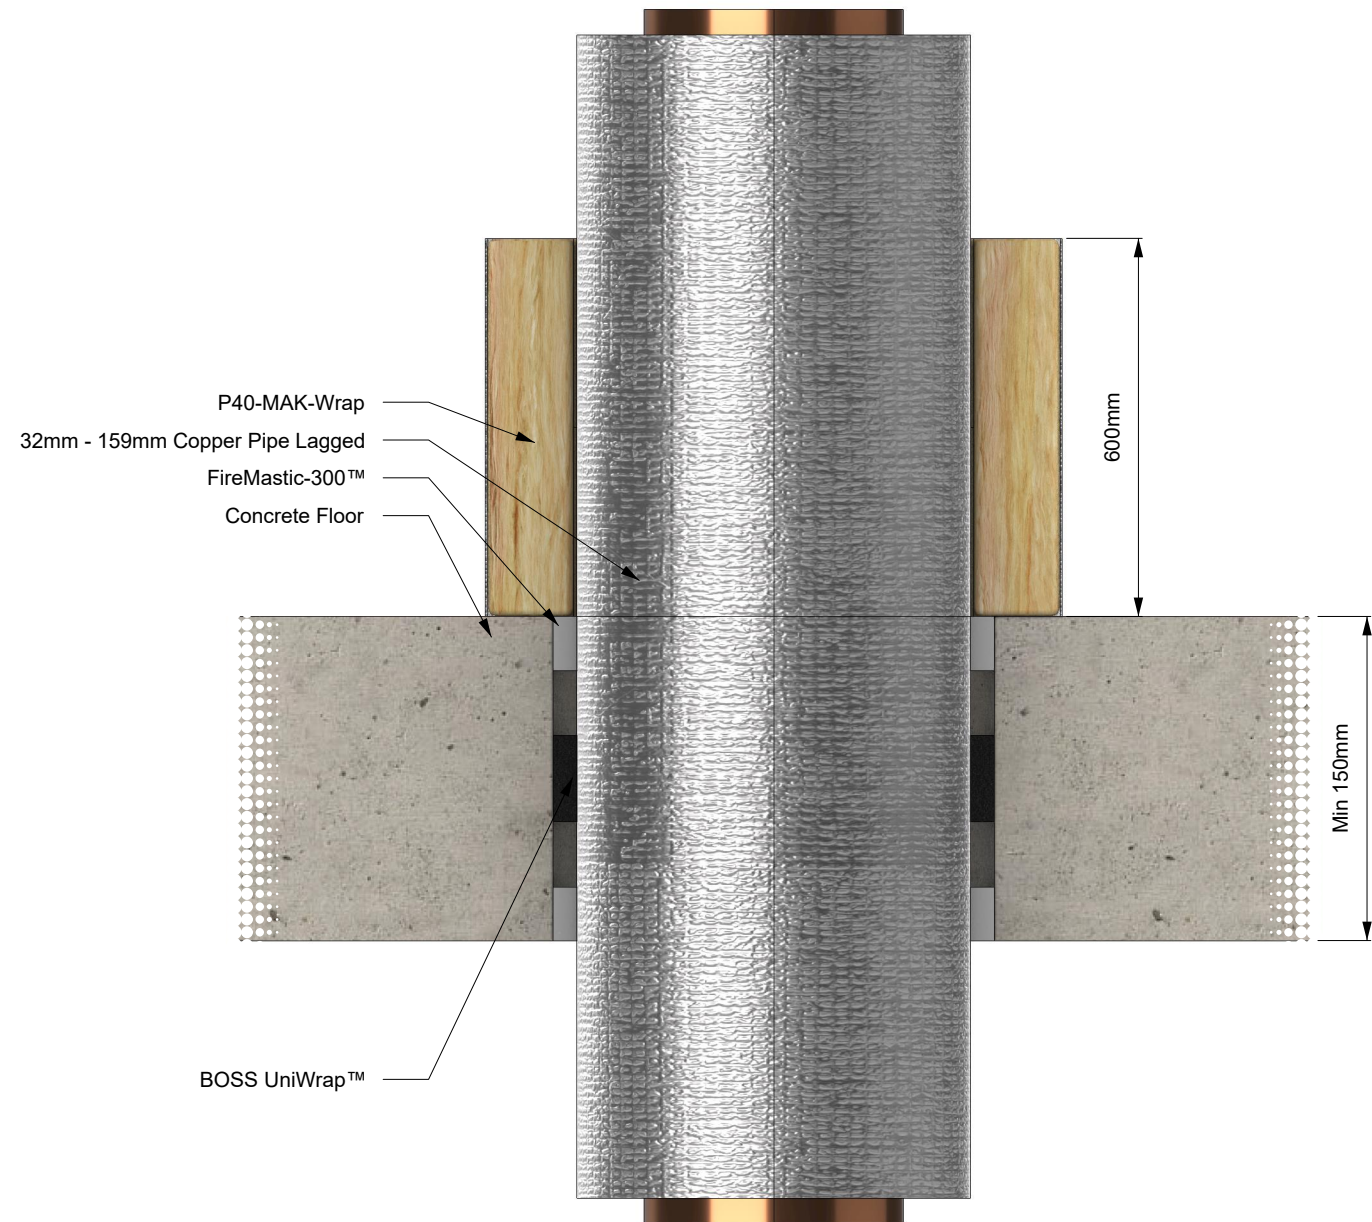

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS UniWrap™	-	32 mm - 159 mm Copper pipe with continuous 30 - 50 mm Thermobreak tube lagging. Sealant 25 mm deep in 5 mm annular gap both sides. Up to 12 layers of BOSS UniWrap™ installed mid-depth of the floor, depending on pipe size. P40-MAK Wrap™ 300 mm to the top side.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Insulated Copper Pipes	BOSS P40-MAK Wrap™	-		Report Reference:		WF FAS 190346	
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2577.25	
Min Substrate Thickness (mm):	150	-	5		Date:	03/06/25	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	600							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.