
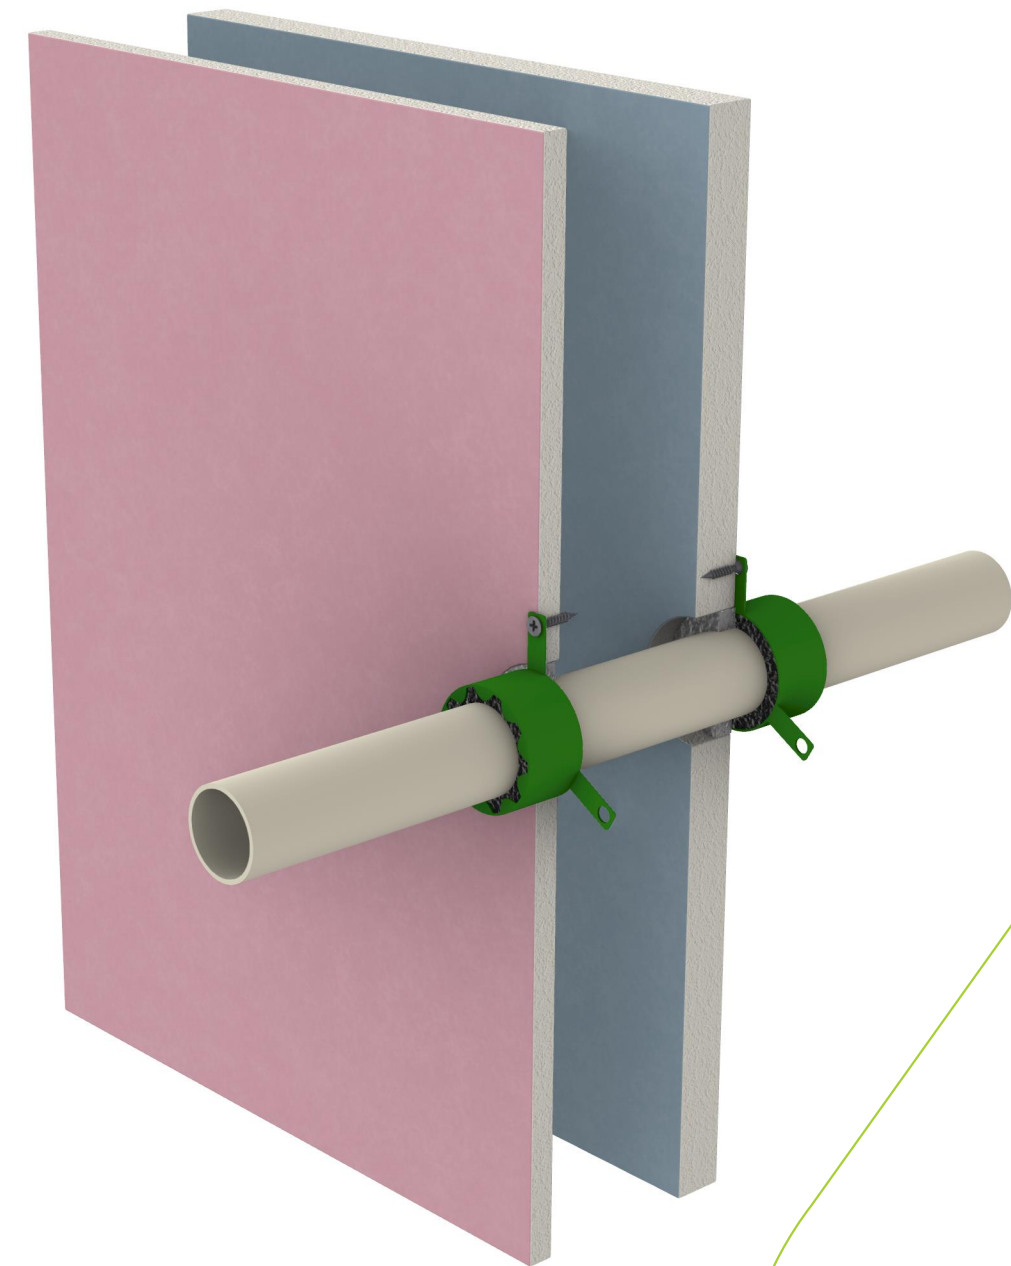


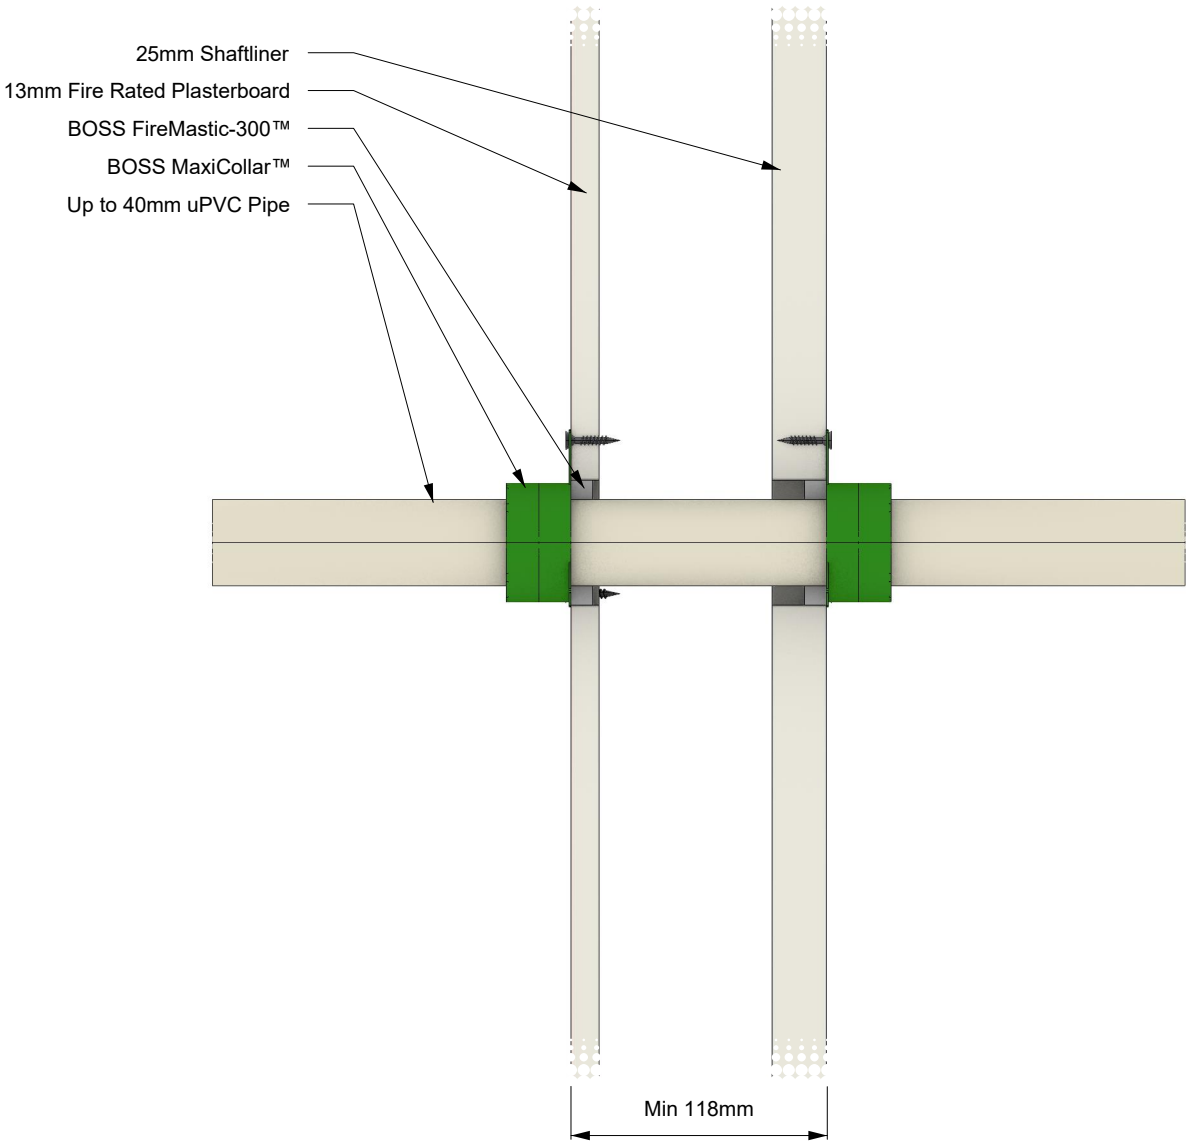

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS MaxiCollar™	-	Up to 40 mm uPVC pipe with 2.0 mm maximum wall thickness. Sealant 10.0 mm deep in 9.0 mm annular gap both sides. 40 mm BOSS MaxiCollar™ installed on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	-	-		Report Reference:		WF FAS 210203	
Substrate:	Shaftliner	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2680.12	
Min Substrate Thickness (mm):	118	-	9		Date:		01/07/25	Rev: 01
Sealant Depth (mm):	10.0	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							