


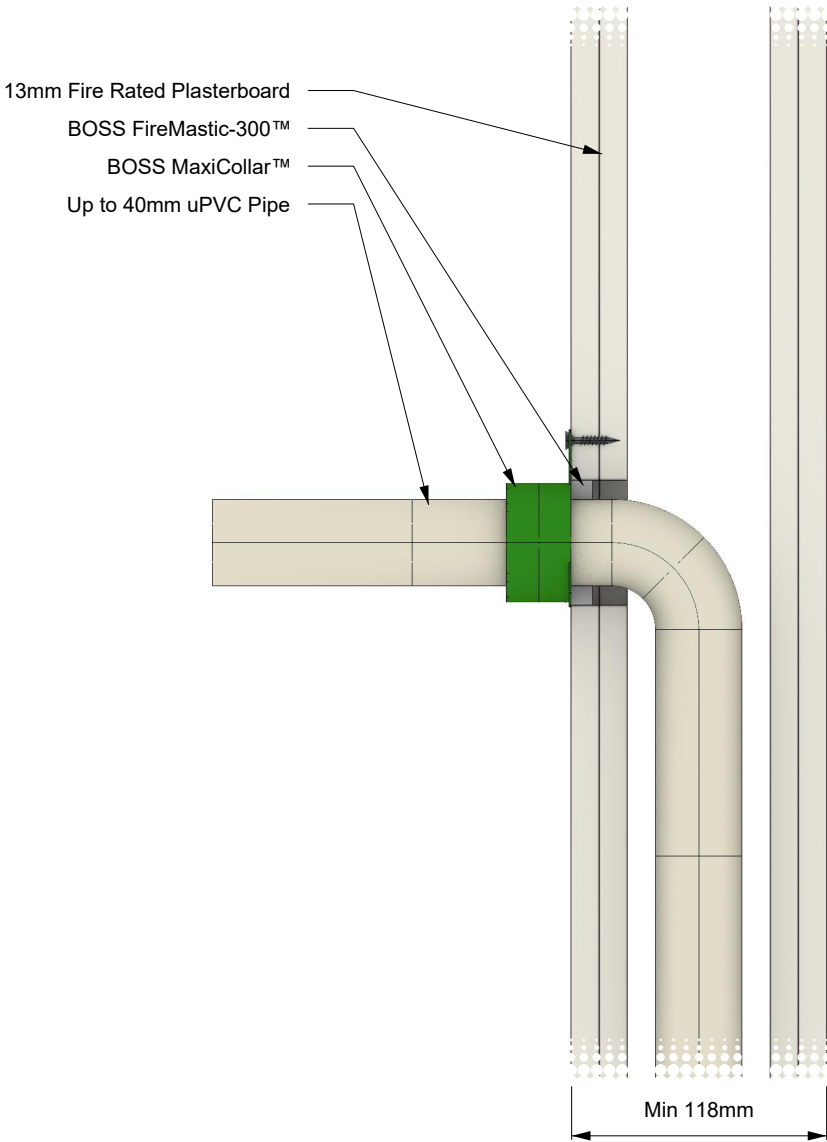

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS MaxiCollar™	-	1-sided installation - Up to 40 mm uPVC pipe with 2.0 mm maximum wall thickness. Sealant 5.0 mm deep in 5.0 mm annular gap to penetrated sides. 40 mm BOSS MaxiCollar™ installed on the penetrated side.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	-	-		Report Reference:		WF FAS 210203	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2690.2	
Min Substrate Thickness (mm):	118	-	5		Date:		01/07/25	Rev:
Sealant Depth (mm):	5.0	ADDITIONAL INFORMATION					01	
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							