
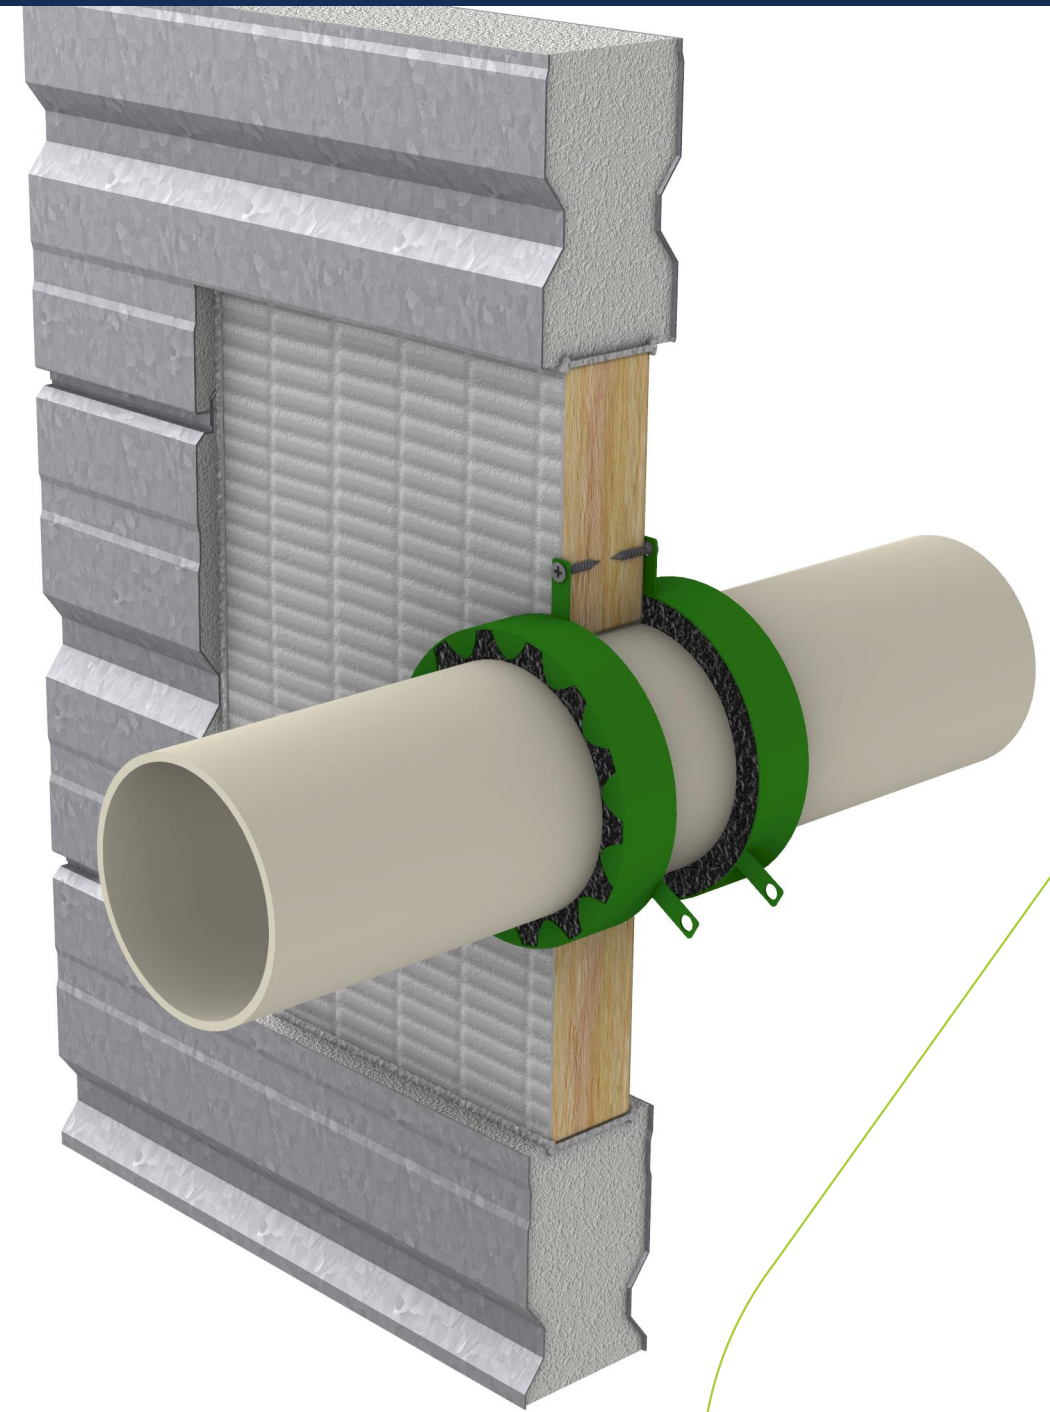


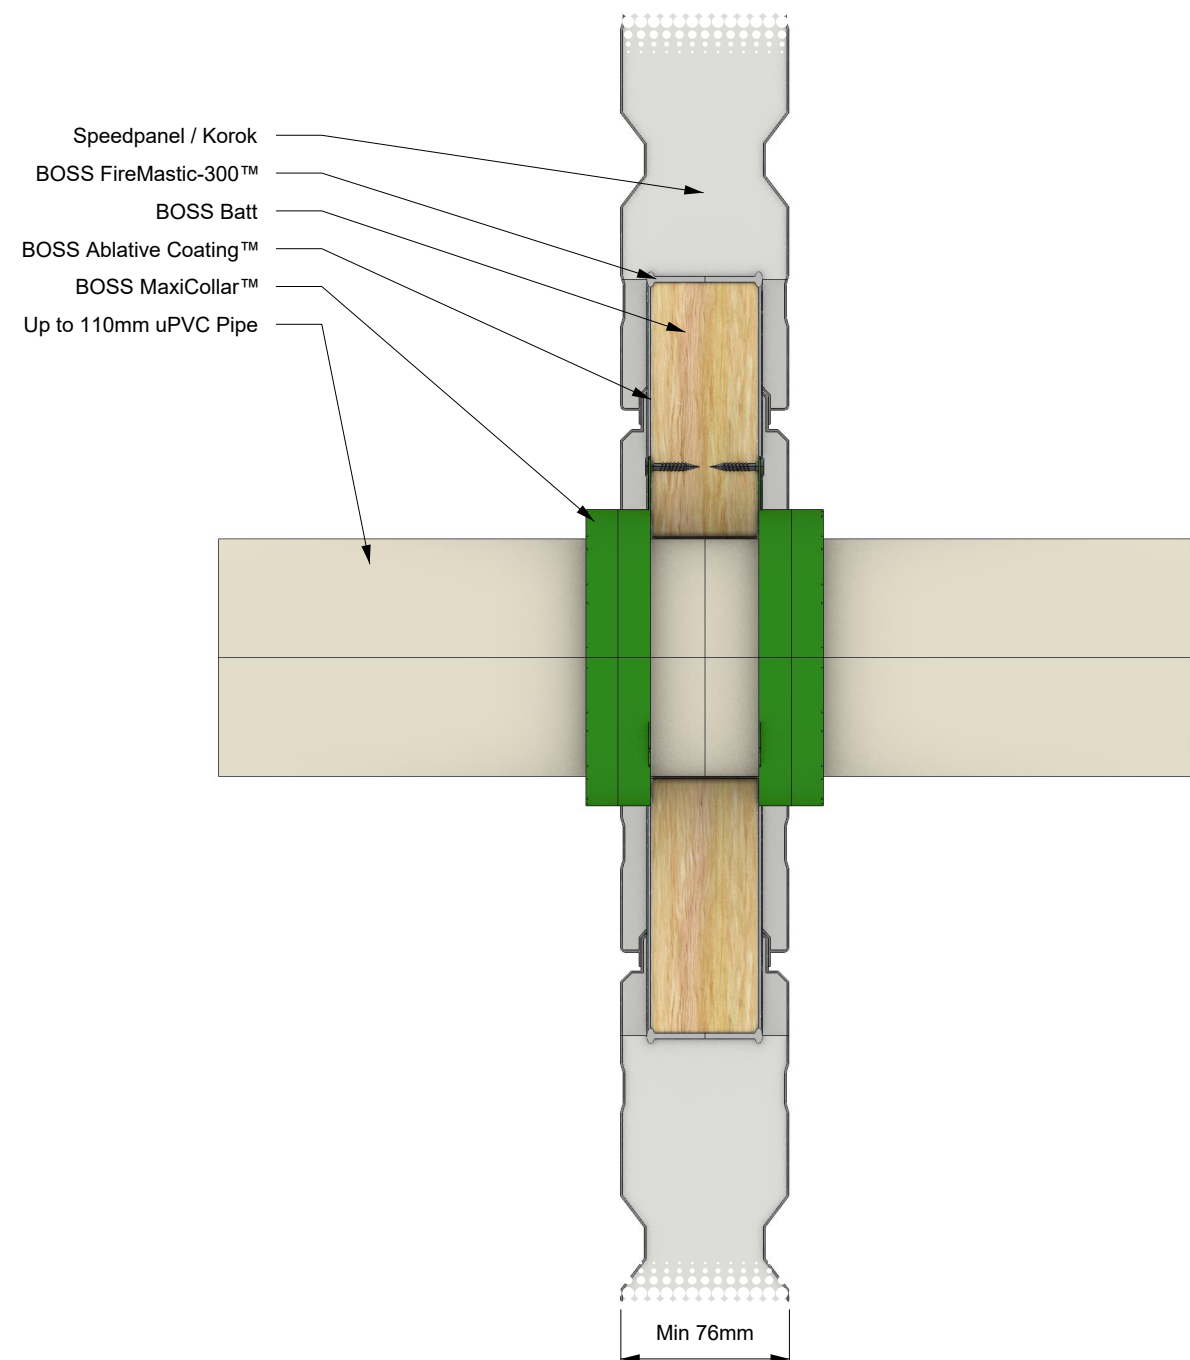

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS FireMastic-300™	Up to 110 mm uPVC pipe with 6.6 mm wall thickness, penetrating 1 layer of BOSS Batt™ protecting an aperture up to 600 mm x 600 mm sealed at the interface of the wall with sealant. The BOSS Batt™ was friction fitted within the aperture flush to the face. The system includes a 110 mm BOSS MaxiCollar™ installed to both sides. For framed systems, the BOSS Batt™ is to be centrally located within the wall with maximum 50 mm timber or steel framing.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS MaxiCollar™	-		Report Reference:		WF FAS 210203	
Substrate:	Speedpanel / Korok	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2735.6	
Min Substrate Thickness (mm):	76	Up to 600 x 600	0.0		Date:		21/07/25	Rev: 01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.