
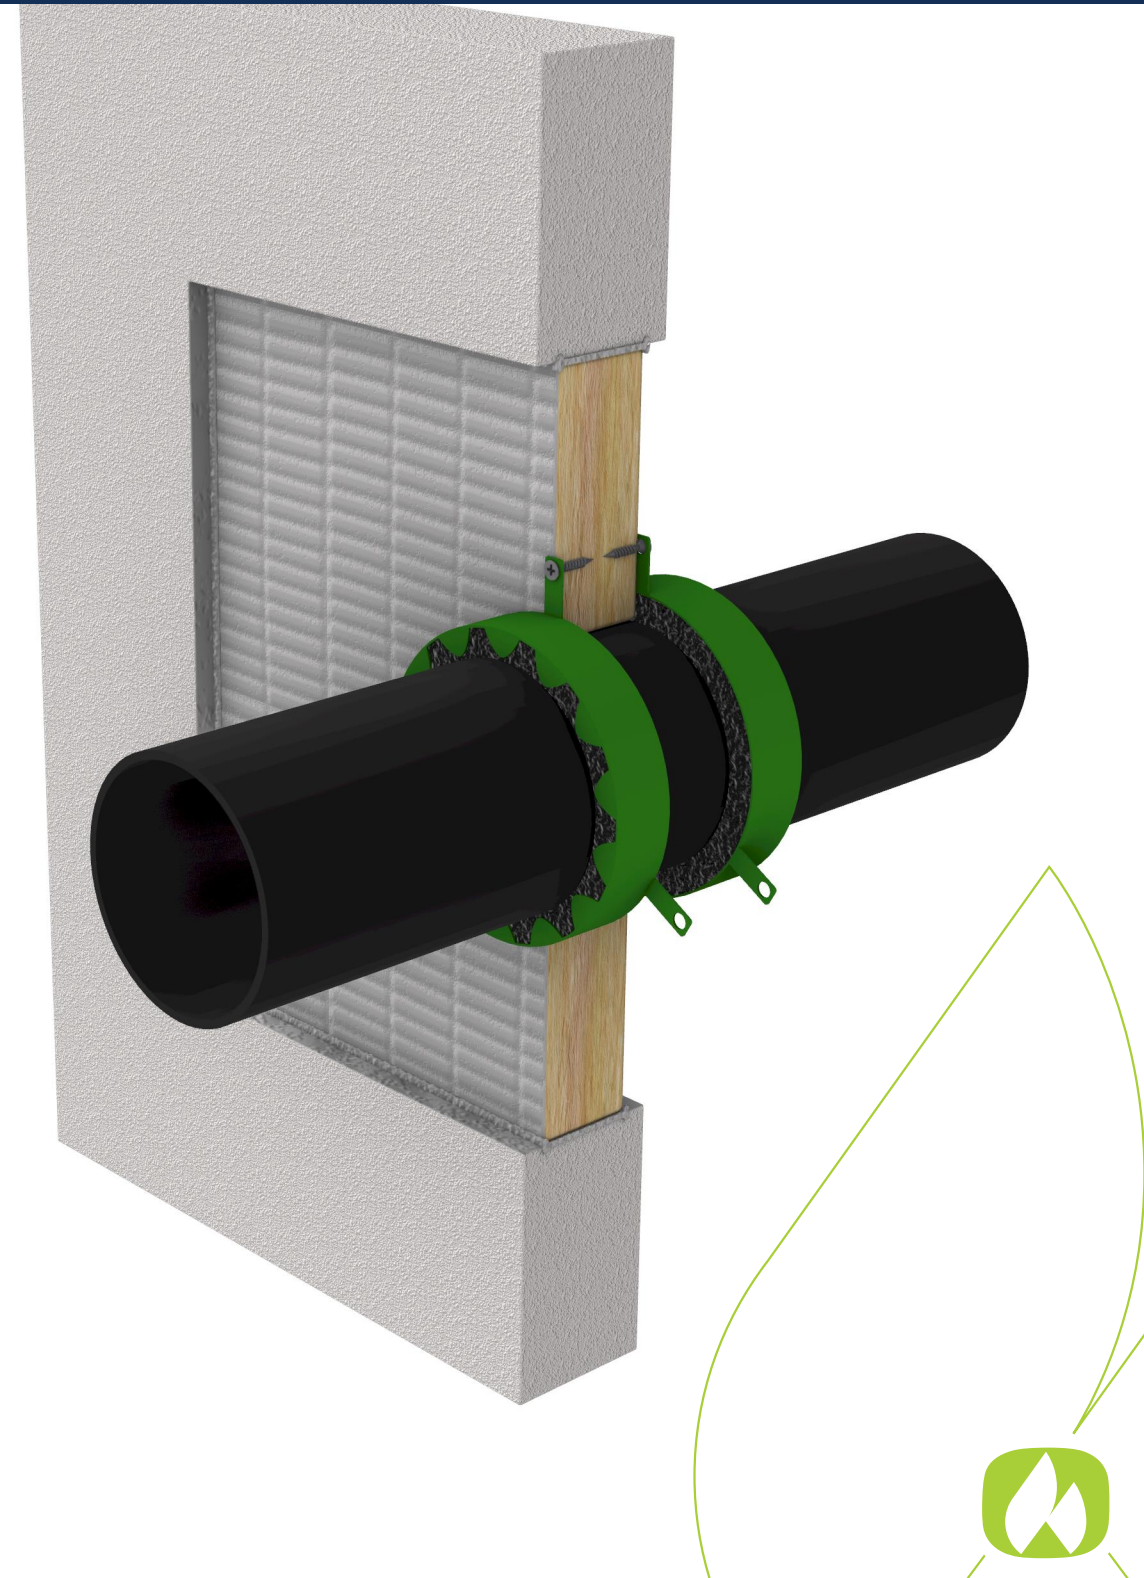


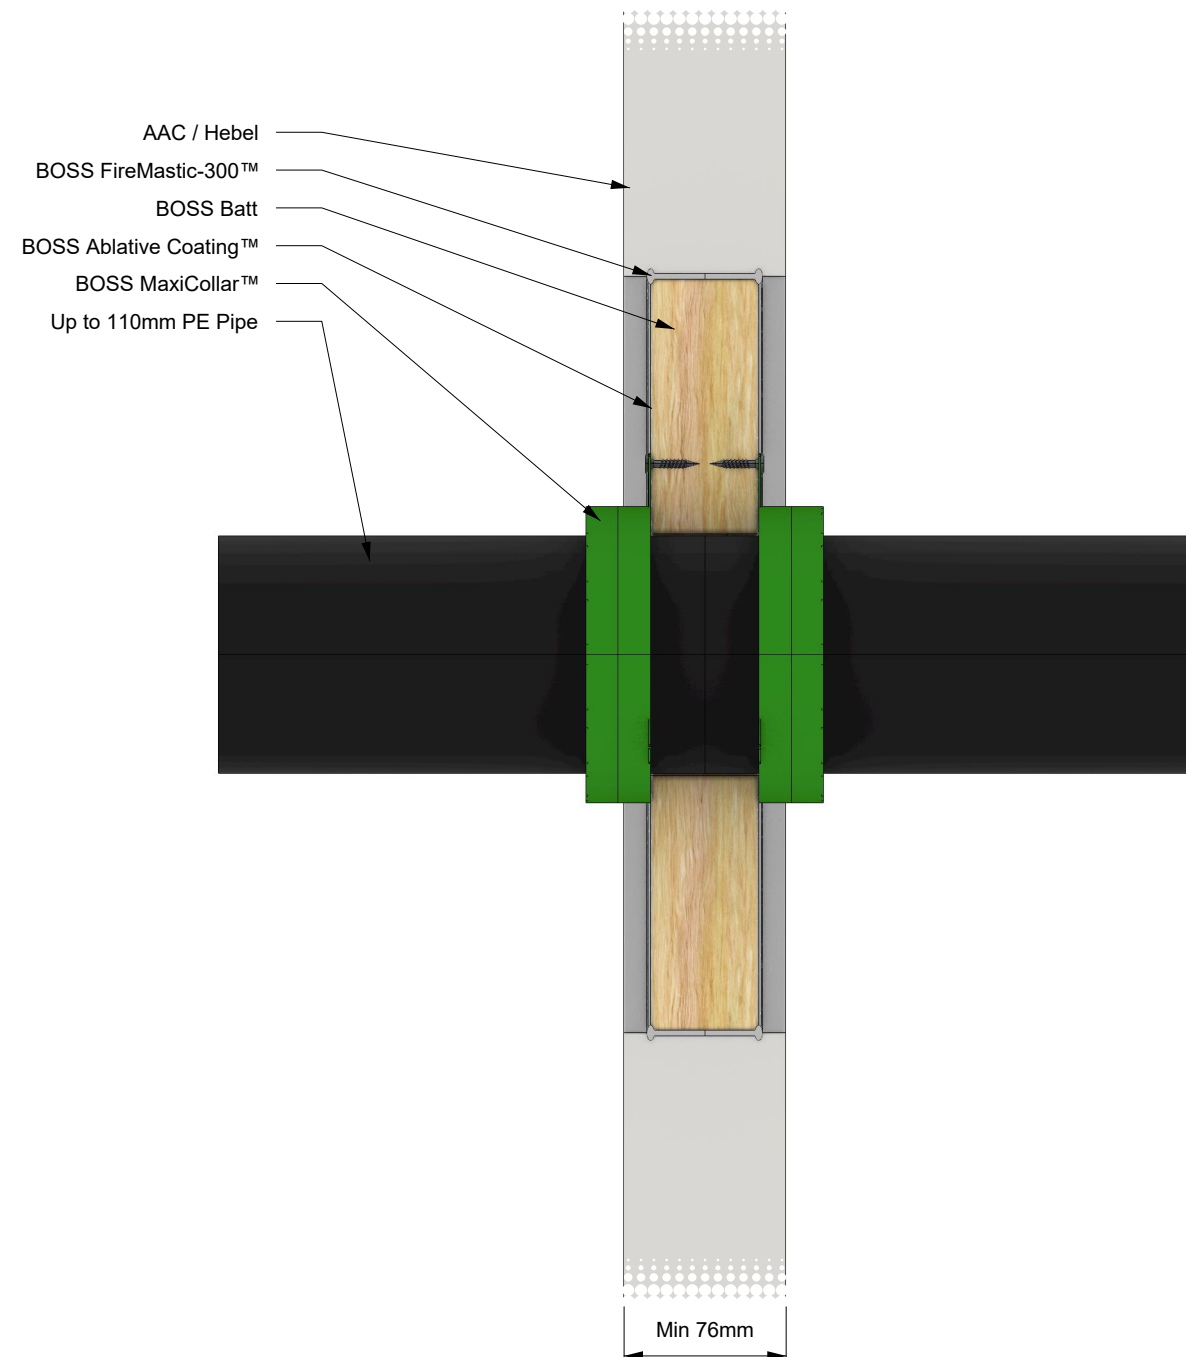

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS FireMastic-300™	Up to 110 mm PE pipe with 2.7 mm wall thickness, penetrating 1 layer of BOSS Batt™ protecting an aperture up to 600 mm x 600 mm sealed at the inter-face of the wall with sealant. The BOSS Batt™ was friction fitted within the aperture flush to the face. The system includes a 110 mm BOSS MaxiCollar™ installed to both sides. For framed systems, the BOSS Batt™ is to be centrally located within the wall with maximum 50 mm timber or steel framing.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PE	BOSS MaxiCollar™	-		Report Reference:		WF FAS 210203	
Substrate:	AAC / Hebel	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2736.7	
Min Substrate Thickness (mm):	76	Up to 600 x 600	0.0		Date:	21/07/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-	-						
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							