
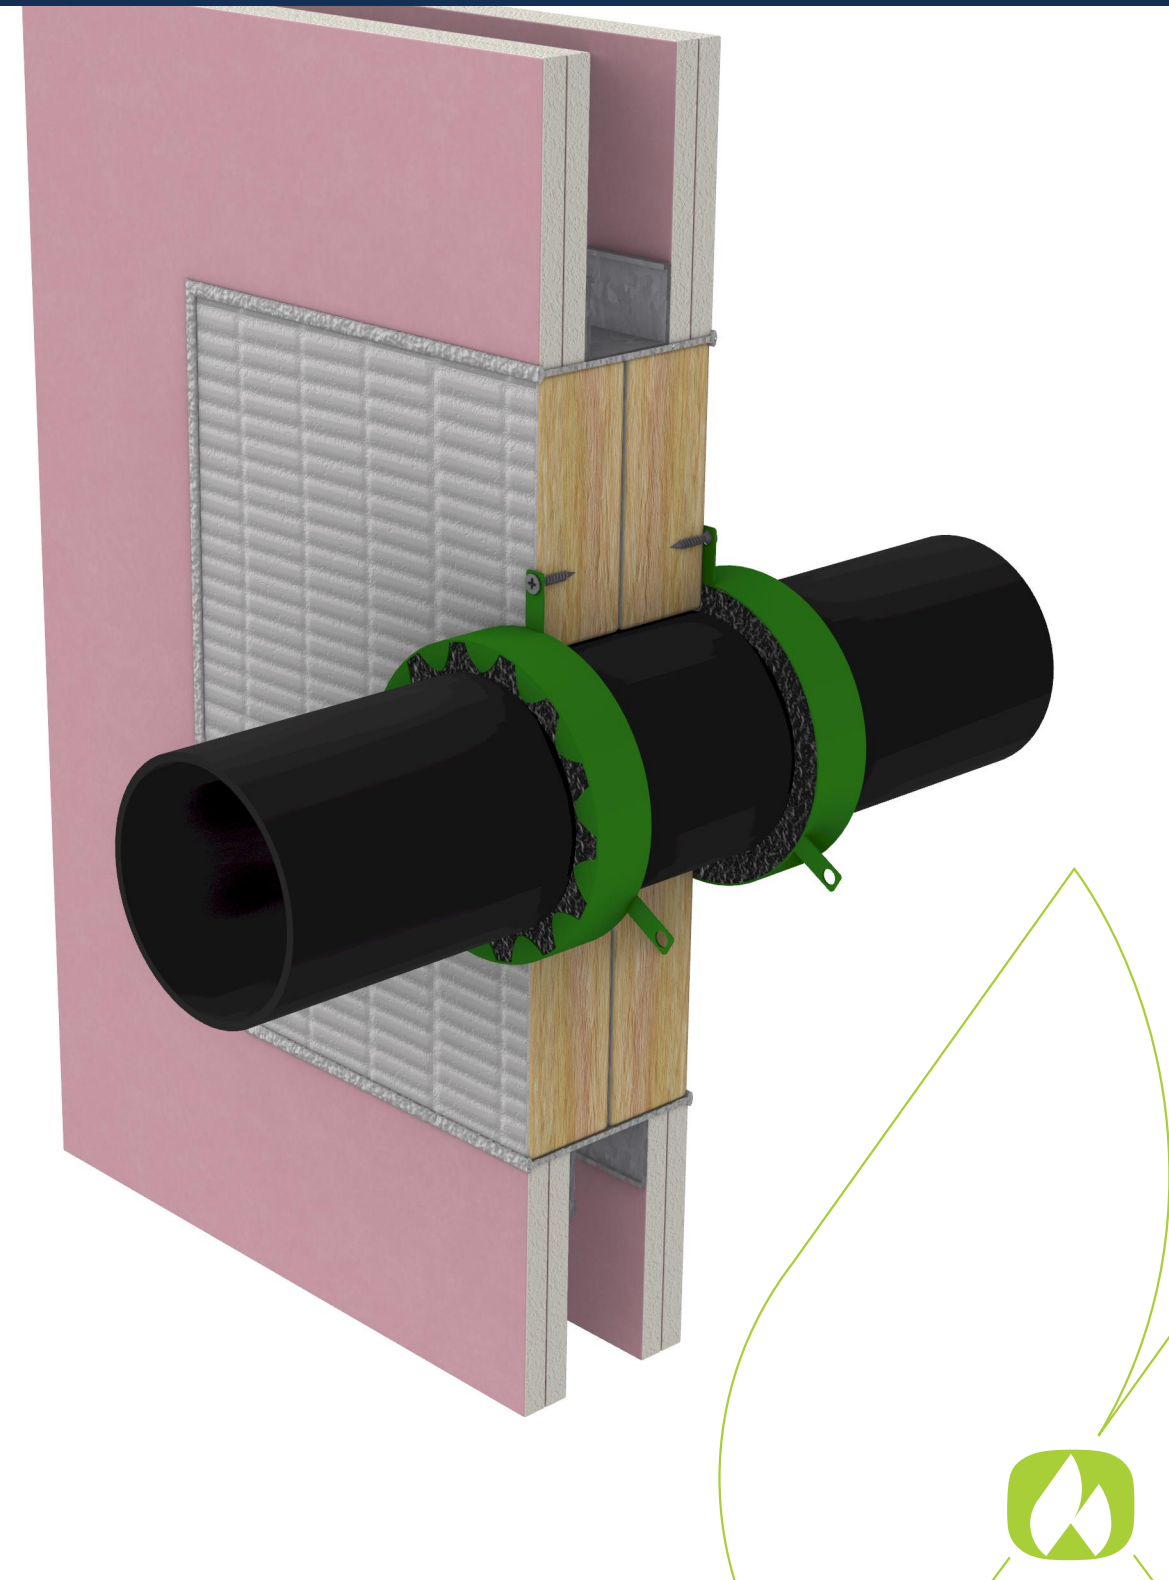


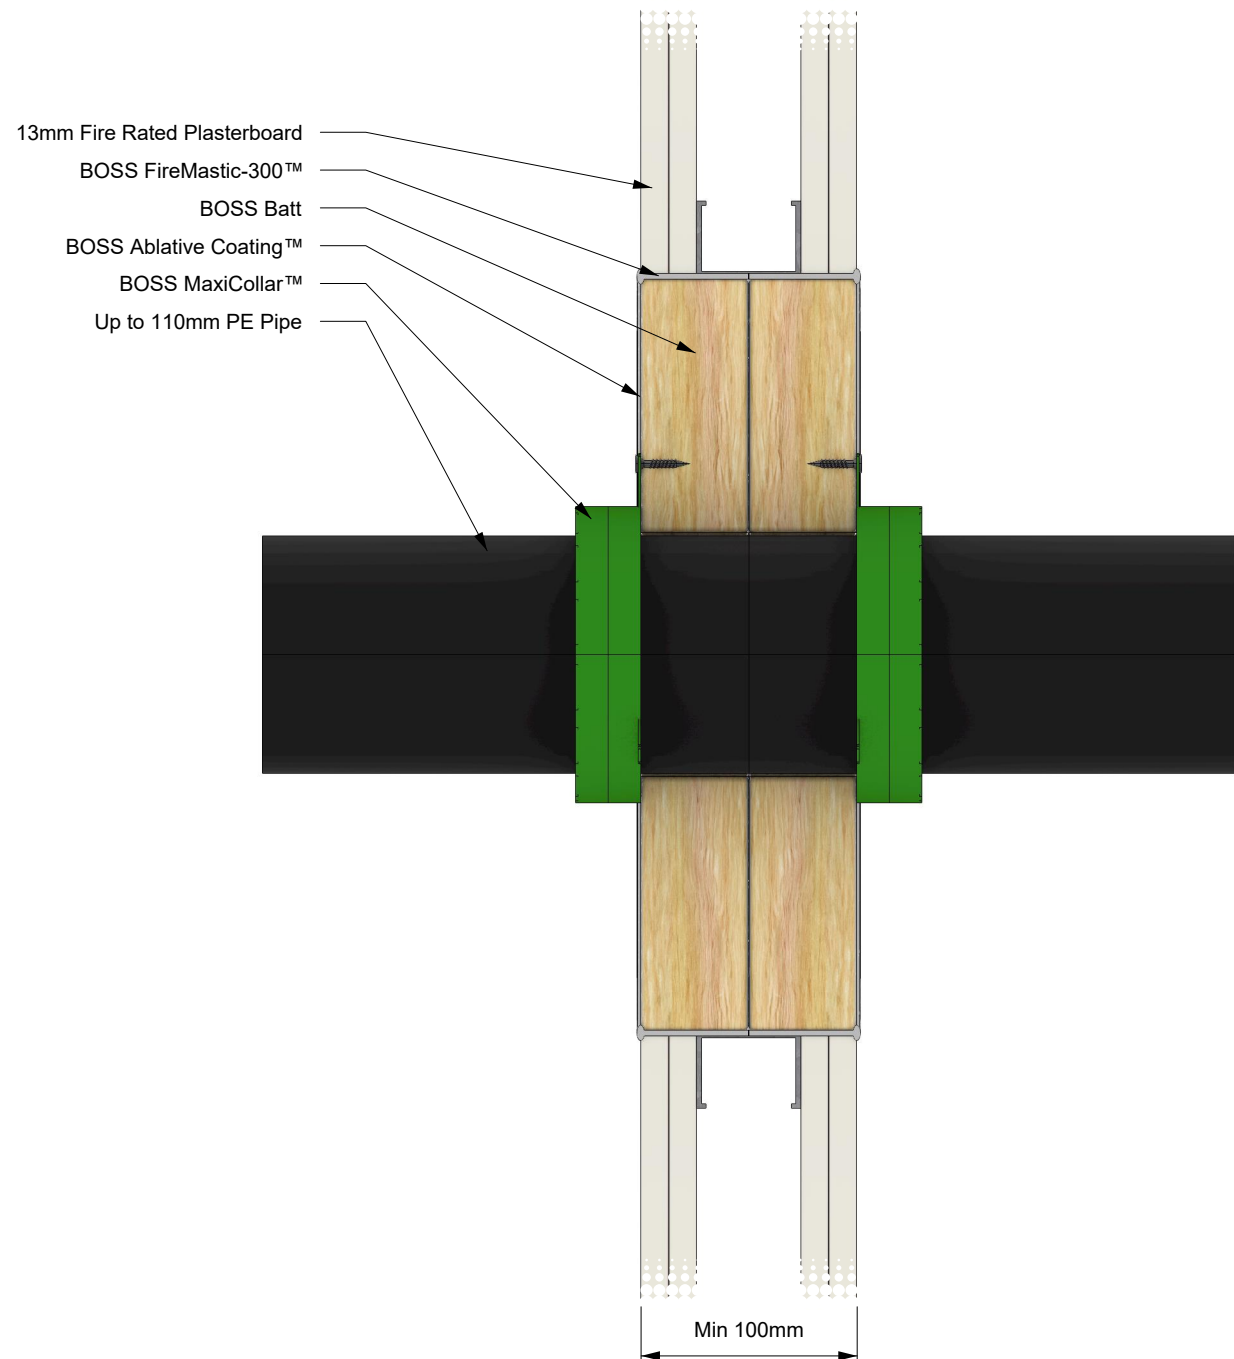

| SYSTEM DESCRIPTION            |                                             | FIRE STOPPING INFORMATION |                      | SERVICE SIZE & DETAILS                                                                                                                                                                                                                                                                | SUPPORTING INFORMATION  |  |                |      |
|-------------------------------|---------------------------------------------|---------------------------|----------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------|--|----------------|------|
| Orientation:                  | Wall                                        | BOSS Batt™                | BOSS FireMastic-300™ | Up to 110 mm PE pipe with 2.7 mm wall thickness, penetrating 2 layers of friction or pattress fitted BOSS Batt™ protecting an aperture up to 600 mm x 600 mm sealed at the interface of the wall with sealant. The system includes a 110 mm BOSS MaxiCollar™ installed to both sides. | Reference Standard:     |  | AS 1530.4:2014 |      |
| Trade / Type:                 | Plumbing / Hydraulic / Active Fire          | BOSS Ablative Coating™    | -                    |                                                                                                                                                                                                                                                                                       | Supplementary Standard: |  | AS 4072.1-2005 |      |
| Service:                      | PE                                          | BOSS MaxiCollar™          | -                    |                                                                                                                                                                                                                                                                                       | Report Reference:       |  | WF FAS 210203  |      |
| Substrate:                    | Double Layer Fire Rated Plasterboard System | APERTURE (mm)             | ANNULAR GAP (mm)     |                                                                                                                                                                                                                                                                                       | Drawing Number:         |  | BF-2739.2      |      |
| Min Substrate Thickness (mm): | 100                                         | Up to 600 x 600           | 0.0                  |                                                                                                                                                                                                                                                                                       | Date:                   |  | 21/07/25       | Rev: |
| Sealant Depth (mm):           | -                                           | ADDITIONAL INFORMATION    |                      |                                                                                                                                                                                                                                                                                       |                         |  | 01             |      |
| Sealant Fillet (mm):          | -                                           |                           |                      |                                                                                                                                                                                                                                                                                       |                         |  |                |      |
| Wrap Length (mm):             | -                                           |                           |                      |                                                                                                                                                                                                                                                                                       |                         |  |                |      |
| FRL / FRR:                    | -/120/120                                   |                           |                      |                                                                                                                                                                                                                                                                                       |                         |  |                |      |