
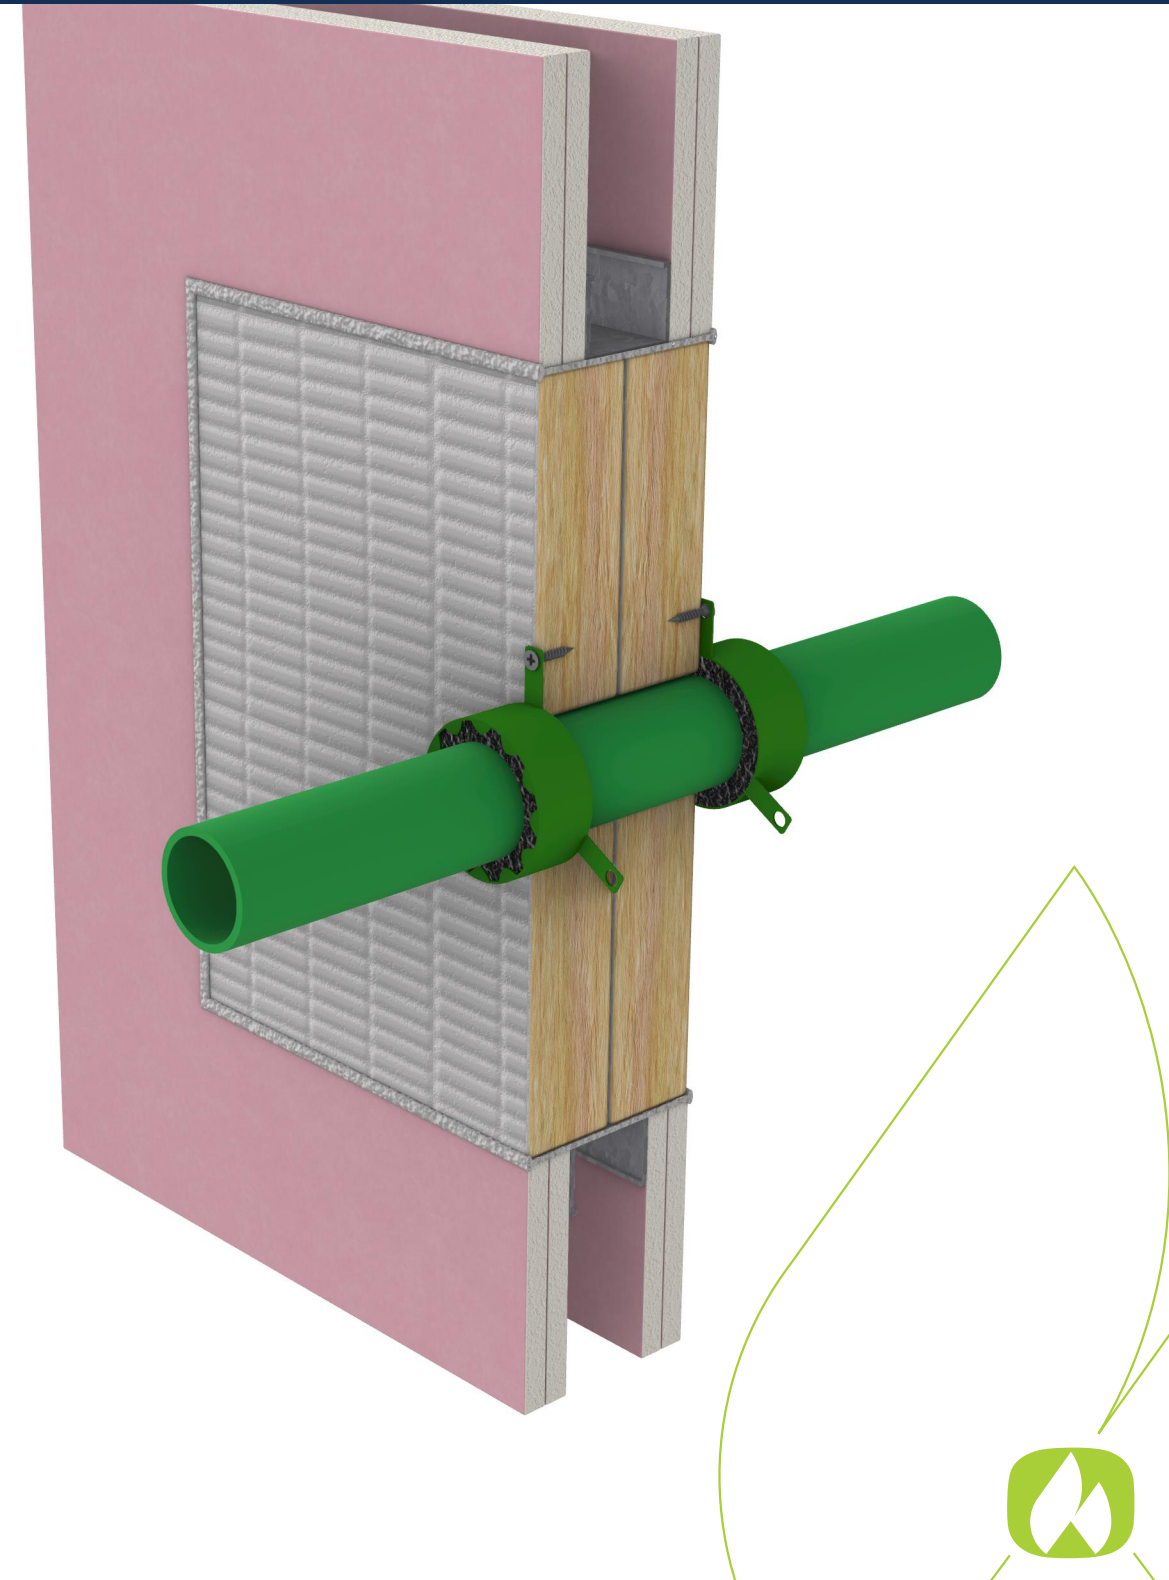


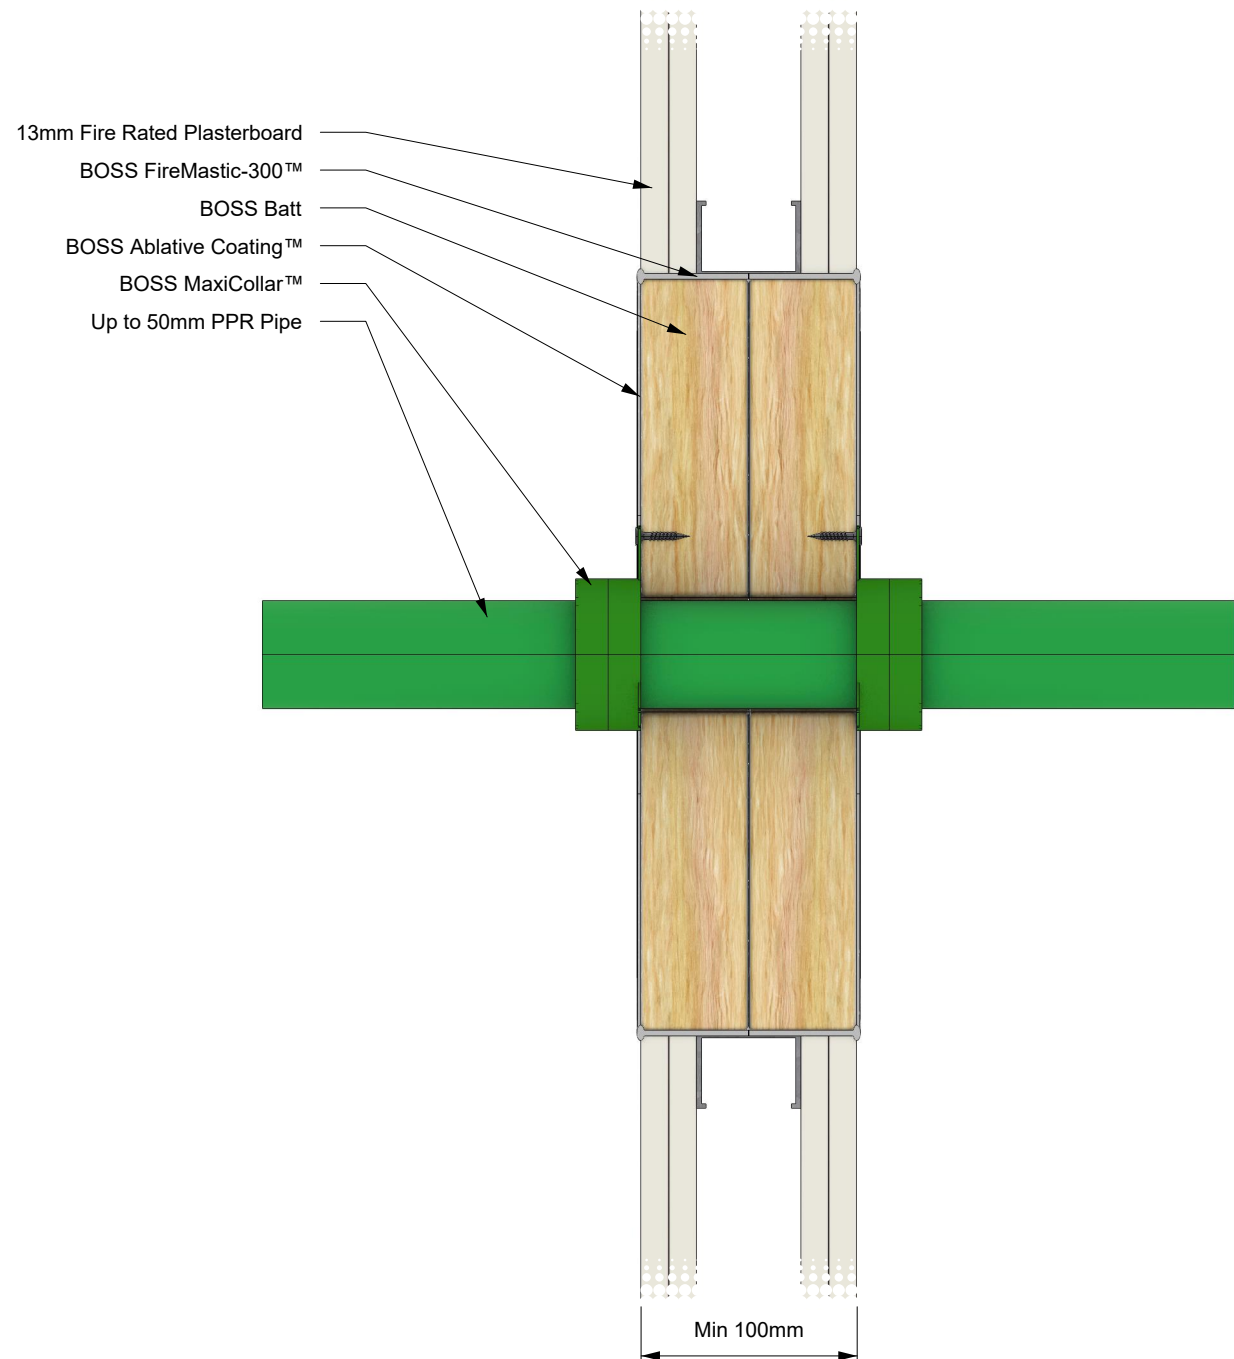

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Wall	BOSS Batt™	BOSS FireMastic-300™	Up to 50 mm PPR pipe with 2.9 mm wall thickness, penetrating 2 layers of friction or pattress fitted BOSS Batt™ protecting an aperture up to 600 mm x 600 mm sealed at the interface of the wall with sealant. The system includes a 50 mm BOSS MaxiCollar™ installed to both sides.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005		
Service:	PPR	BOSS MaxiCollar™	-		Report Reference:		WF FAS 210203		
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2740.2		
Min Substrate Thickness (mm):	100	Up to 600 x 600	0.0		-	Date:	21/07/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	-								
Wrap Length (mm):	-								
FRL / FRR:	-/120/120								