
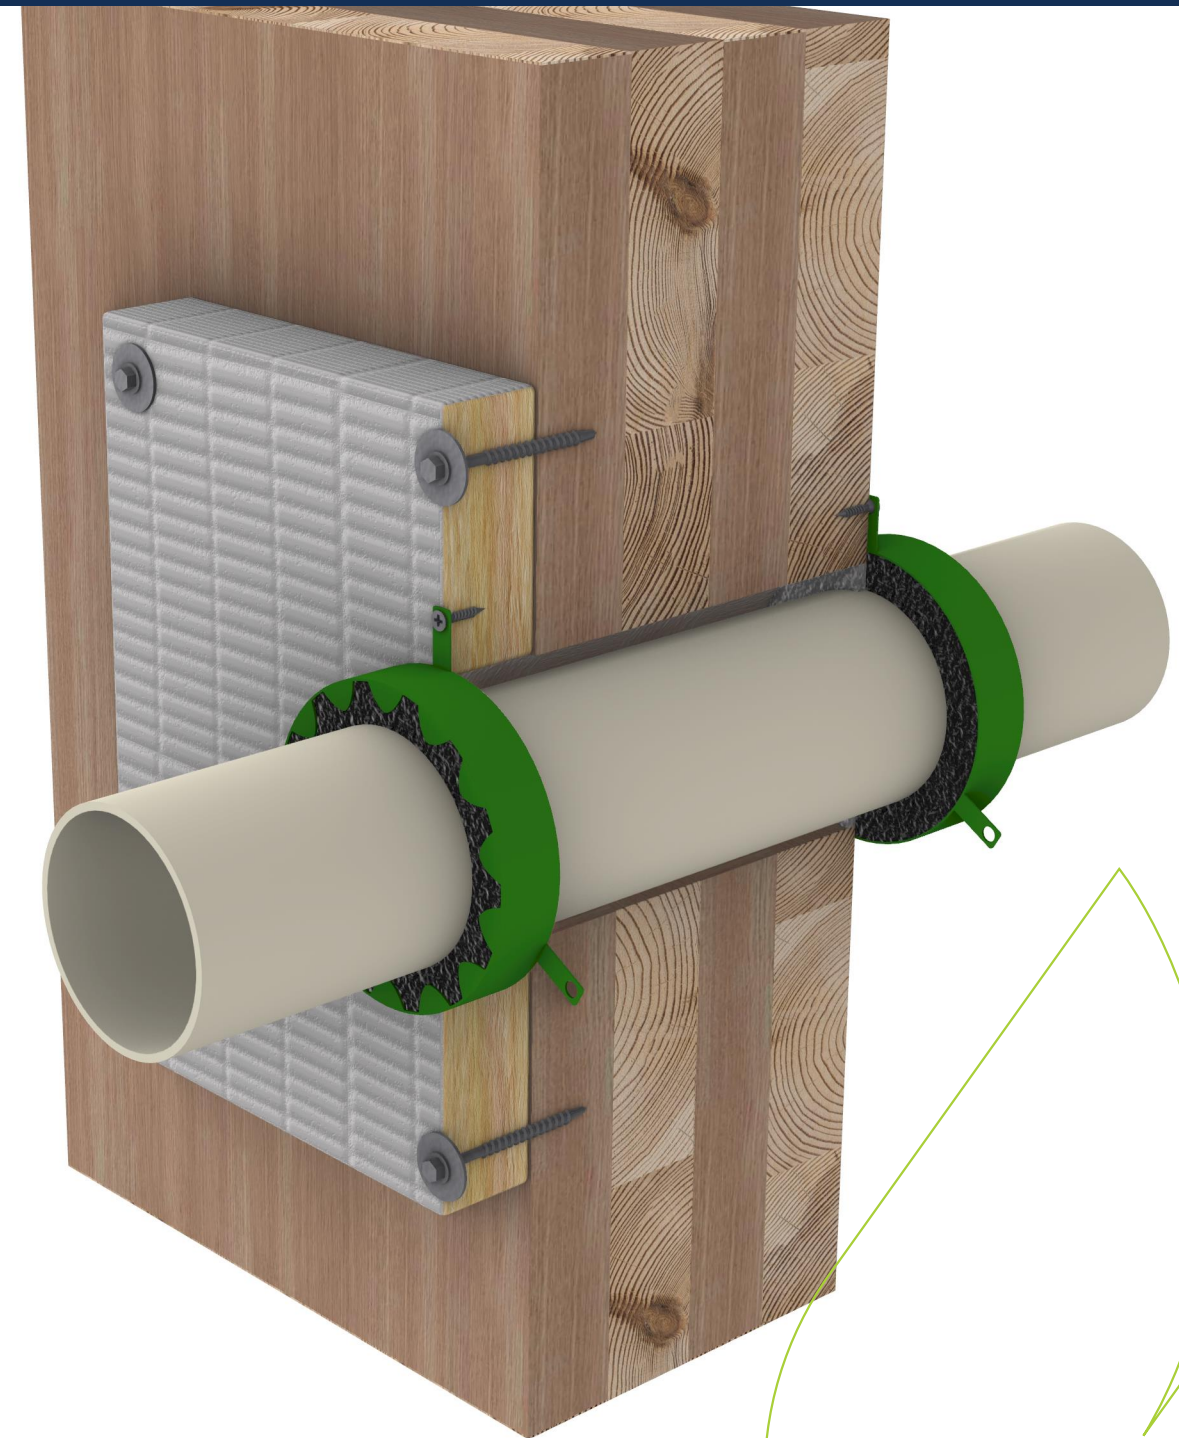


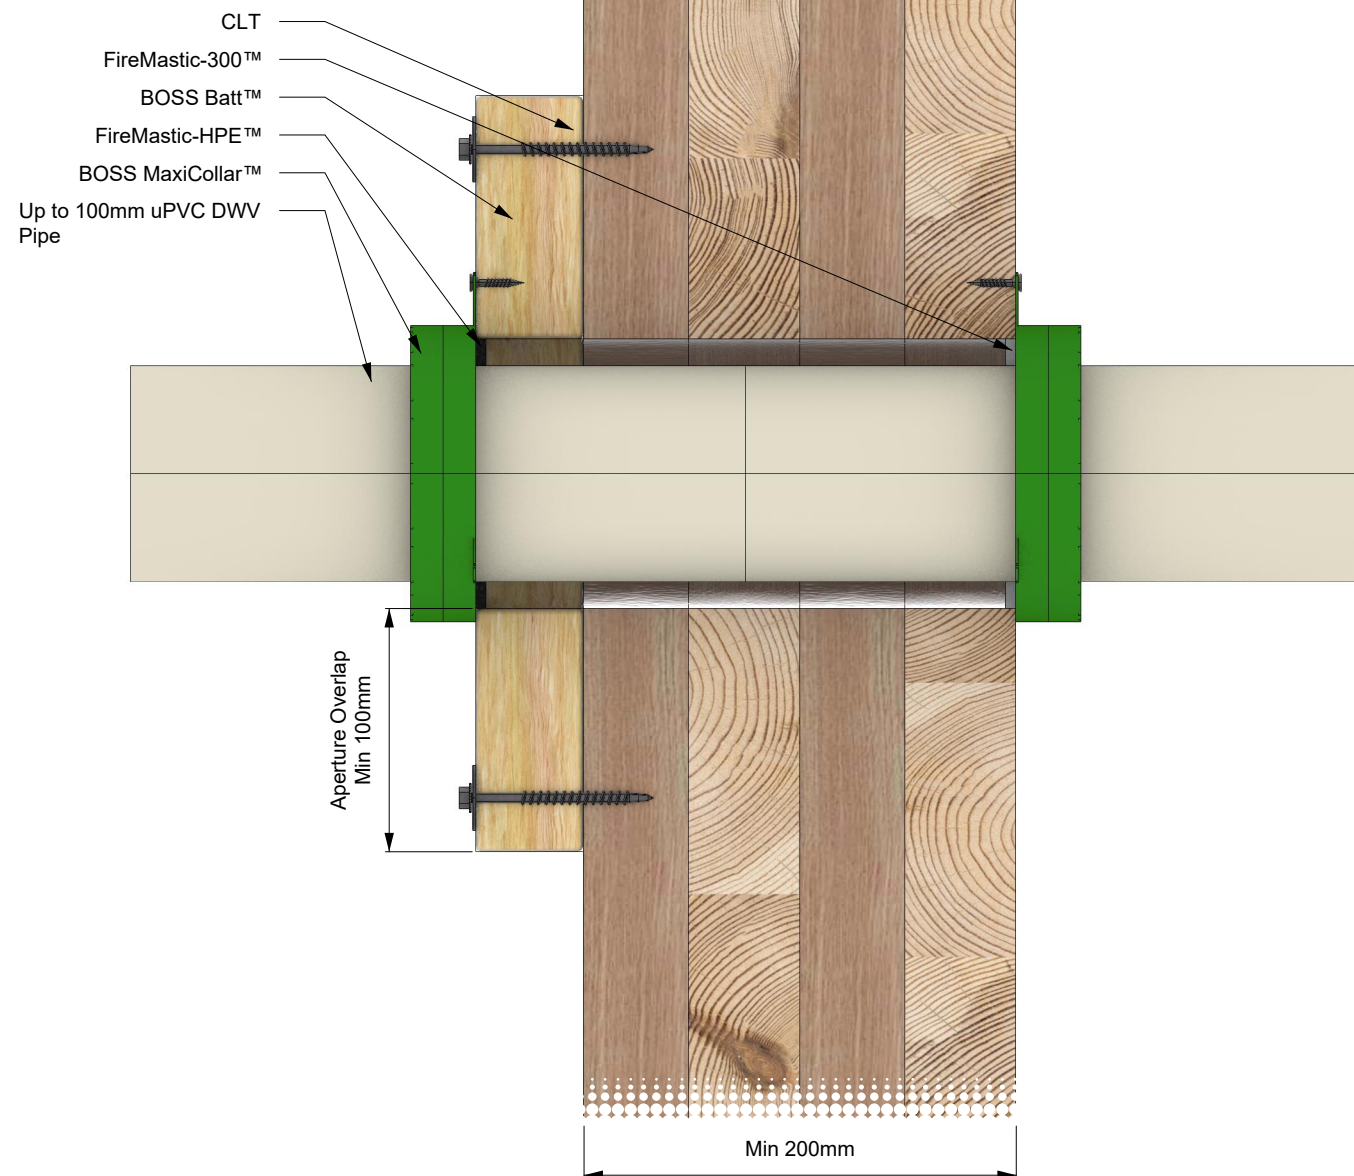

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS MaxiCollar™	BOSS Batt™	Up to 100 mm uPVC DWV pipe with 3.0 mm maximum wall thickness. BOSS Batt™ pattress installed to exposed side of the system. BOSS FireMastic-300™ sealant is used to the unexposed side and BOSS FireMastic-HPE™ sealant is used to the exposed side. Sealant 5.0 mm deep in 12.5 mm annular gap both sides. 100 mm BOSS MaxiCollar™ installed on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS FireMastic-HPE™	-		Report Reference:		WF FAS 210203	
Substrate:	CLT - Cross Laminated Timber	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2757.24	
Min Substrate Thickness (mm):	200	-	12.5		Date:		21/07/25	Rev: 01
Sealant Depth (mm):	5	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.