
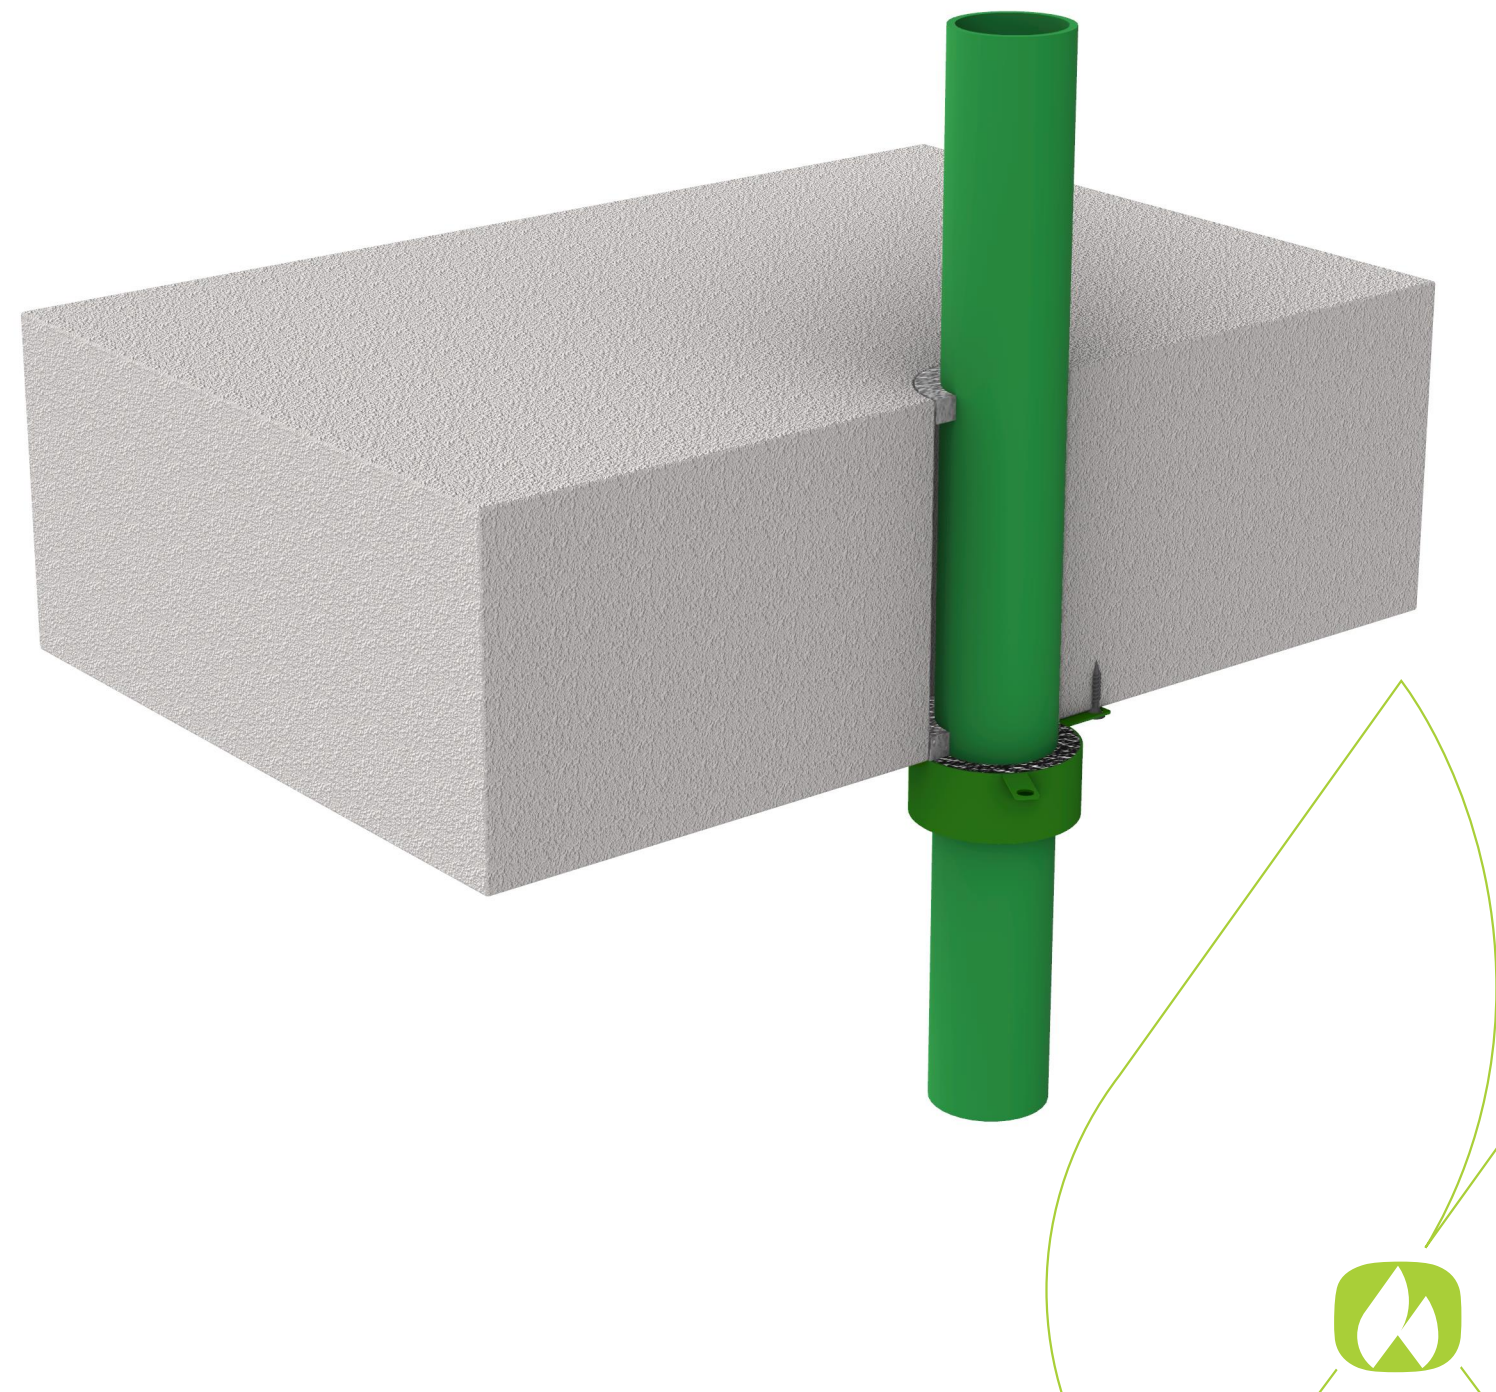


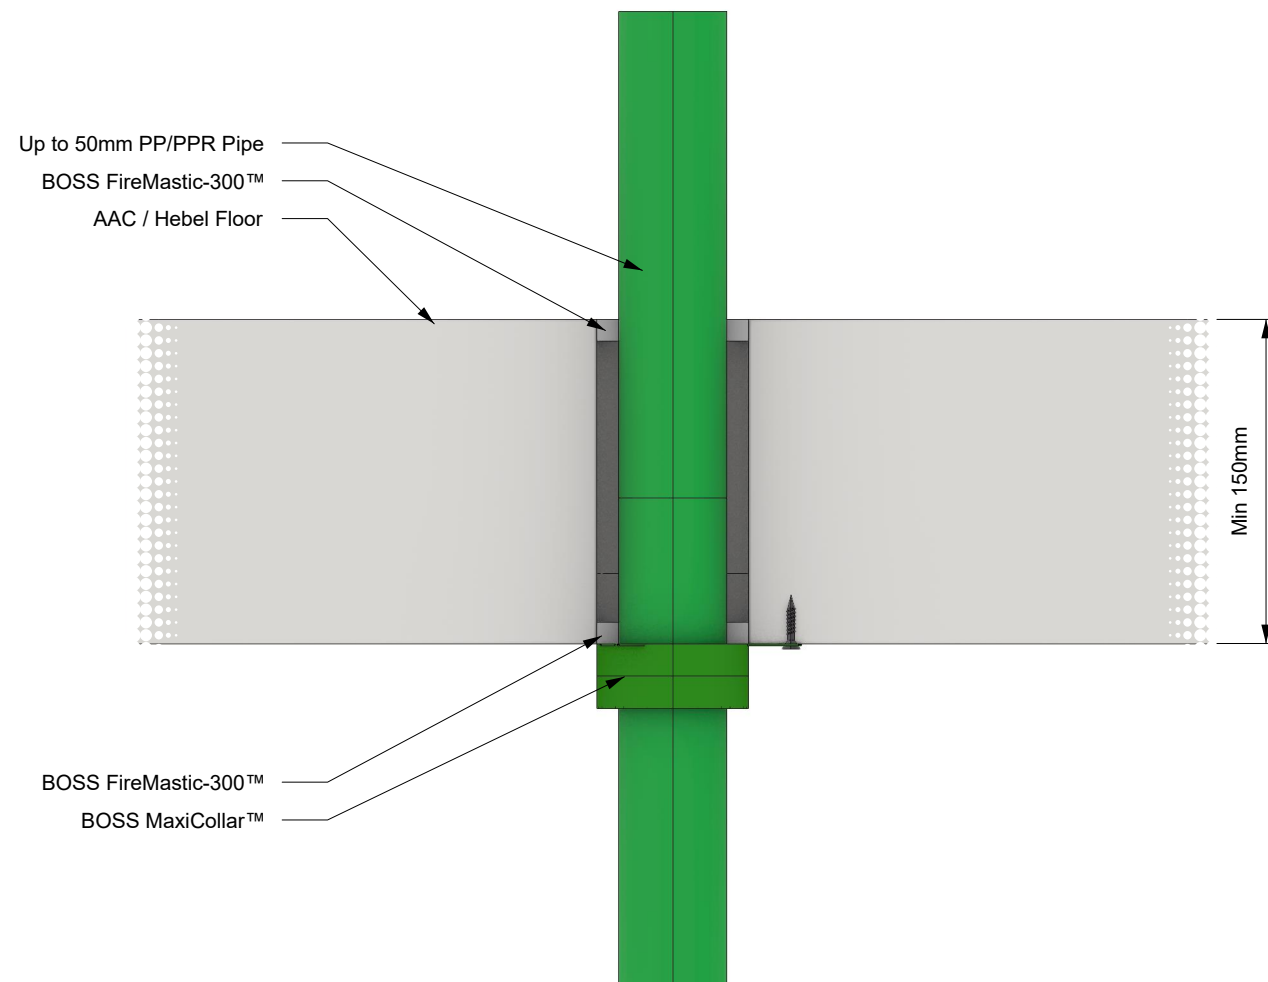

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS MaxiCollar™	-	Up to 50 mm PP/PPR pipe with 1.8 mm - 6.9 mm maximum wall thickness. Sealant 10.0 mm deep in 11.0 mm annular gap on both sides. 55 mm BOSS MaxiCollar™ installed on the underside.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PPR	-	-		Report Reference:		WF FAS 210203	
Substrate:	AAC / Hebel Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2791.26	
Min Substrate Thickness (mm):	150	-	11		Date:		17/07/25	Rev:
Sealant Depth (mm):	10	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/90/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.