
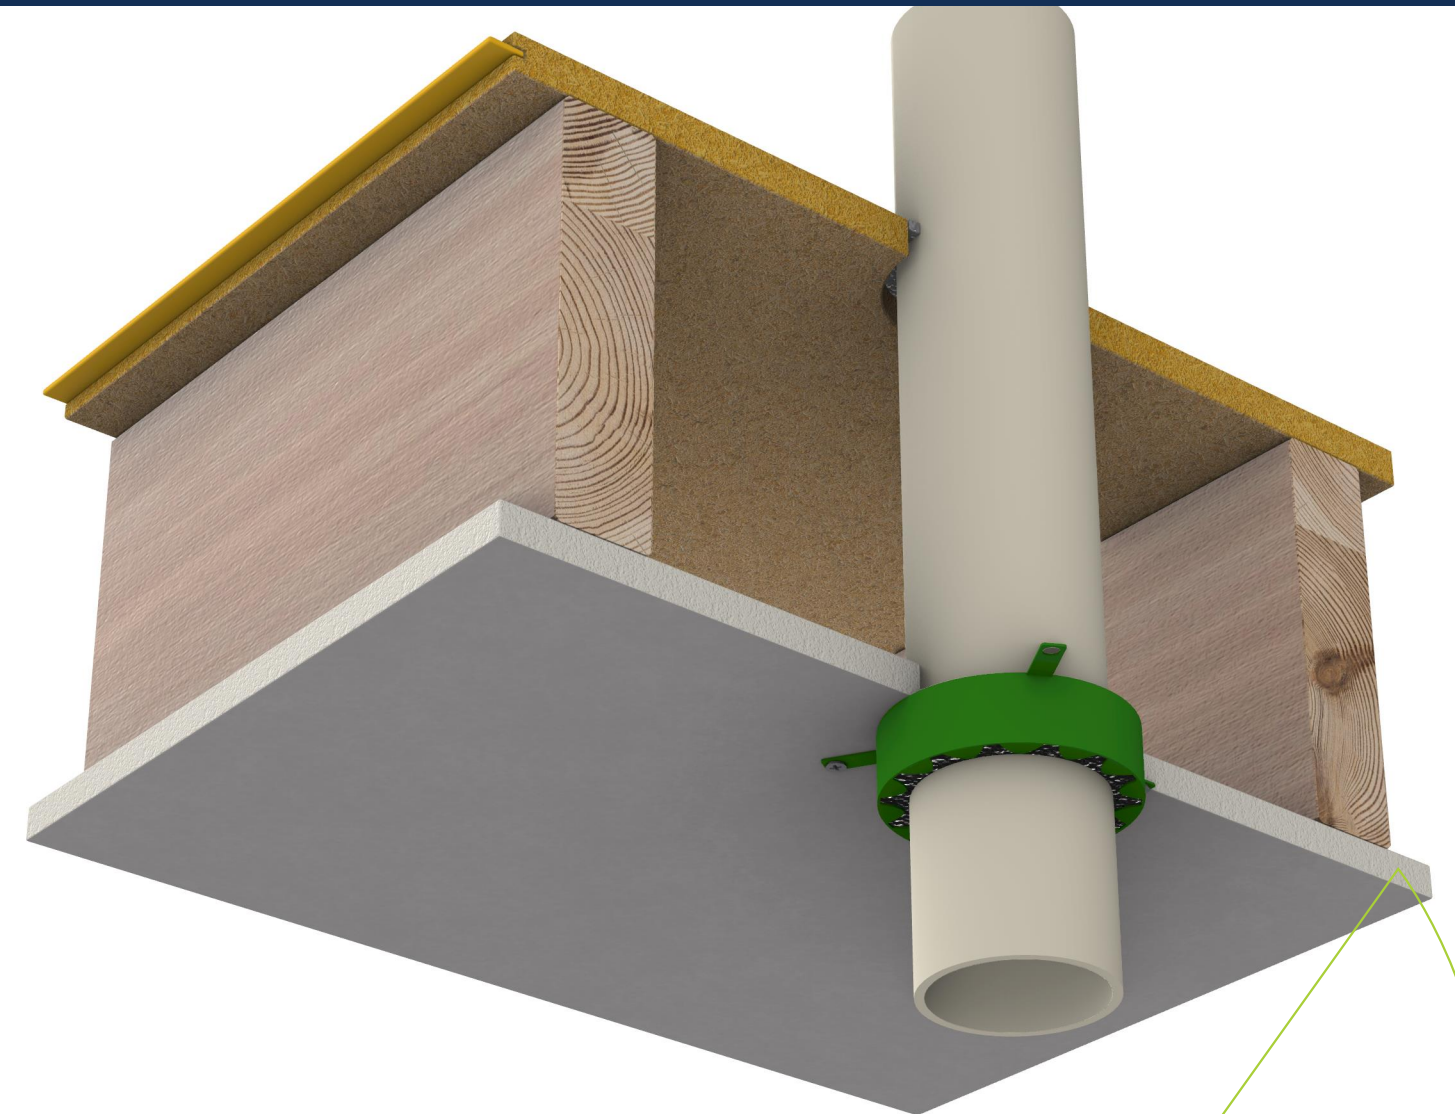


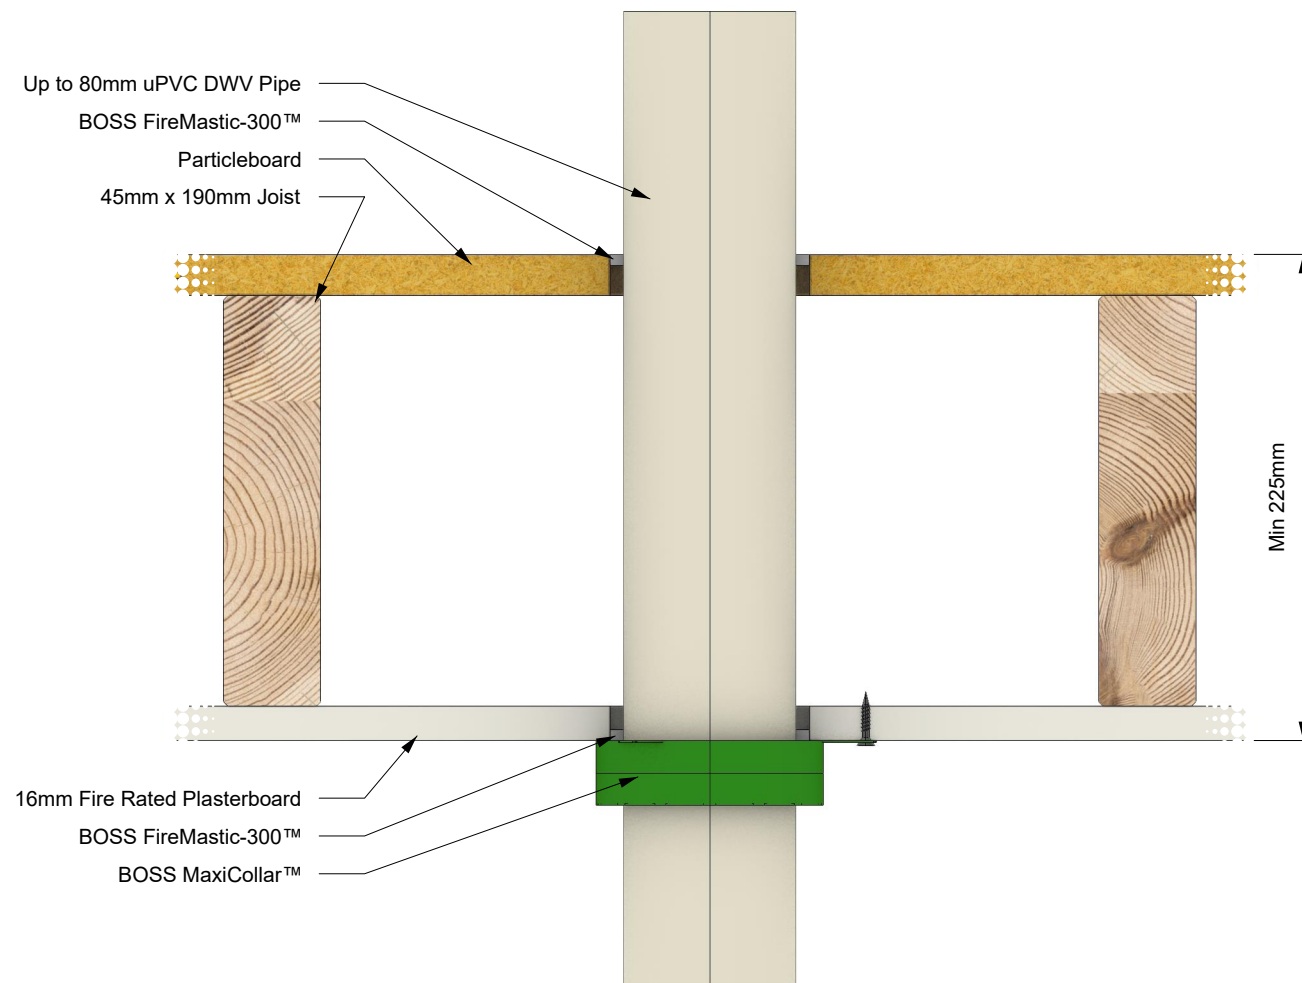

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Ceiling	BOSS MaxiCollar™	-	Up to 80 mm uPVC DWV pipe with 2.9 mm maximum wall thickness. Sealant 5.0 mm deep in 6.0 mm annular gap both sides, finished flush. 80 mm BOSS MaxiCollar™ installed on the underside.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	-	-		Report Reference:		WF FAS 210203	
Substrate:	Plasterboard ceiling systems	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2835.27	
Min Substrate Thickness (mm):	225	-	6		Date:		17/07/25	Rev:
Sealant Depth (mm):	5	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							