
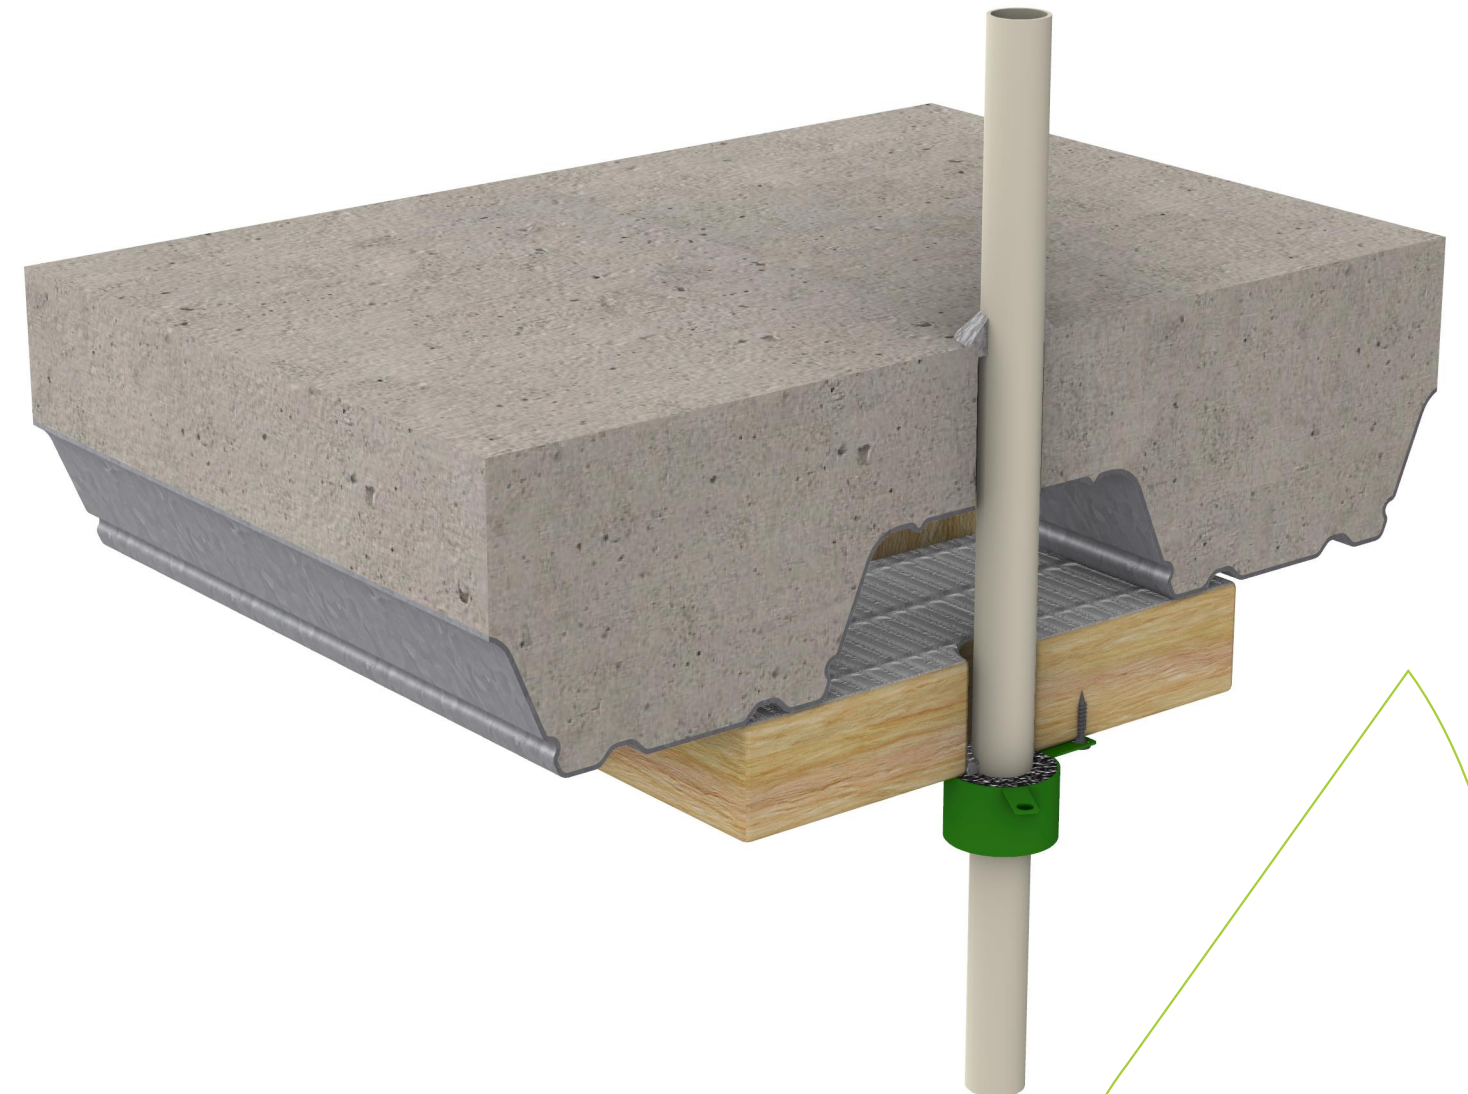


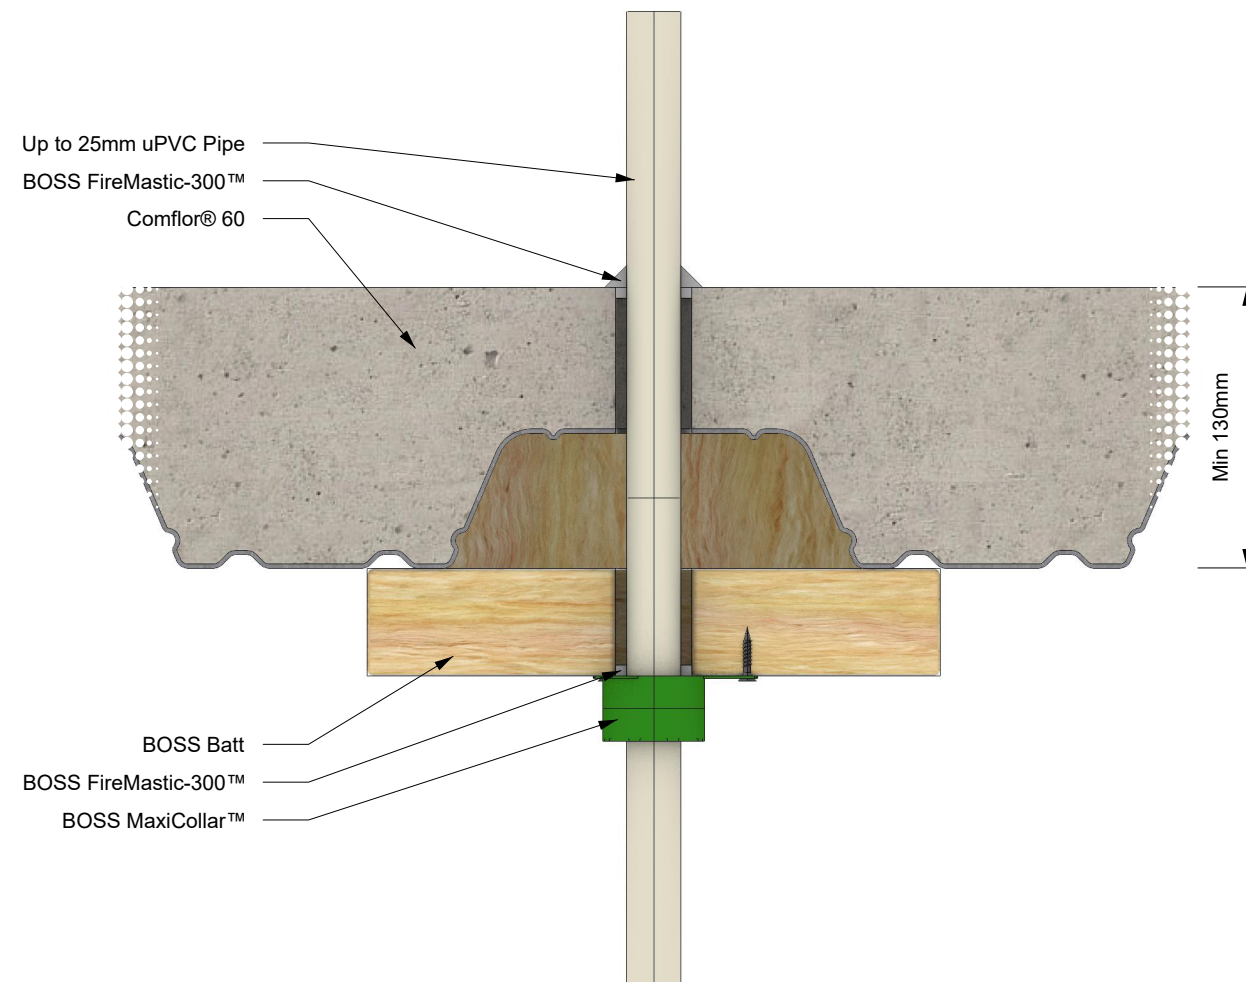

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS Batt™	BOSS FireMastic-300™	Up to 25 mm uPVC pipe with 2.2 mm maximum wall thickness. When installed in ComFlor® 60 (Composite floor deck), a 265 mm x 265 mm section of BOSS Batt is to be installed to the underside of the floor system, with the gap between the BOSS Batt and the top rib filled with a trapezoid shape section of BOSS Batt. Sealant to depth of 5 mm on both sides, finished with a 10 mm x 10 mm fillet on the top side. 32 mm BOSS MaxiCollar™ installed to the underside.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS MaxiCollar™	-		Report Reference:		WF FAS 210203	
Substrate:	Comflor® 60	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2860.28	
Min Substrate Thickness (mm):	130	-	5		Date:		17/07/25	Rev: 01
Sealant Depth (mm):	5	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	10							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.