
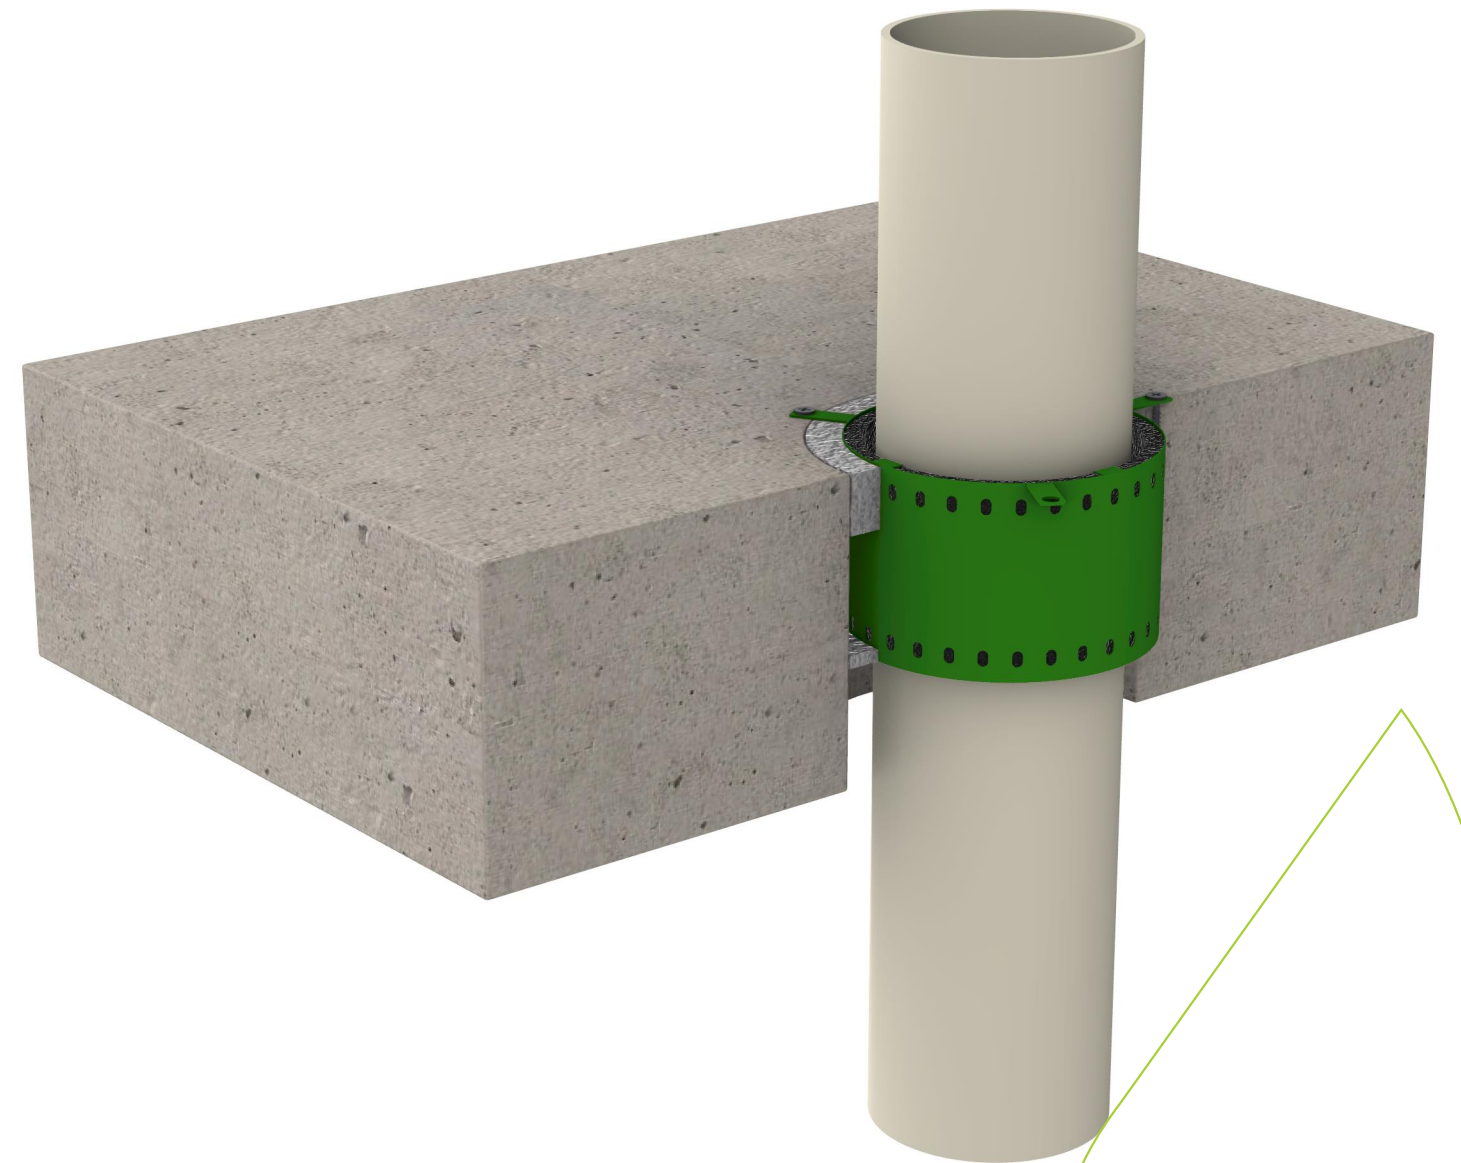


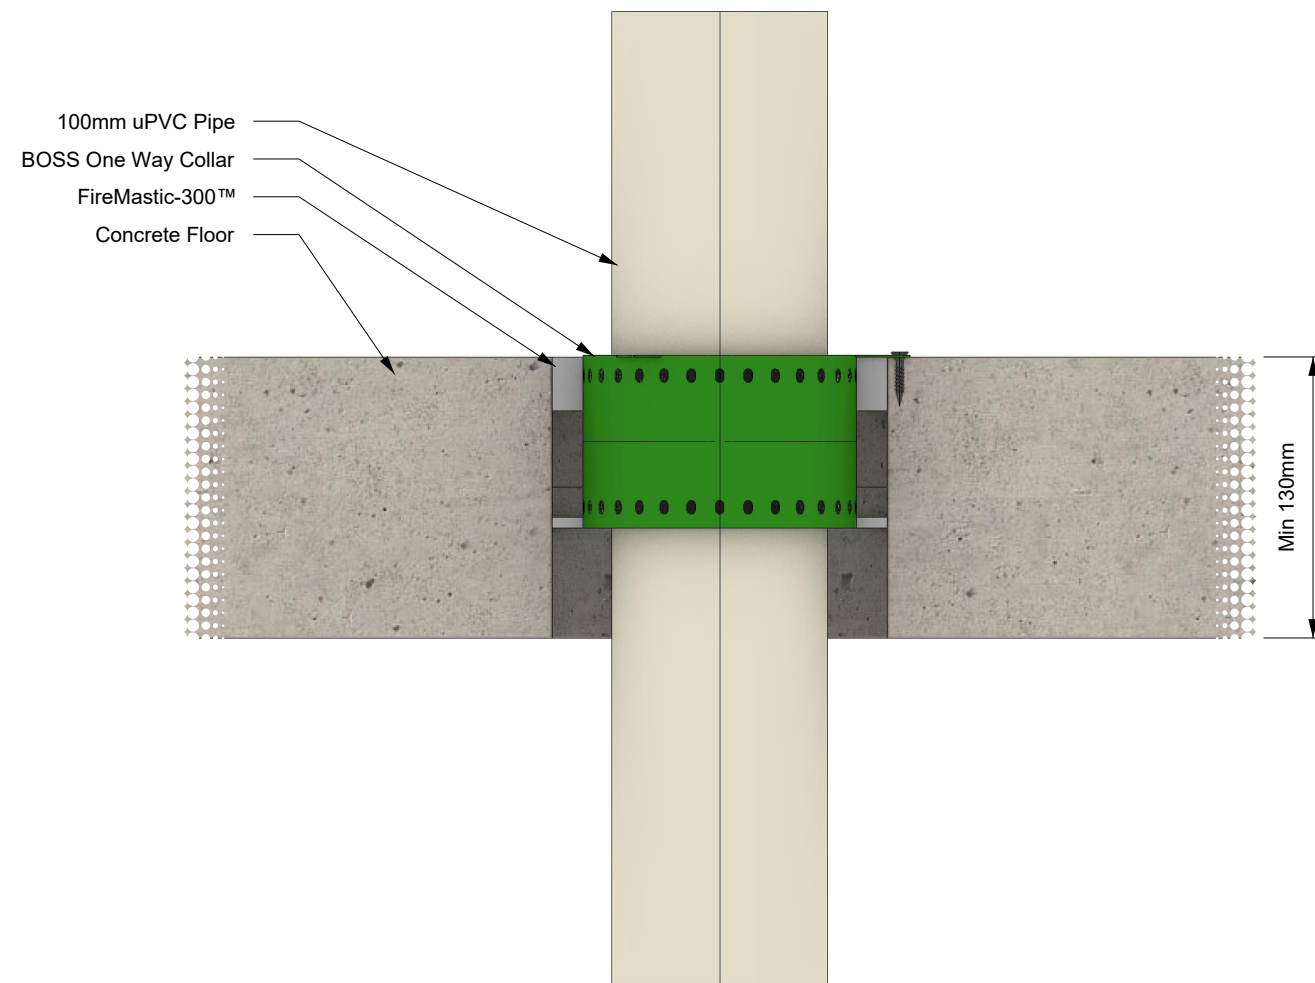

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS OneWay collar	-	100 mm uPVC pipe with 3.3 mm maximum wall thickness, installed through a 100 mm BOSS OneWay collar, installed flush with the top of the floor. Sealant installed 25 mm deep in the annular gap between the separating element, the service and the metal sleeve to the top side. Sealant was also installed 5 mm deep in the annular gap between the separating element, the service and the metal sleeve to the underside.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	-	-		Report Reference:		WF FAS 210203	
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2865.25	
Min Substrate Thickness (mm):	130	155	27.5		Date:		07/08/25	Rev: 01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.