



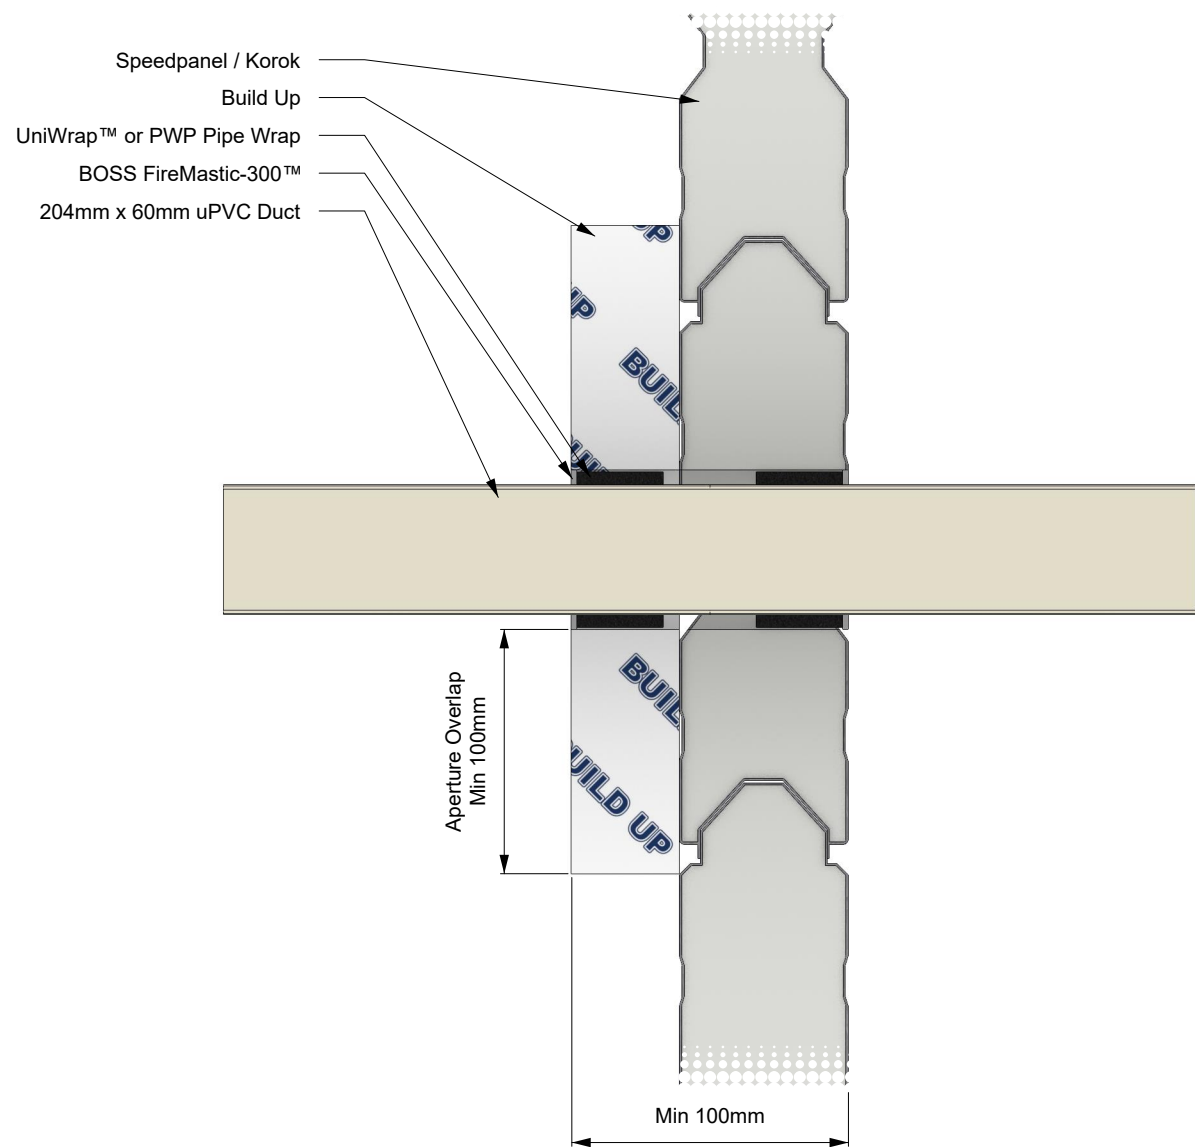

BUILD UP DETAILS

*Localised thickening to be fixed and sealed to substrate using appropriate methods relevant to the substrate and build up material.

*To achieve the necessary thickness and FRL rating of the originally tested substrate, the separating element can be built-up on one or both sides by using BOSS Batts, fire-rated plasterboard, calcium silicate board, or Shaftliner board.

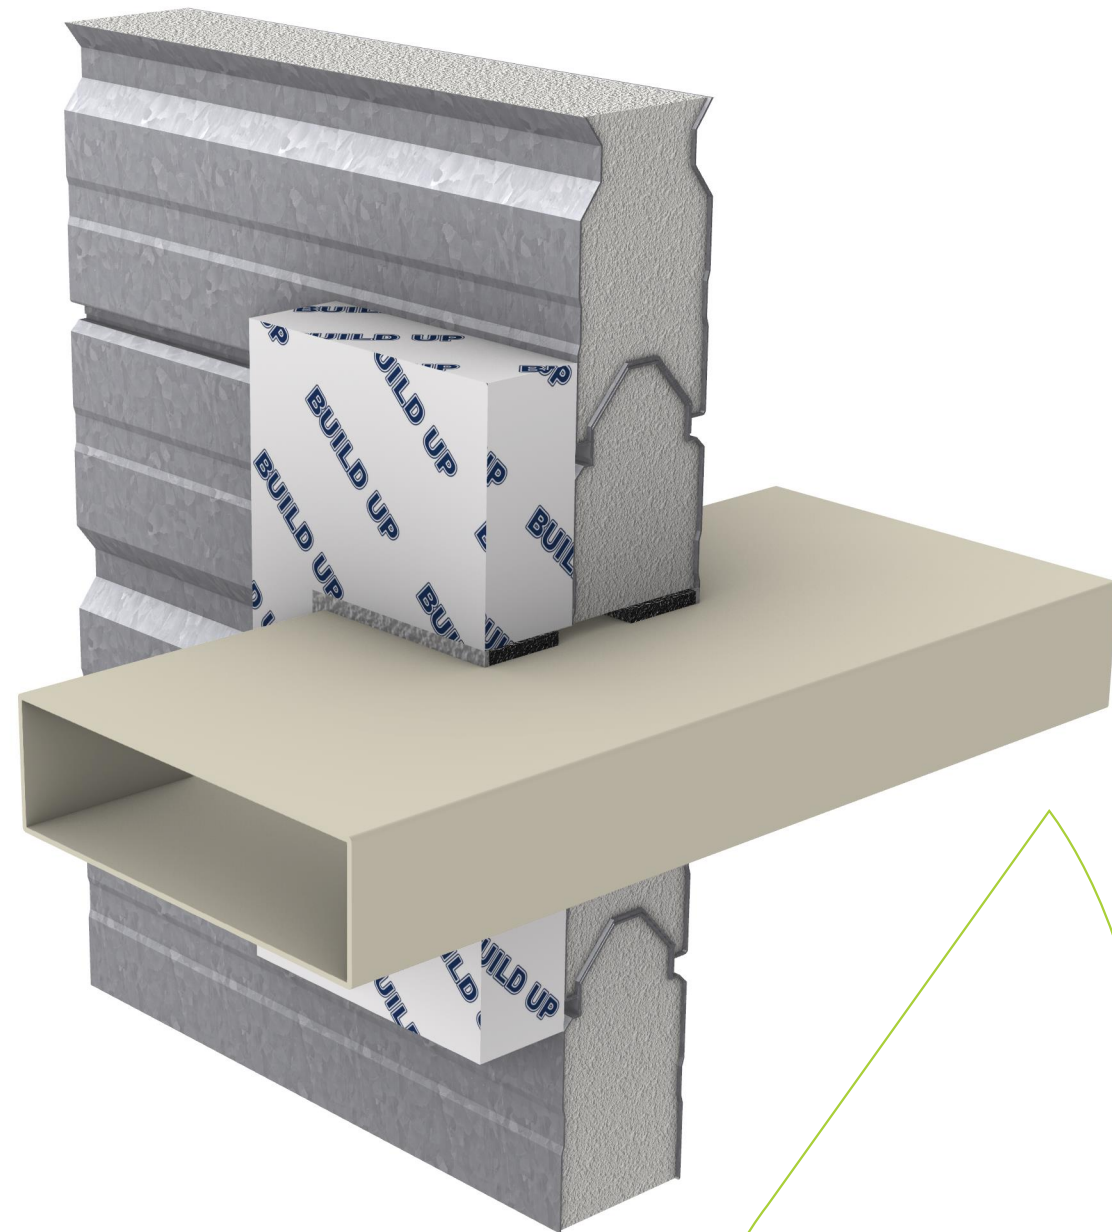

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS UniWrap™	-	204 mm x 60 mm uPVC duct with 2.5 mm maximum wall thickness. 3 layers of BOSS UniWrap™ or BOSS PWP Pipe Wrap flush with the face of the separating element on both sides. Sealant applied to the ends of the BOSS UniWrap™ or BOSS PWP Pipe Wrap on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS PWP Pipe Wrap	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS FireMastic-300™	-		Report Reference:		WF FAS 210203	
Substrate:	Speedpanel / Korok with Buildup	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2866.16	
Min Substrate Thickness (mm):	100	218 x 74	-		Date:	07/08/25	Rev:	01
Sealant Depth (mm):	Surface	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-	-						
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.