
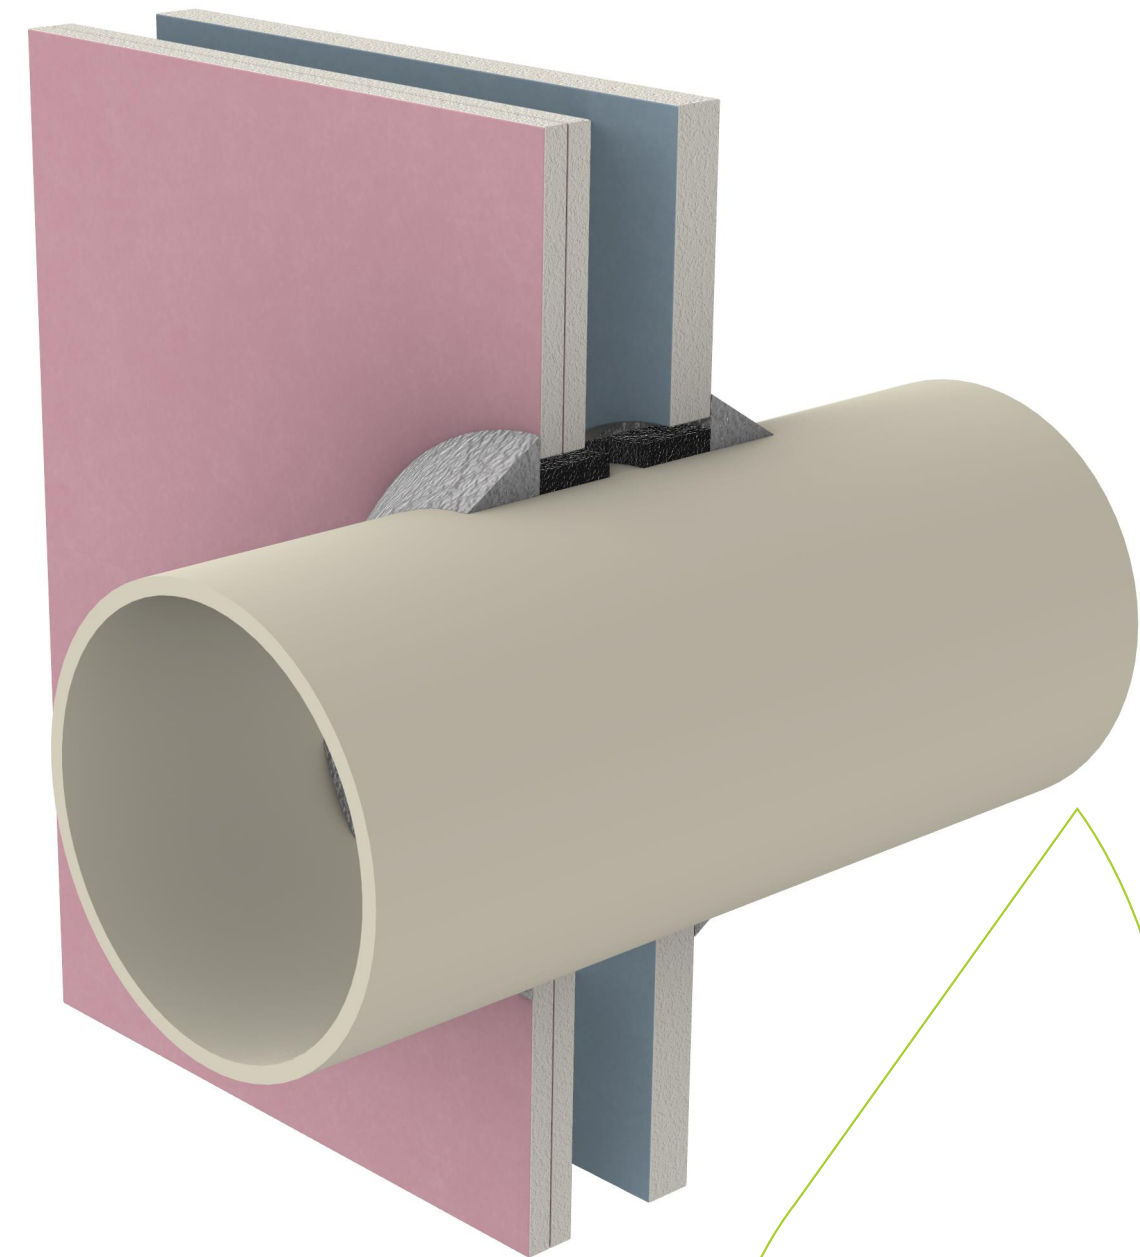


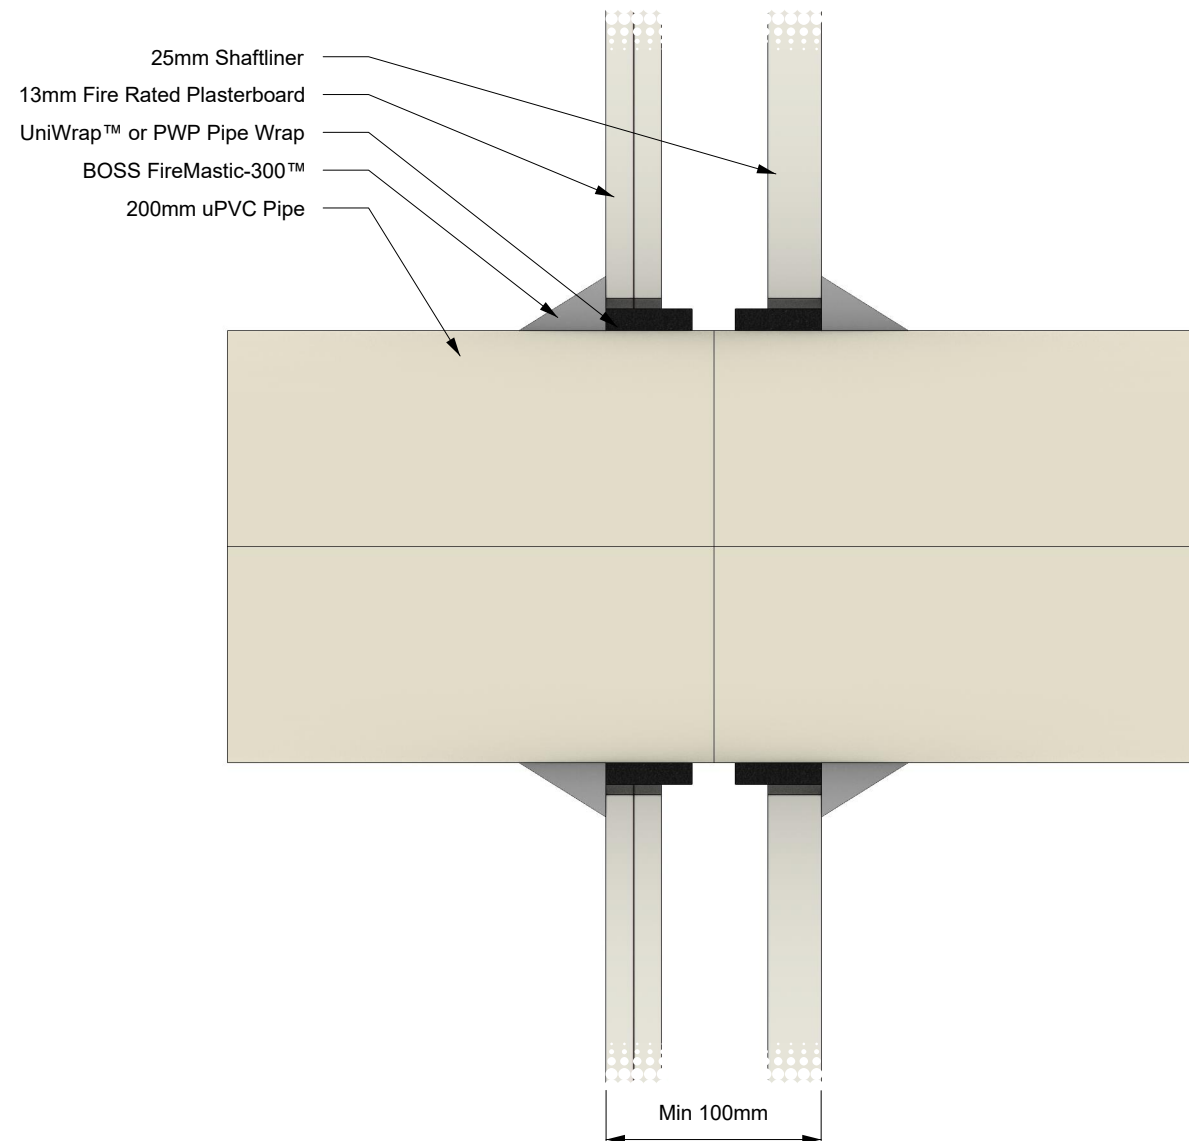

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Wall	BOSS UniWrap™	-		200 mm uPVC pipe with 7.7 mm maximum wall thickness. 5 layers of BOSS UniWrap™ or BOSS PWP Pipe Wrap flush with the face of the separating element on both sides. Fillet of sealant applied 25 mm wide (wall) x 40 mm deep (pipe) on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS PWP Pipe Wrap	-			Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS FireMastic-300™	-			Report Reference:		WF FAS 210203	
Substrate:	Shaftliner	APERTURE (mm)	ANNULAR GAP (mm)			Drawing Number:		BF-2869.12	
Min Substrate Thickness (mm):	100	-	35			Date:	07/08/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	25 (Wall) x 40 (Pipe)								
Wrap Length (mm):	-								
FRL / FRR:	-/120/120								

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.