


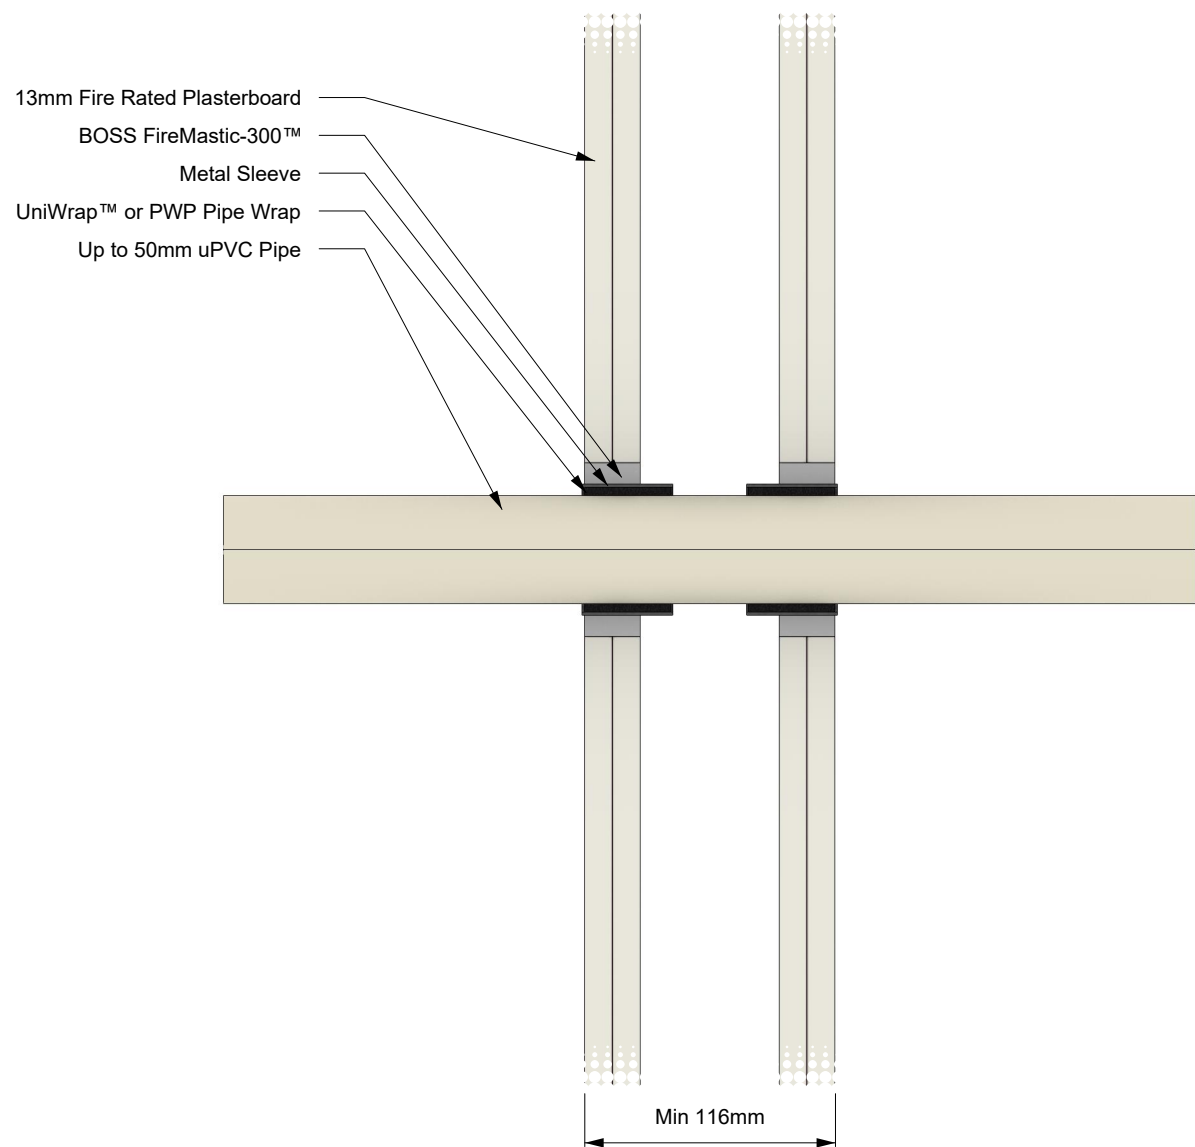

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS UniWrap™	-	Up to 50 mm uPVC pipe with 3.5 mm maximum wall thickness. 2 layers of BOSS UniWrap™ or BOSS PWP Pipe Wrap encased in a metal sleeve, flush with the face of the separating element on both sides. Sealant 26 mm deep in 10.0 mm annular gap between the wall, service and metal sleeve, finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS PWP Pipe Wrap	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS FireMastic-300™	-		Report Reference:		WF FAS 210203	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2871.2	
Min Substrate Thickness (mm):	116	-	10		Date:	07/08/25	Rev:	01
Sealant Depth (mm):	26	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.