
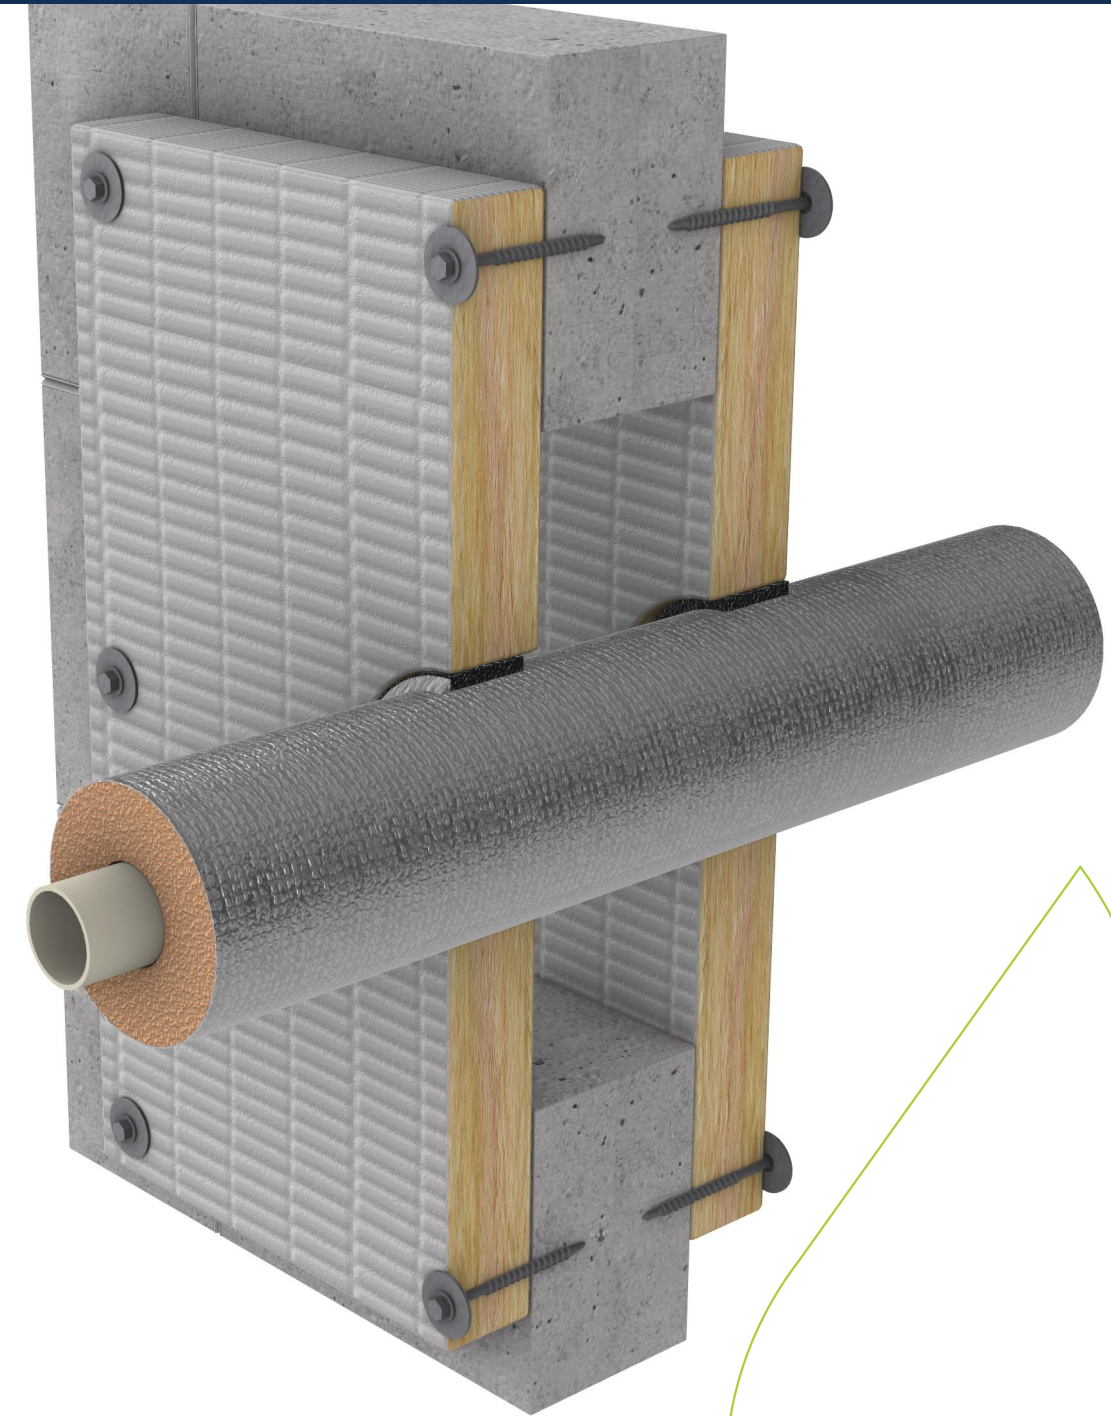


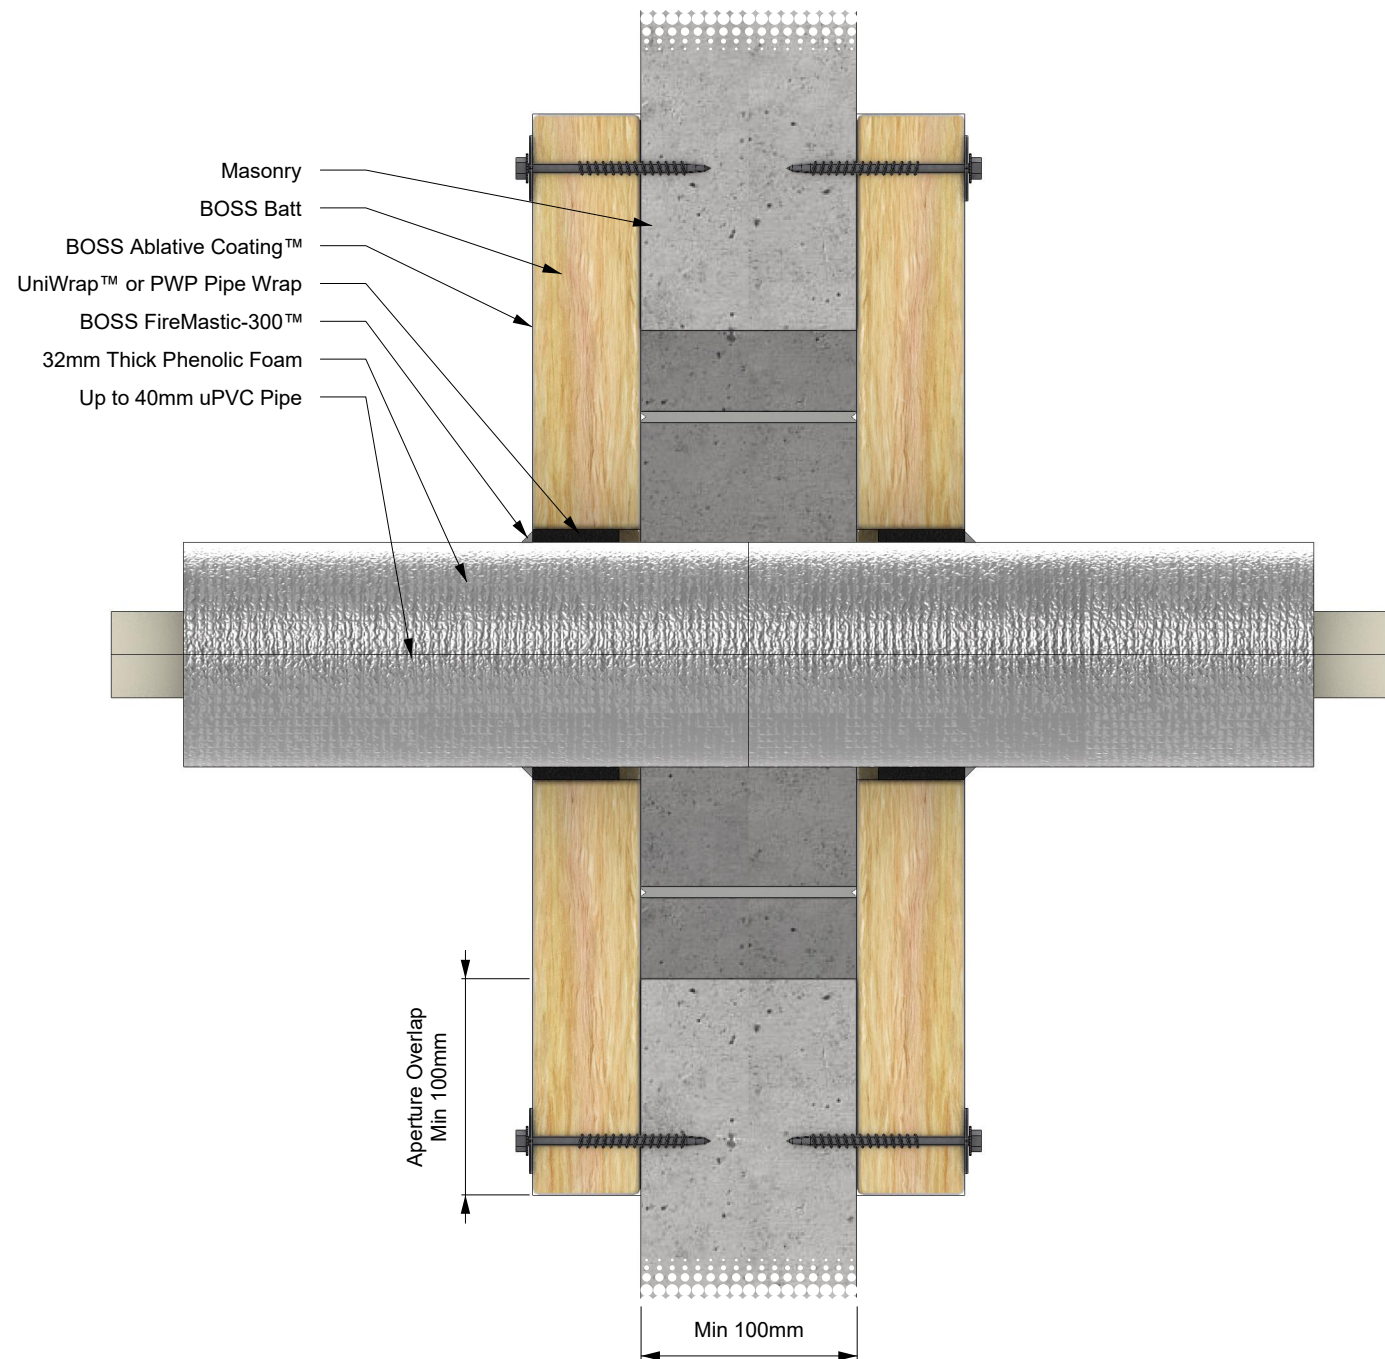

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS PWP Pipe Wrap	Up to 40 mm uPVC pipe with 1.9 mm wall thickness, insulated with 32 mm thick phenolic foam. The system penetrated 2 layers of BOSS Batt™, with each layer patressed on either side protecting an aperture up to 600 mm x 600 mm, that overlapped the aperture by 100 mm on all sides. 3 layers of BOSS UniWrap™ or BOSS PWP Pipe Wrap flush with the face of the separating element on both sides installed in the 38.0 mm annular gap. 5 mm x 5 mm fillet of sealant applied both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	BOSS FireMastic-300™		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS UniWrap™	-		Report Reference:		WF FAS 210203	
Substrate:	Masonry	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2879.5	
Min Substrate Thickness (mm):	100	Up to 600 x 600	38		Date:	07/08/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	5	-						
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							