
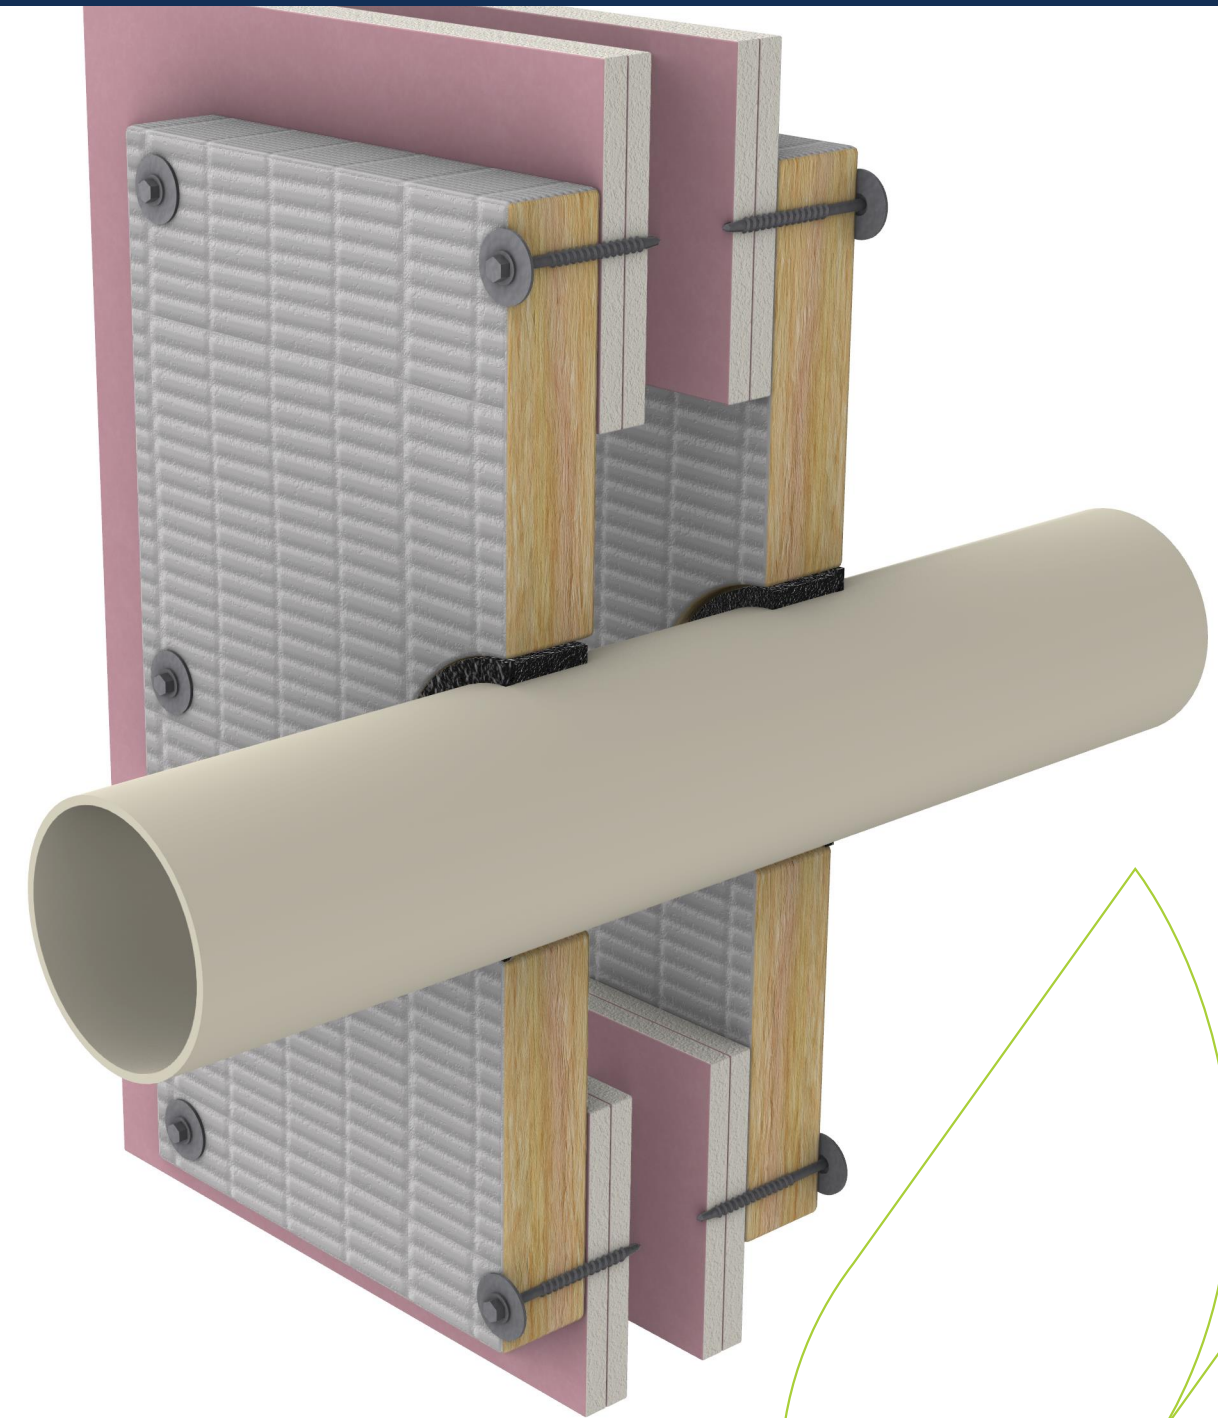


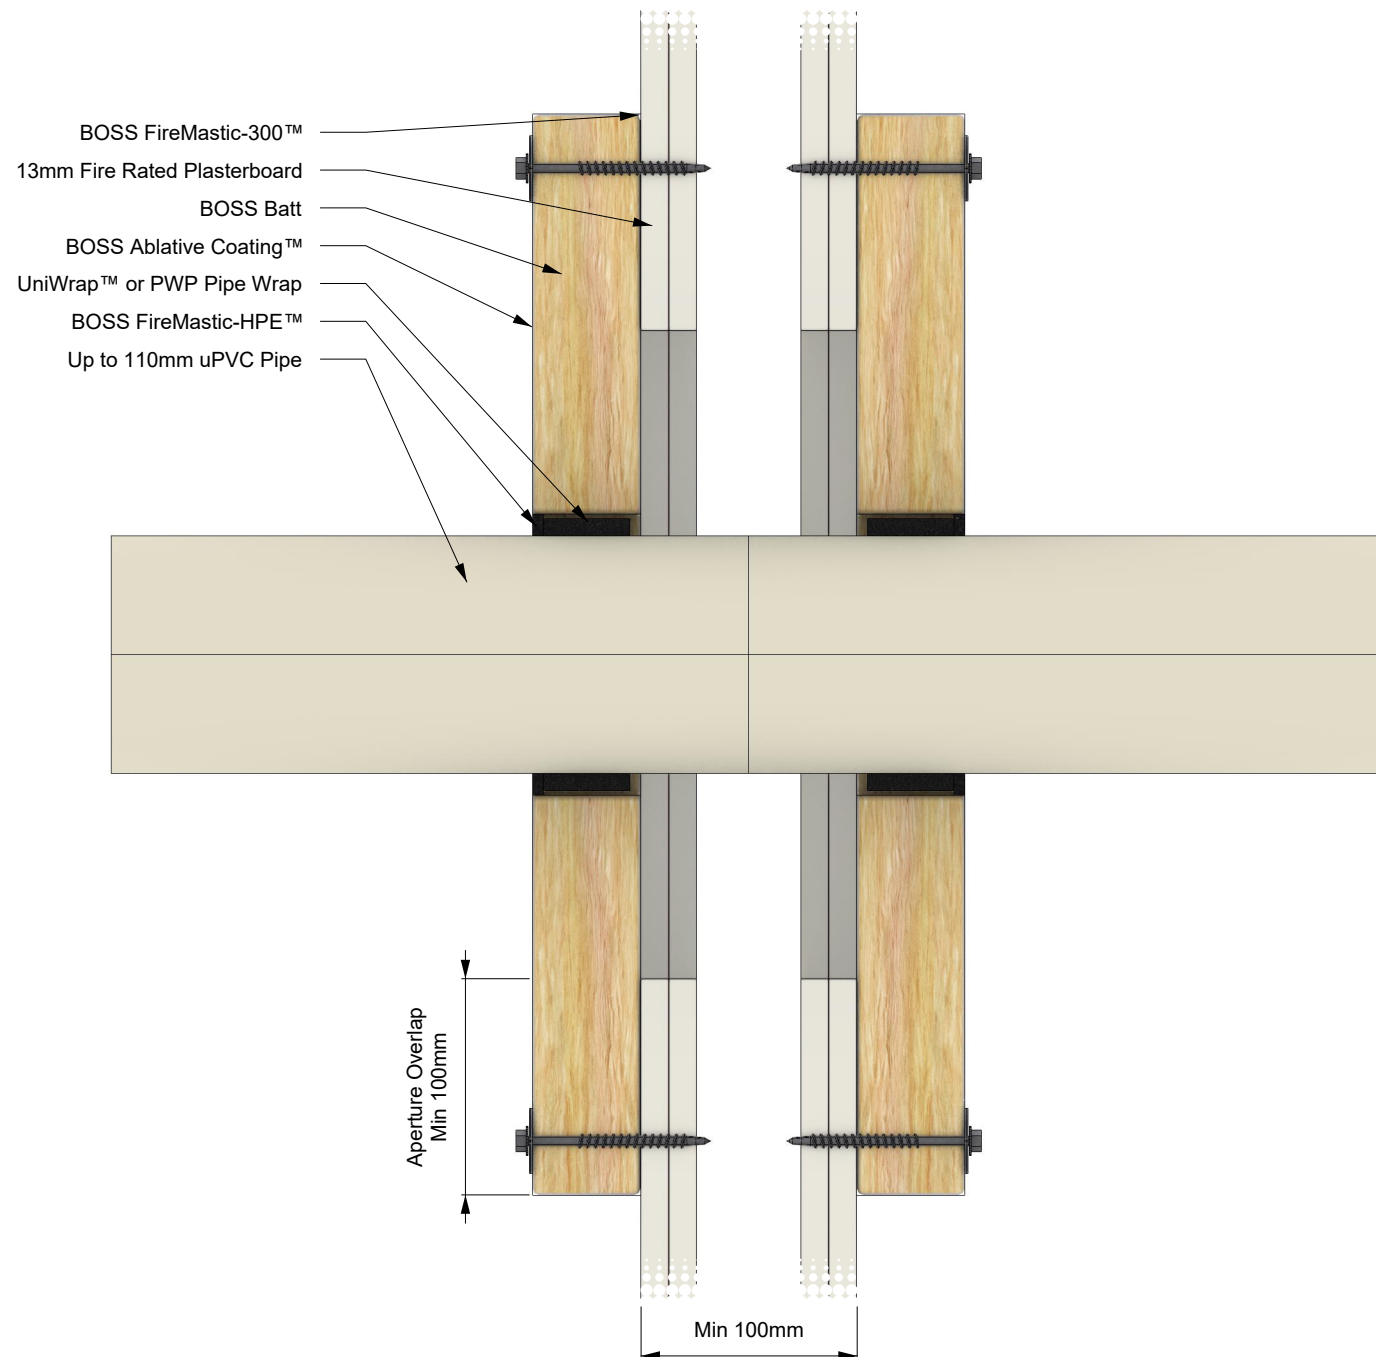

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS PWP Pipe Wrap	Up to 110 mm uPVC pipe with 4.9mm wall thickness. The system penetrated 2 layers of BOSS Batt™, with each layer patressed on either side protecting an aperture up to 470 mm x 470 mm, that overlapped the aperture by 100 mm on all sides. All edges sealed with BOSS FireMastic-300™ sealant. 4 layers of BOSS UniWrap™ or BOSS PWP Pipe Wrap flush with the face of the separating element on both sides installed in the 10.0 mm annular gap. Sealant applied to the ends of the BOSS UniWrap™ or BOSS PWP Pipe Wrap on both sides with BOSS FireMastic-HPE™.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	BOSS FireMastic-300™		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS UniWrap™	-		Report Reference:		WF FAS 210203	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2886.2	
Min Substrate Thickness (mm):	100	Up to 470 x 470	10		Date:	07/08/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.