
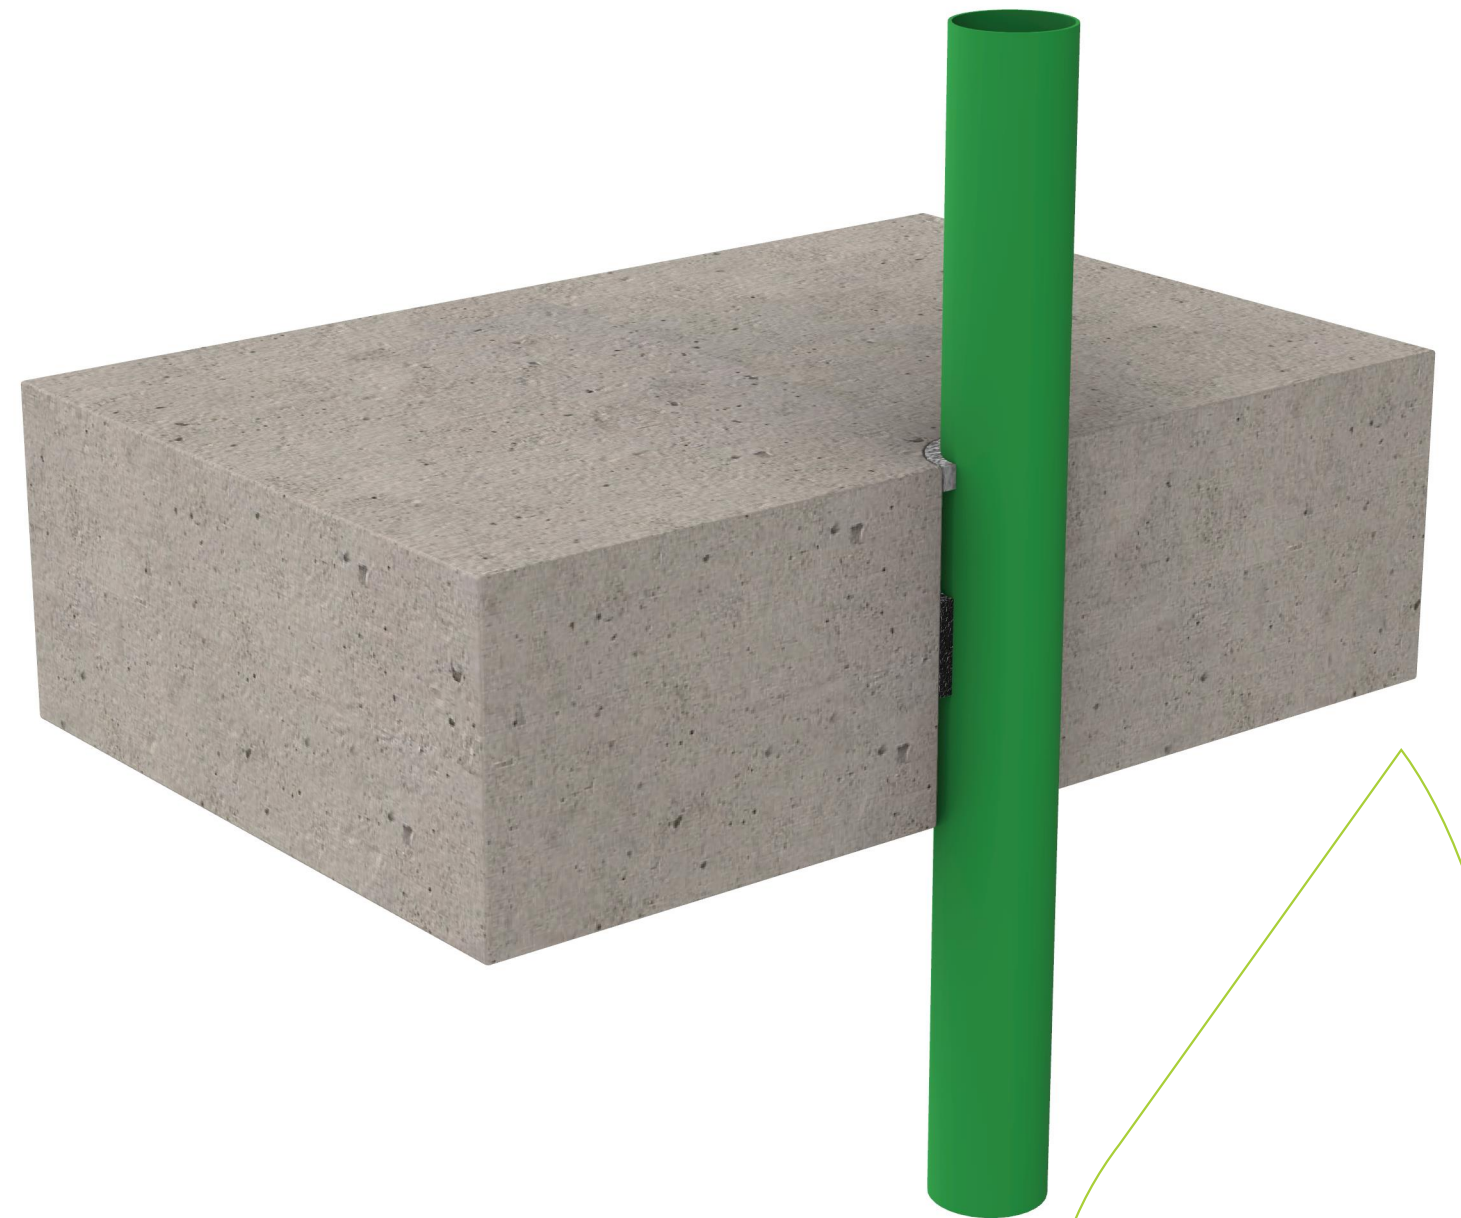


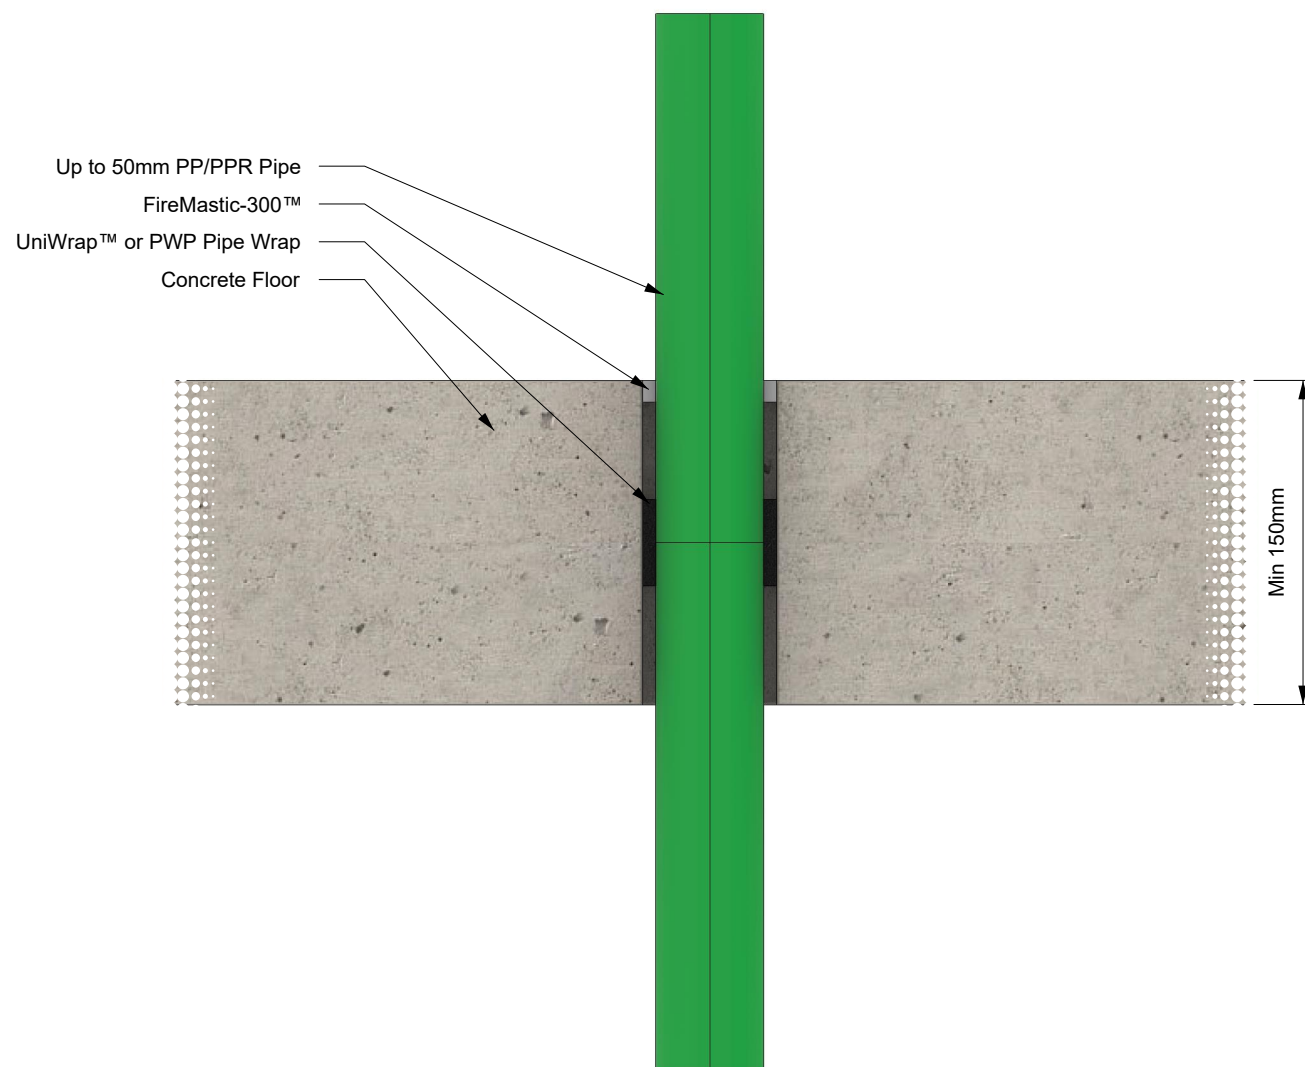

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS UniWrap™	-	Up to 50 mm PP/PPR pipe with 3.0 – 4.6 mm wall thickness. 2 layers of BOSS UniWrap™ or BOSS PWP Pipe Wrap mid-depth of the floor. Sealant 10.0 mm deep in 6.0 mm annular gap to the top side.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS PWP Pipe Wrap	-		Supplementary Standard:		AS 4072.1-2005	
Service:	HDPE	BOSS FireMastic-300™	-		Report Reference:		WF FAS 210203	
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2893.25	
Min Substrate Thickness (mm):	150	-	6		Date:		07/08/25	Rev:
Sealant Depth (mm):	10	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/240/240							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.