
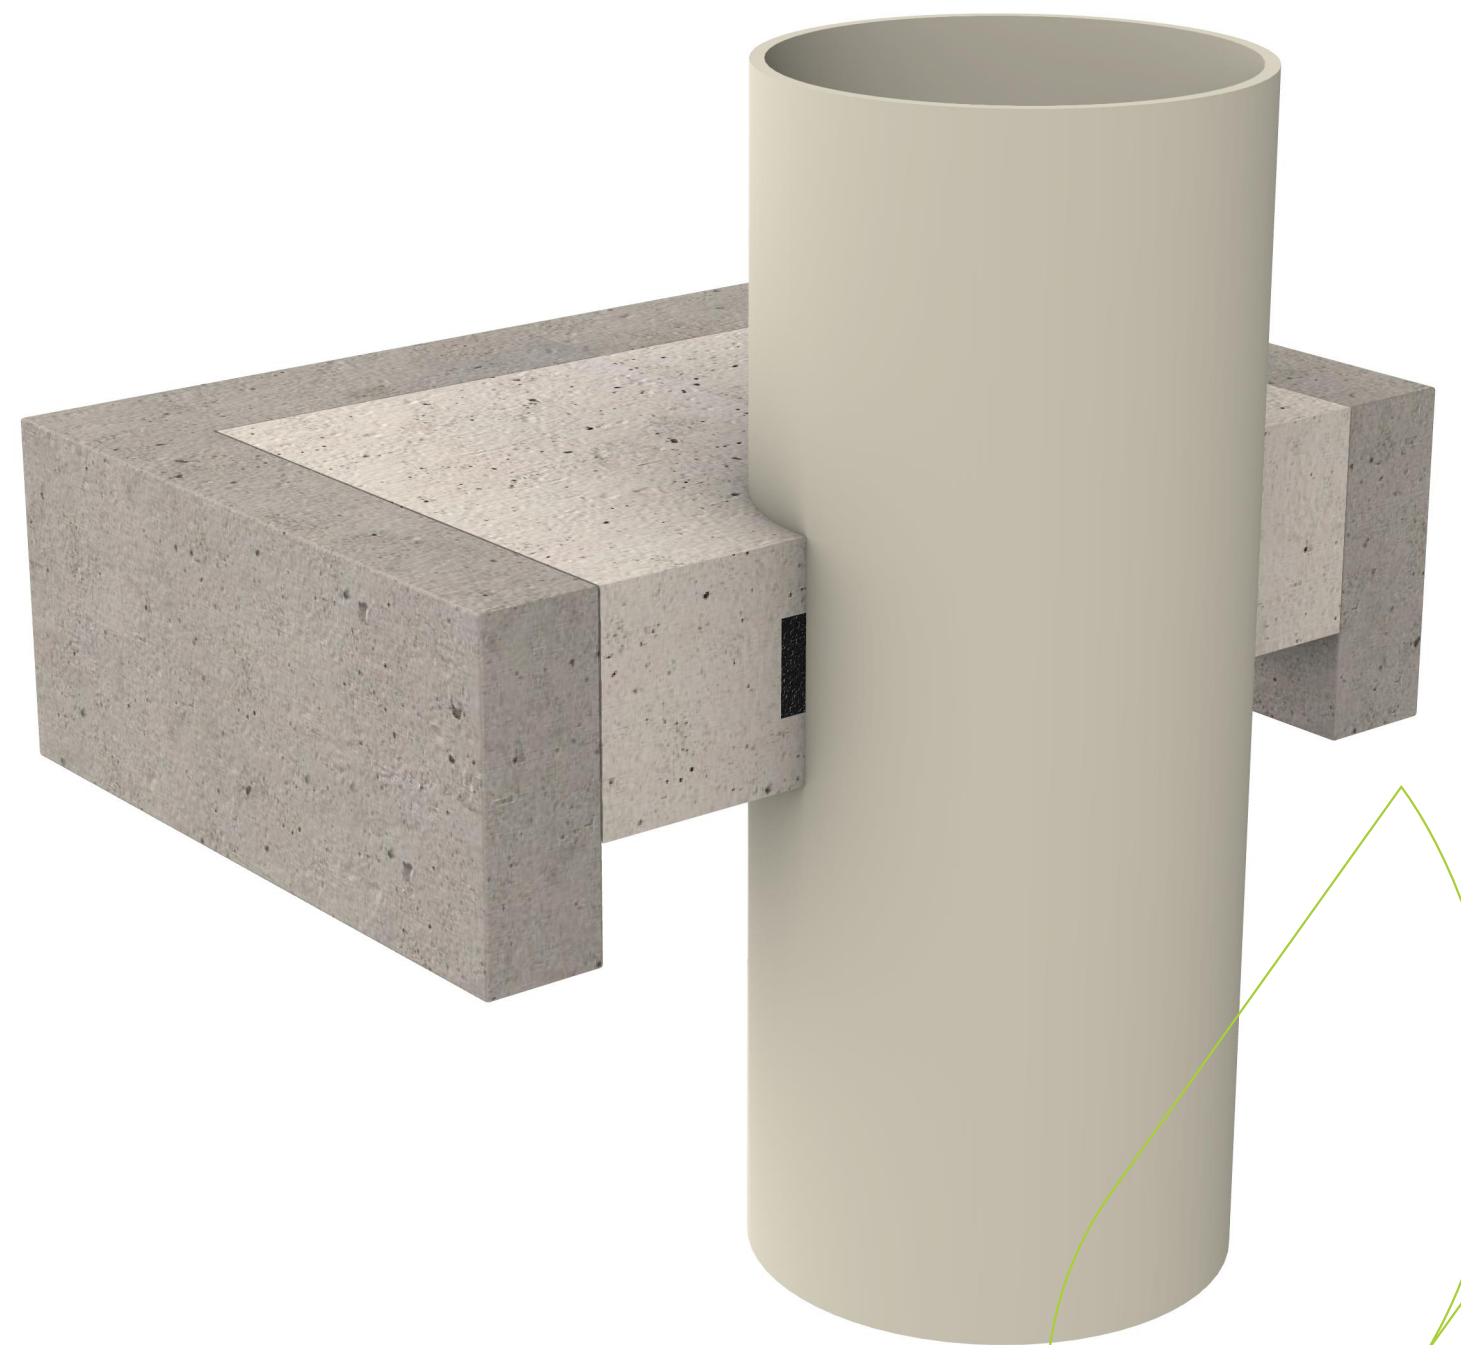


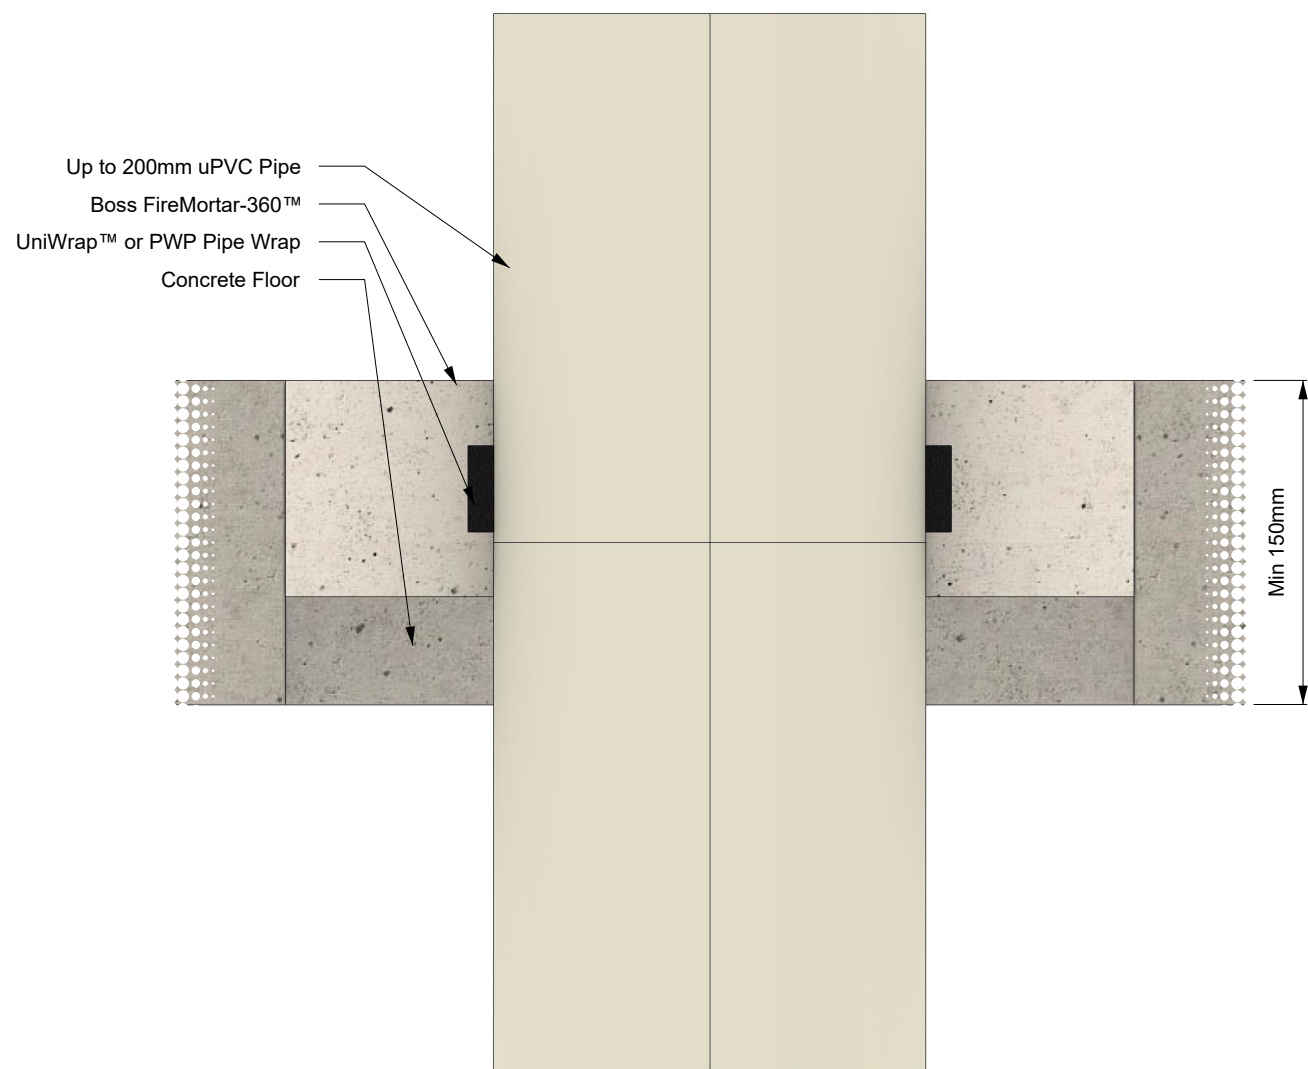

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS UniWrap™	-	Up to 200 mm uPVC pipe with 7.7 mm – 9.6 mm maximum wall thickness, penetrating a 1400 mm x 700 mm aperture filled with 100 mm thick BOSS FireMortar-360 gypsum based mortar, flush with the top face of the floor. 10 layers of BOSS UniWrap™ or BOSS PWP Pipe Wrap cast into the BOSS FireMortar-360 mid-depth of the floor.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS PWP Pipe Wrap	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	Boss FireMortar-360™	-		Report Reference:		WF FAS 210203	
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2898.25	
Min Substrate Thickness (mm):	150	Up to 1400 x 700	0		Date:	07/08/25	Rev:	01
Sealant Depth (mm):	-	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/90/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.