
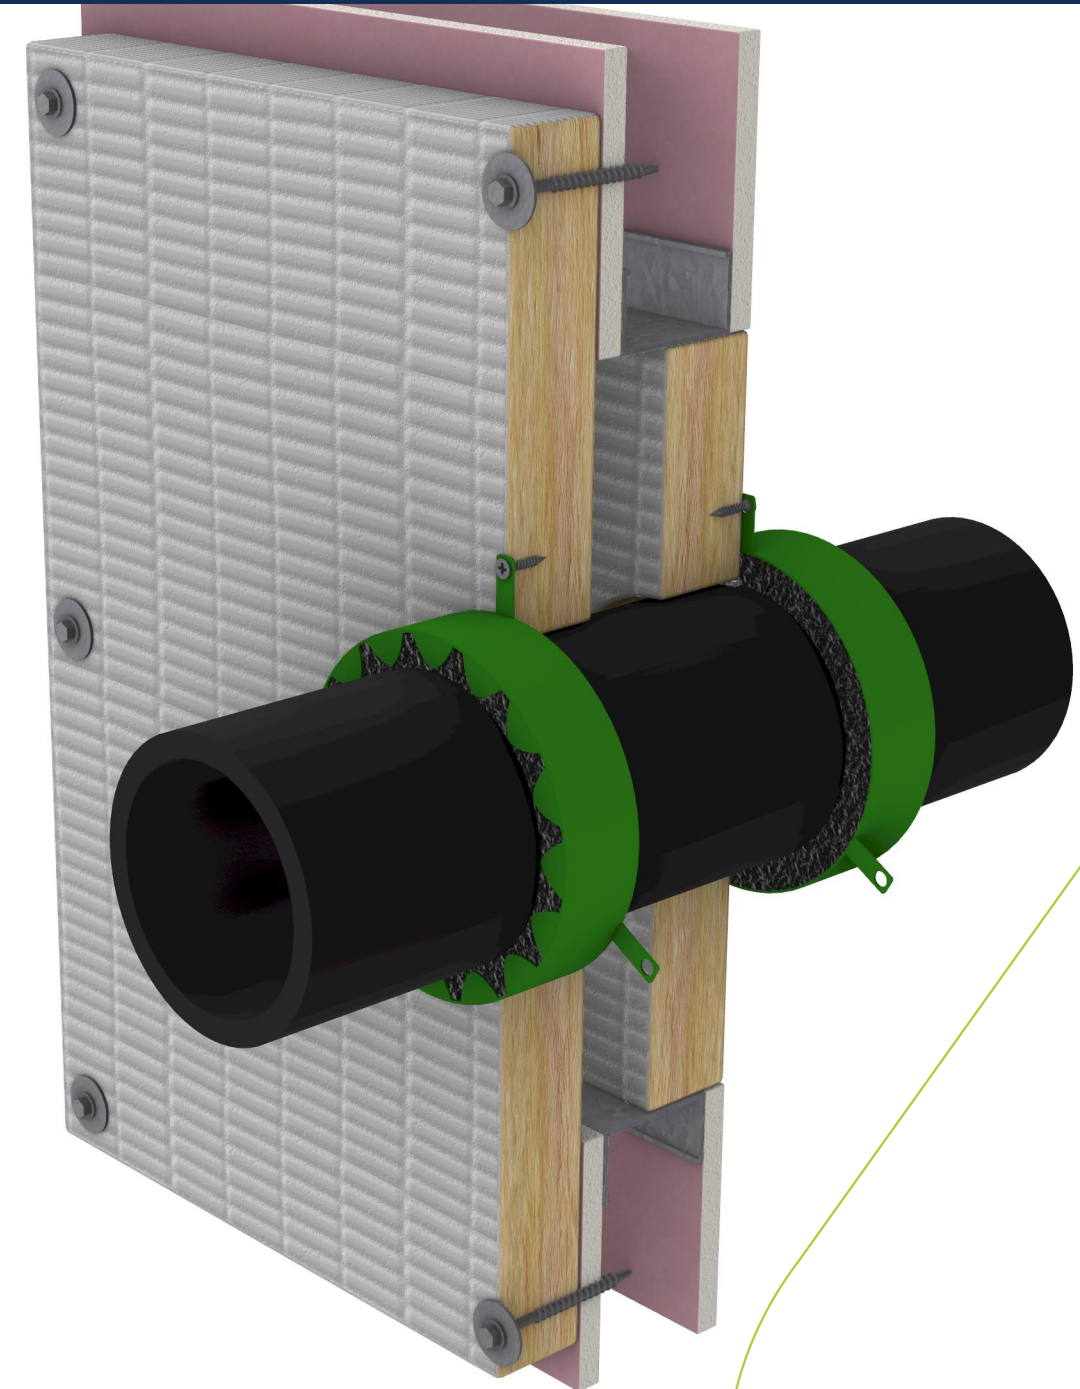


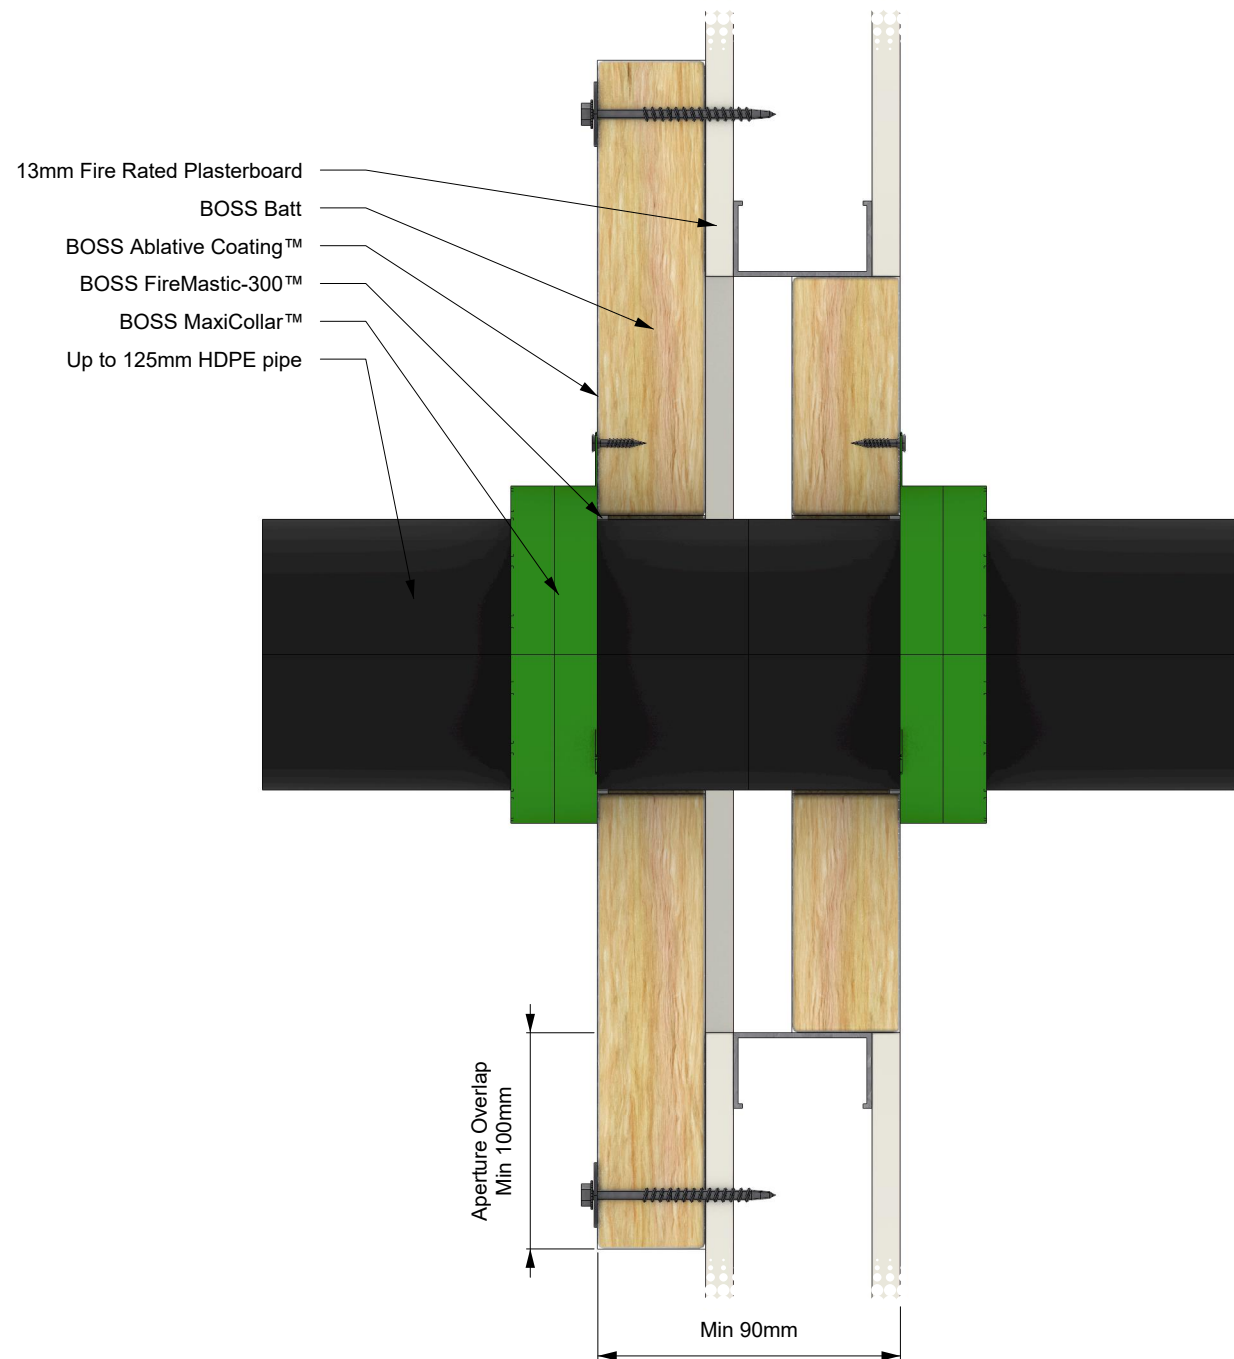

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS FireMastic-300™	Up to 125 mm HDPE pipe with 11.75 mm maximum wall thickness, penetrating 2 layers of BOSS Batt™ protecting an aperture up to 1200 mm x 500 mm. Sealant 5 mm deep in 2.0 mm annular gap both sides. 125 mm BOSS Maxi-Collar™ installed on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	HDPE	BOSS MaxiCollar™	-		Report Reference:		WF FAS 210203	
Substrate:	Single Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2976.1	
Min Substrate Thickness (mm):	90.0	Up to 1200 x 500	2.0		Date:	20/08/25	Rev:	01
Sealant Depth (mm):	5.0	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/30/30							