
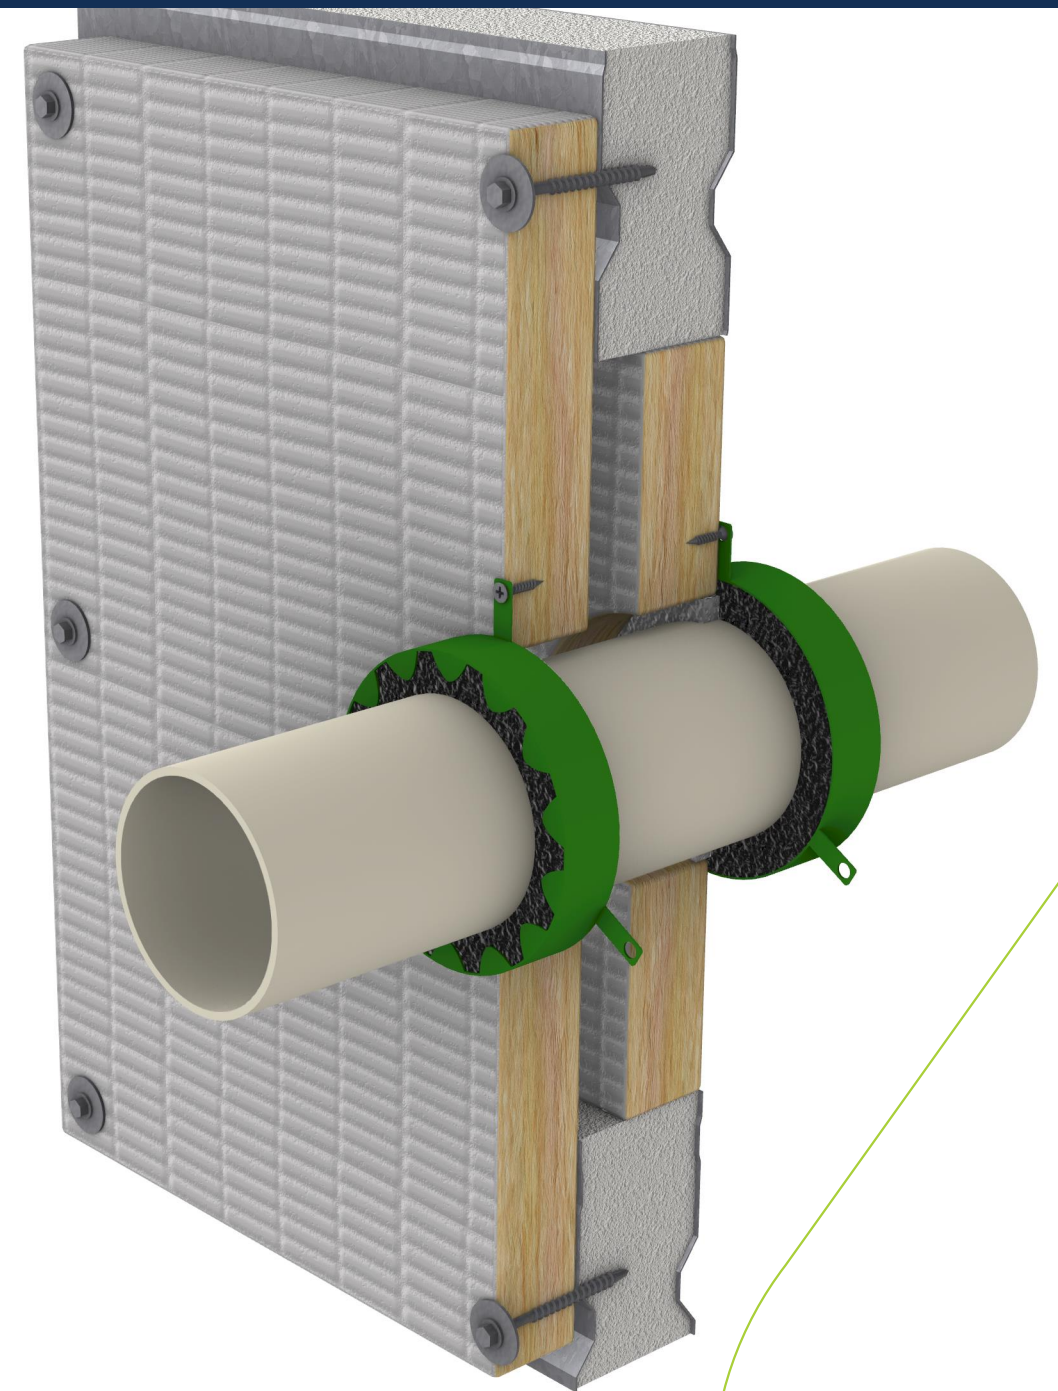


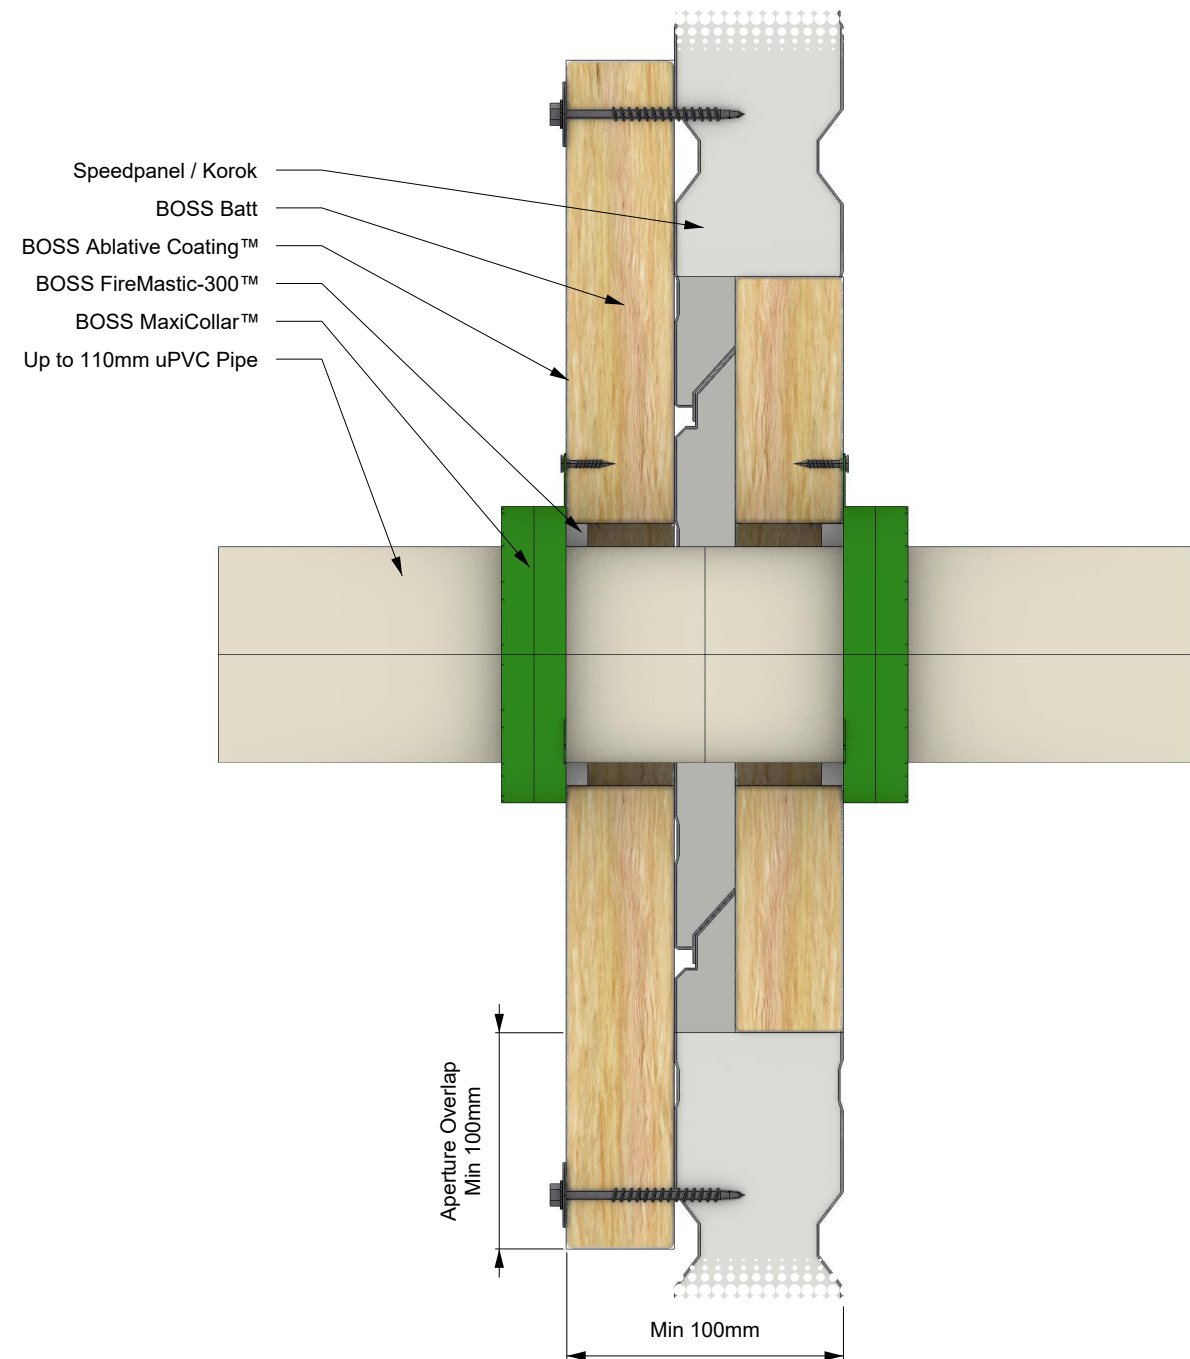

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS FireMastic-300™	Up to 110 mm uPVC pipe with 4.2 - 7.4 mm maximum wall thickness, penetrating 2 layers of BOSS Batt™ protecting an aperture up to 1200 mm x 500 mm. Sealant 12.5 mm deep in 10.0 mm annular gap both sides. 110 mm BOSS MaxiCollar™ installed on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	BOSS MaxiCollar™	-		Report Reference:		WF FAS 210203	
Substrate:	Speedpanel / Korok	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2991.6	
Min Substrate Thickness (mm):	100	Up to 1200 x 500	10.0		Date:		14/08/25	Rev:
Sealant Depth (mm):	12.5	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							