
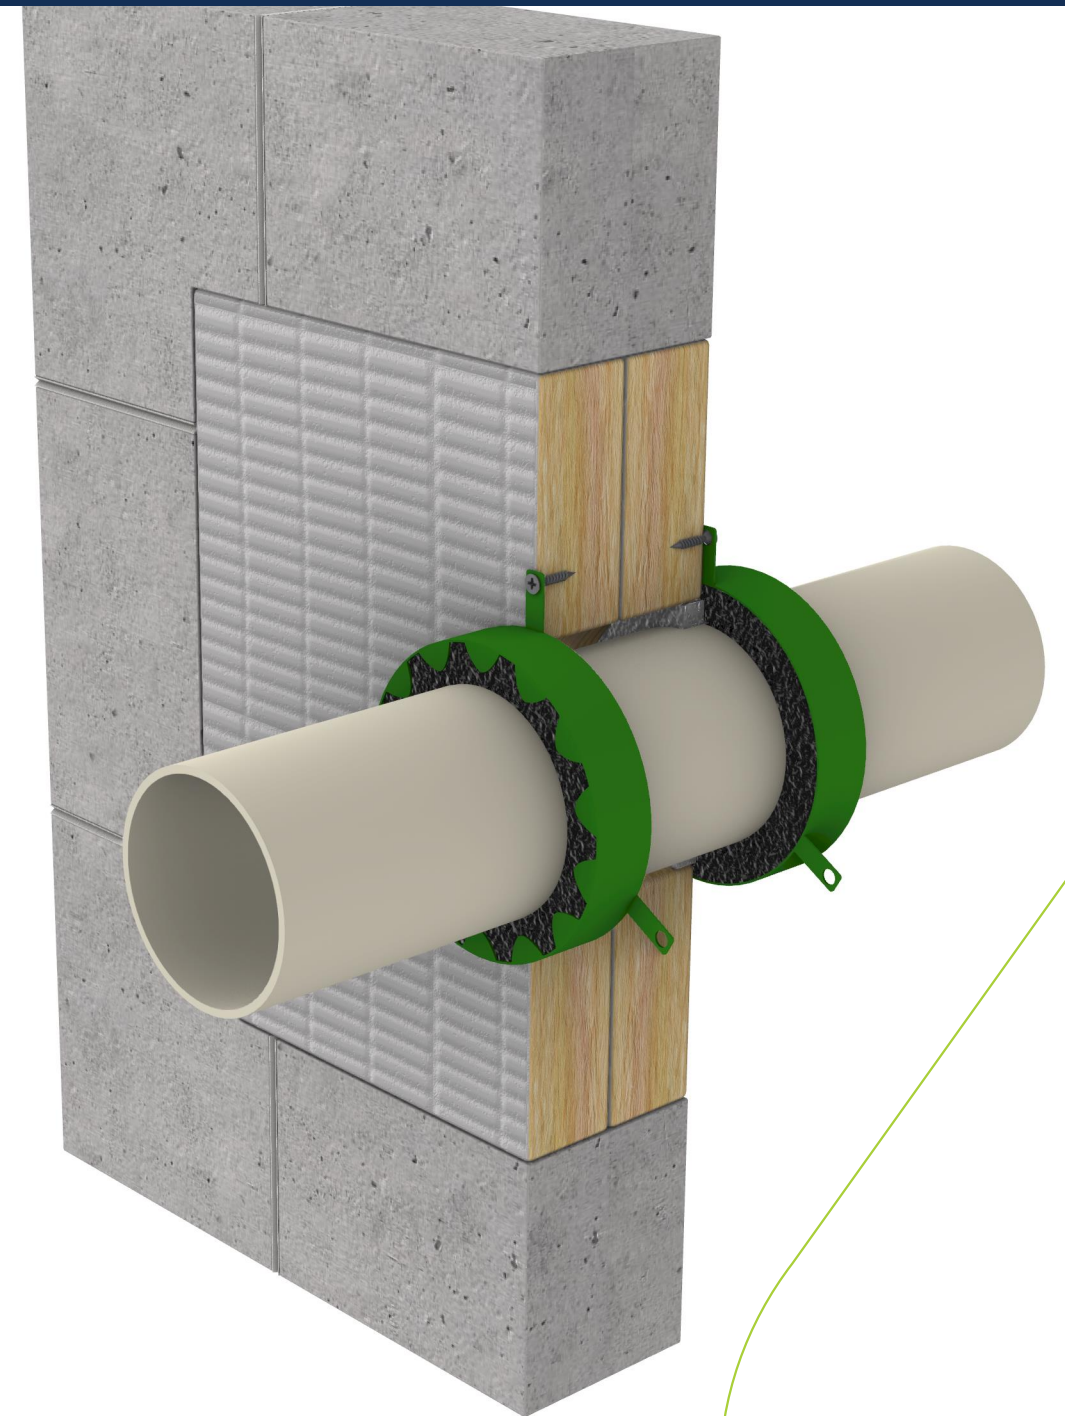


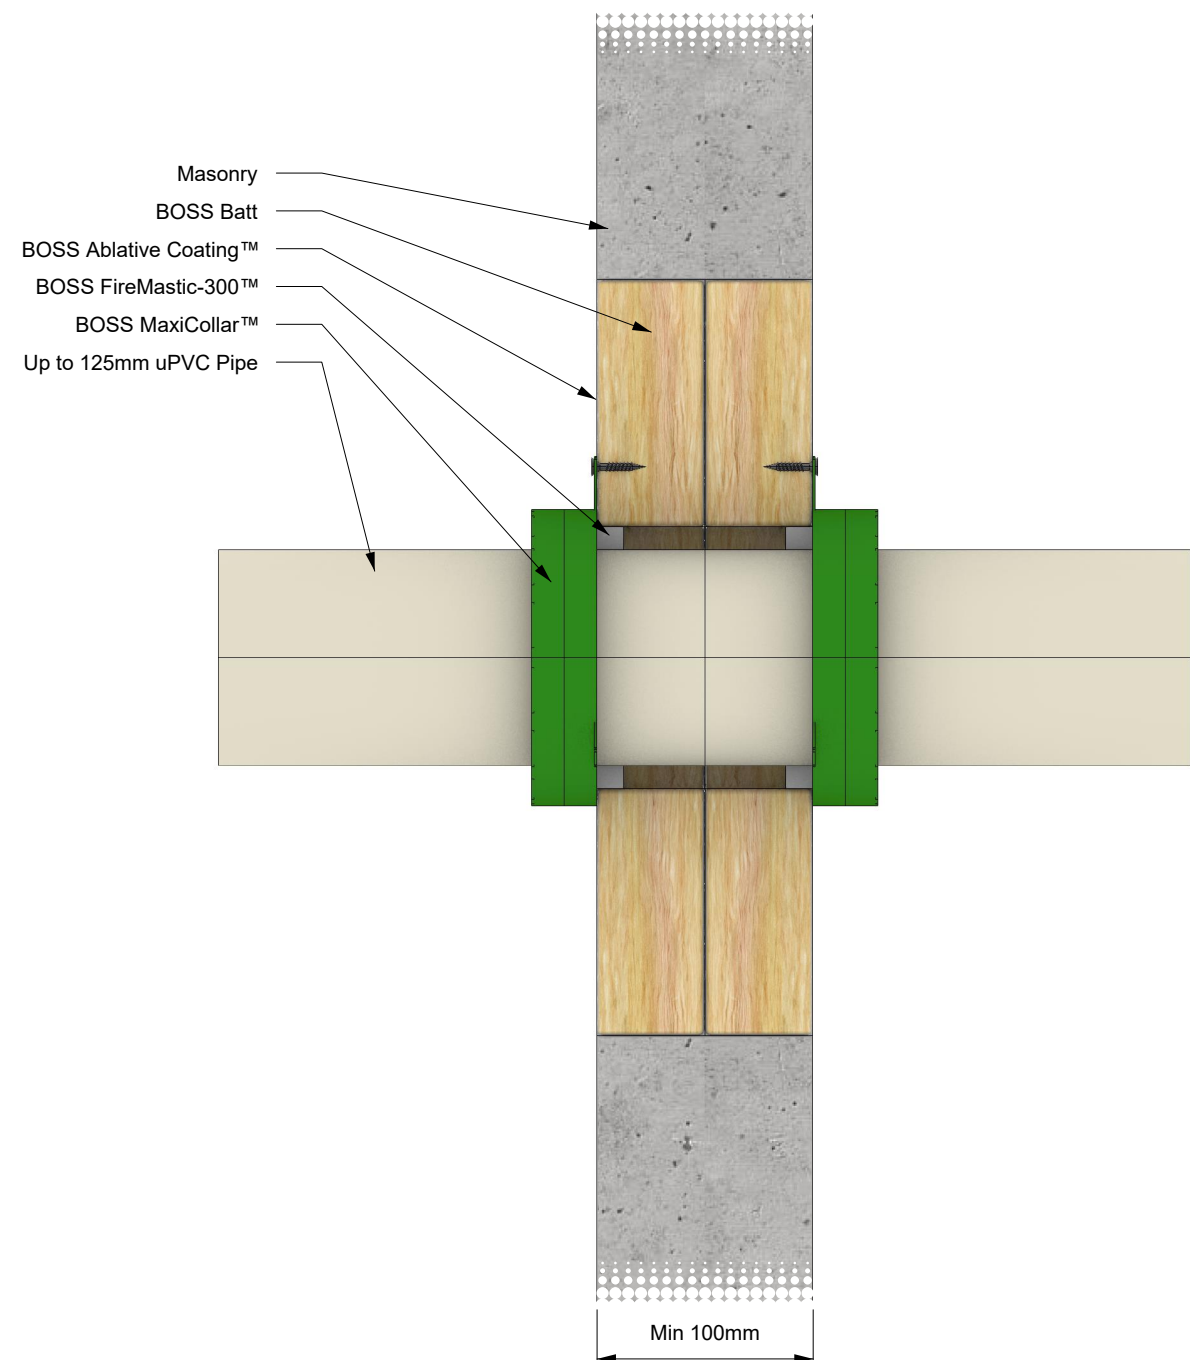

SYSTEM DESCRIPTION

Orientation:	Wall
Trade / Type:	Plumbing / Hydraulic / Active Fire
Service:	UPVC
Substrate:	Masonry
Min Substrate Thickness (mm):	100
Sealant Depth (mm):	12.5
Sealant Fillet (mm):	-
Wrap Length (mm):	-
FRL / FRR:	-/120/120

FIRE STOPPING INFORMATION

BOSS Batt™	BOSS FireMastic-300™
BOSS Ablative Coating™	-
BOSS MaxiCollar™	-
APERTURE (mm)	ANNULAR GAP (mm)
Up to 1200 x 500	10.0
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

Up to 125 mm uPVC pipe with 6.0 mm maximum wall thickness, penetrating 2 layers of BOSS Batt™ protecting an aperture up to 1200 mm x 500 mm. Sealant 12.5 mm deep in 10.0 mm annular gap both sides. 125 mm BOSS MaxiCollar™ installed on both sides.

SUPPORTING INFORMATION

Reference Standard:		AS 1530.4:2014	
Supplementary Standard:		AS 4072.1-2005	
Report Reference:		WF FAS 210203	
Drawing Number:		BF-2992.5	
Date:	14/08/25	Rev:	01