
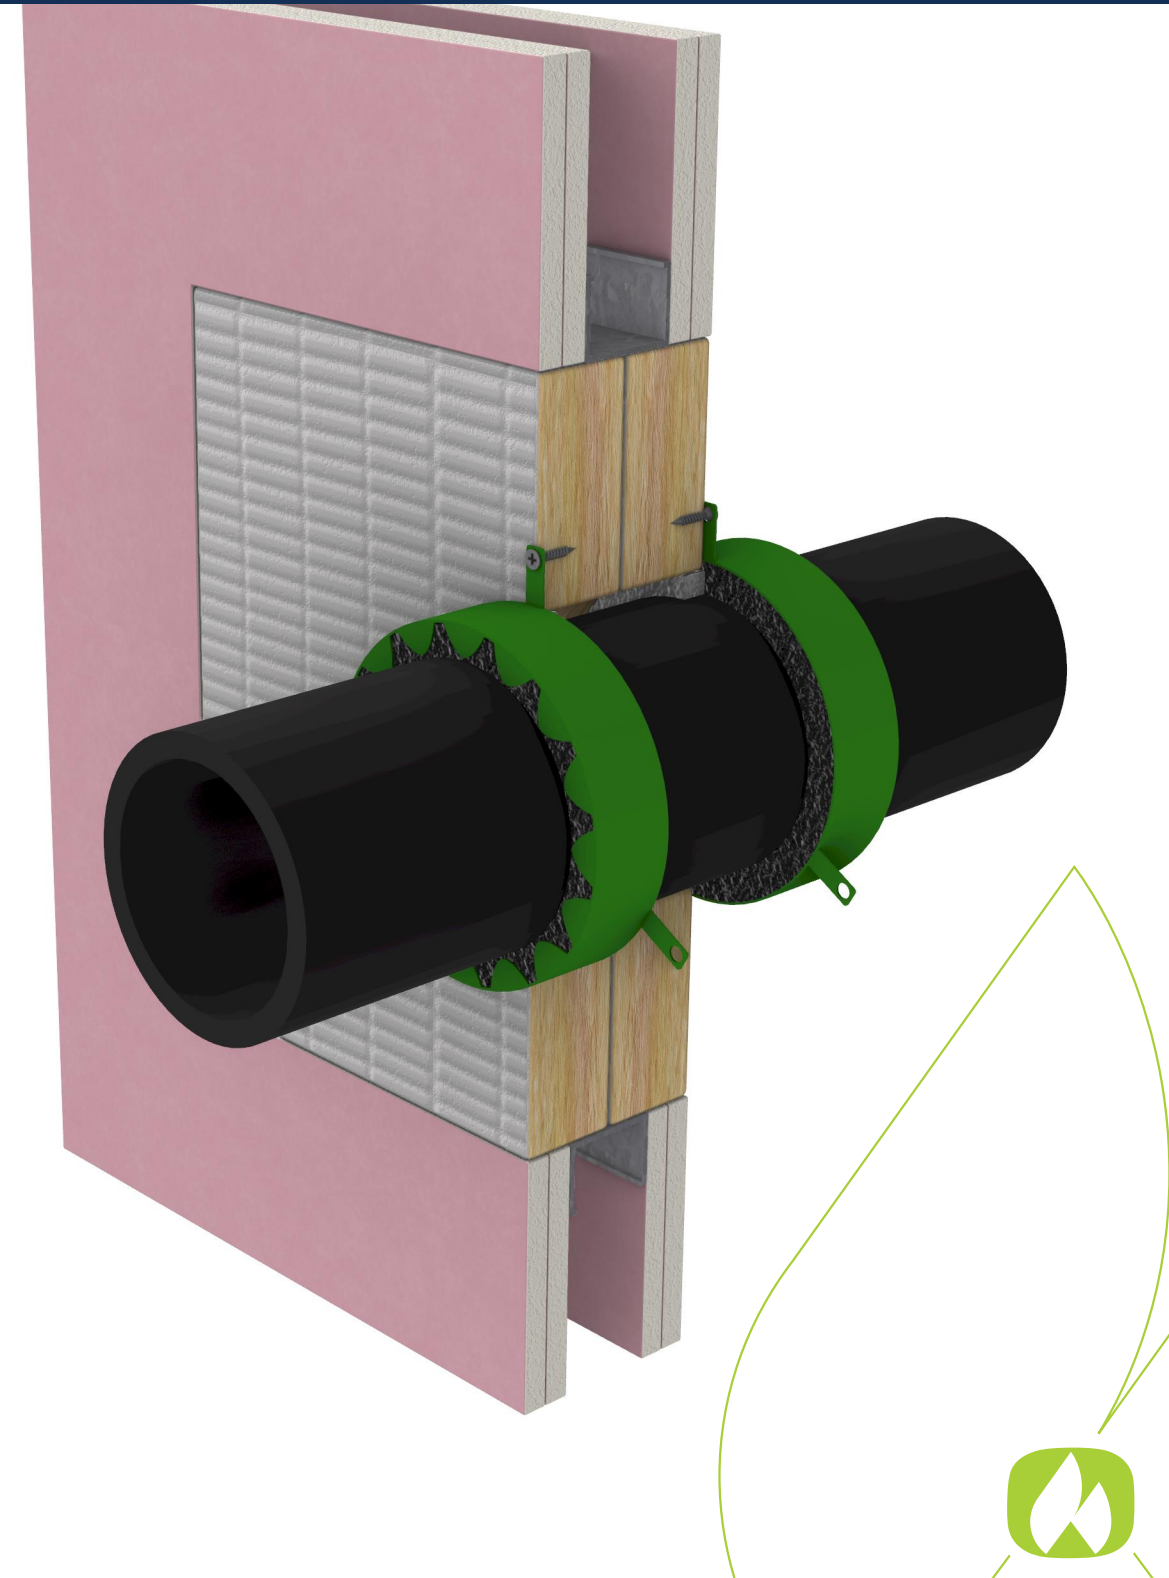


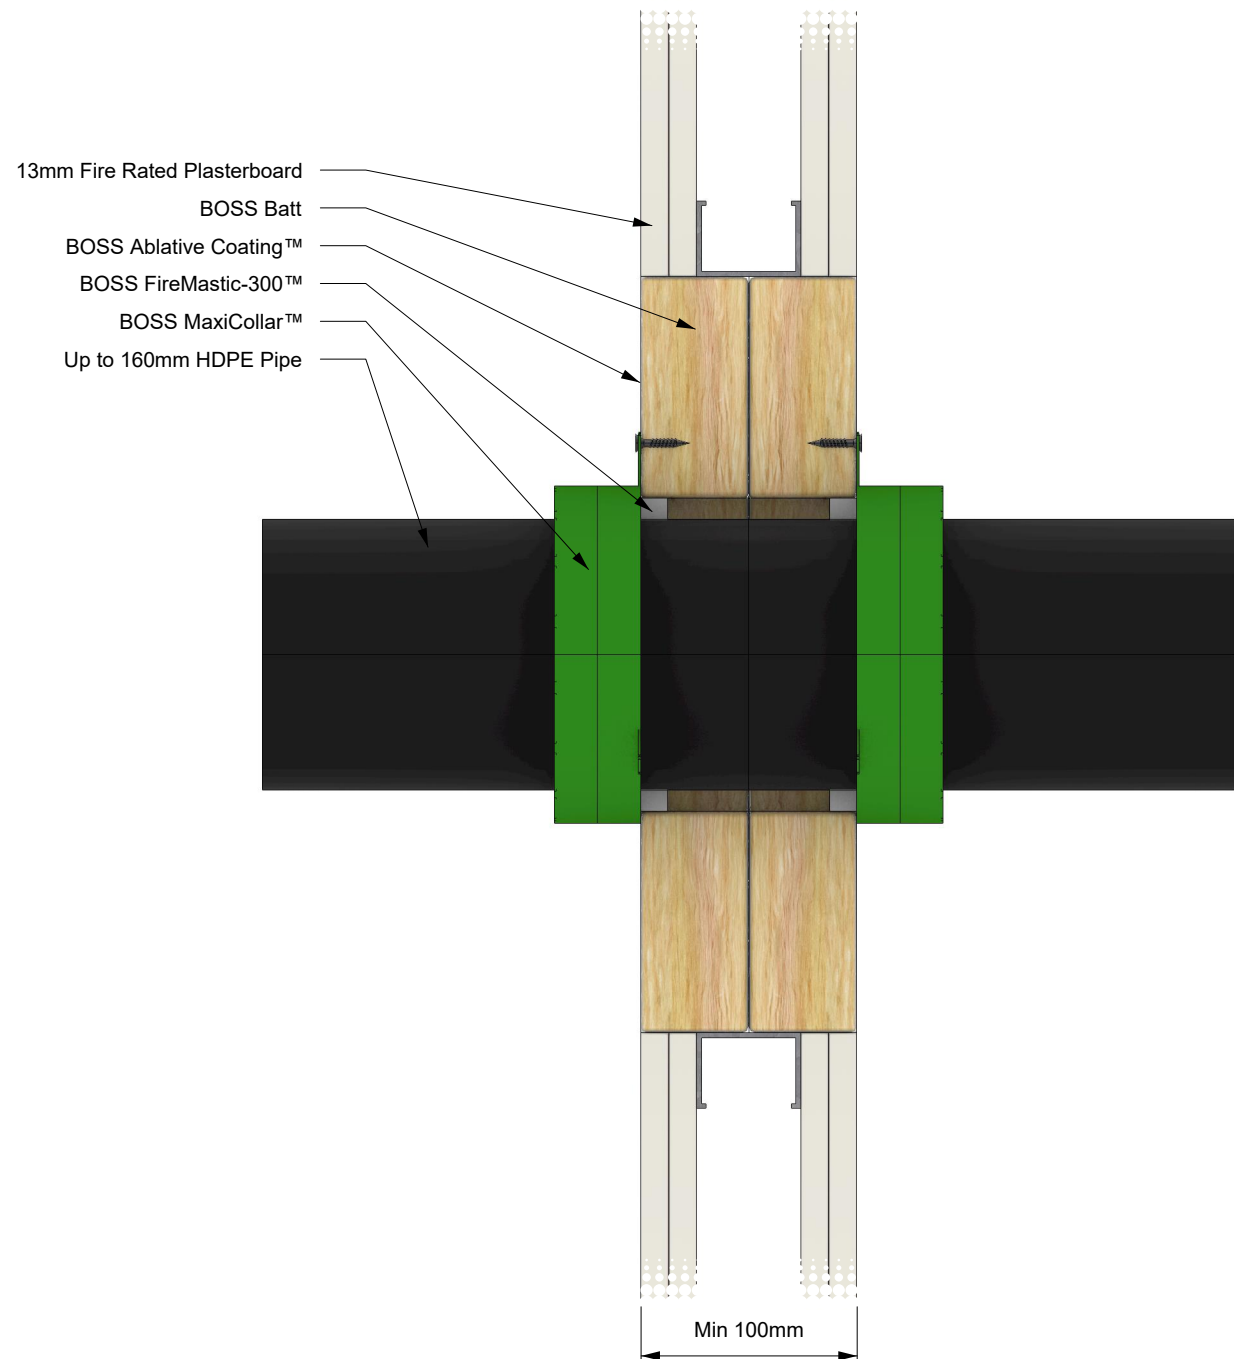

| SYSTEM DESCRIPTION            |                                             | FIRE STOPPING INFORMATION |                      | SERVICE SIZE & DETAILS                                                                                                                                                                                                                                         | SUPPORTING INFORMATION  |  |                |      |
|-------------------------------|---------------------------------------------|---------------------------|----------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------|--|----------------|------|
| Orientation:                  | Wall                                        | BOSS Batt™                | BOSS FireMastic-300™ | Up to 160 mm HDPE pipe with 4.9 mm – 9.5 mm maximum wall thickness, penetrating 2 layers of BOSS Batt™ protecting an aperture up to 1200 mm x 500 mm. Sealant 12.5 mm deep in 10.0 mm annular gap both sides. 160 mm BOSS MaxiCollar™ installed on both sides. | Reference Standard:     |  | AS 1530.4:2014 |      |
| Trade / Type:                 | Plumbing / Hydraulic / Active Fire          | BOSS Ablative Coating™    | -                    |                                                                                                                                                                                                                                                                | Supplementary Standard: |  | AS 4072.1-2005 |      |
| Service:                      | HDPE                                        | BOSS MaxiCollar™          | -                    |                                                                                                                                                                                                                                                                | Report Reference:       |  | WF FAS 210203  |      |
| Substrate:                    | Double Layer Fire Rated Plasterboard System | APERTURE (mm)             | ANNULAR GAP (mm)     |                                                                                                                                                                                                                                                                | Drawing Number:         |  | BF-2999.2      |      |
| Min Substrate Thickness (mm): | 100                                         | Up to 1200 x 500          | 10.0                 |                                                                                                                                                                                                                                                                | Date:                   |  | 14/08/25       | Rev: |
| Sealant Depth (mm):           | 12.5                                        | ADDITIONAL INFORMATION    |                      |                                                                                                                                                                                                                                                                |                         |  |                | 01   |
| Sealant Fillet (mm):          | -                                           |                           |                      |                                                                                                                                                                                                                                                                |                         |  |                |      |
| Wrap Length (mm):             | -                                           |                           |                      |                                                                                                                                                                                                                                                                |                         |  |                |      |
| FRL / FRR:                    | -/120/120                                   |                           |                      |                                                                                                                                                                                                                                                                |                         |  |                |      |