
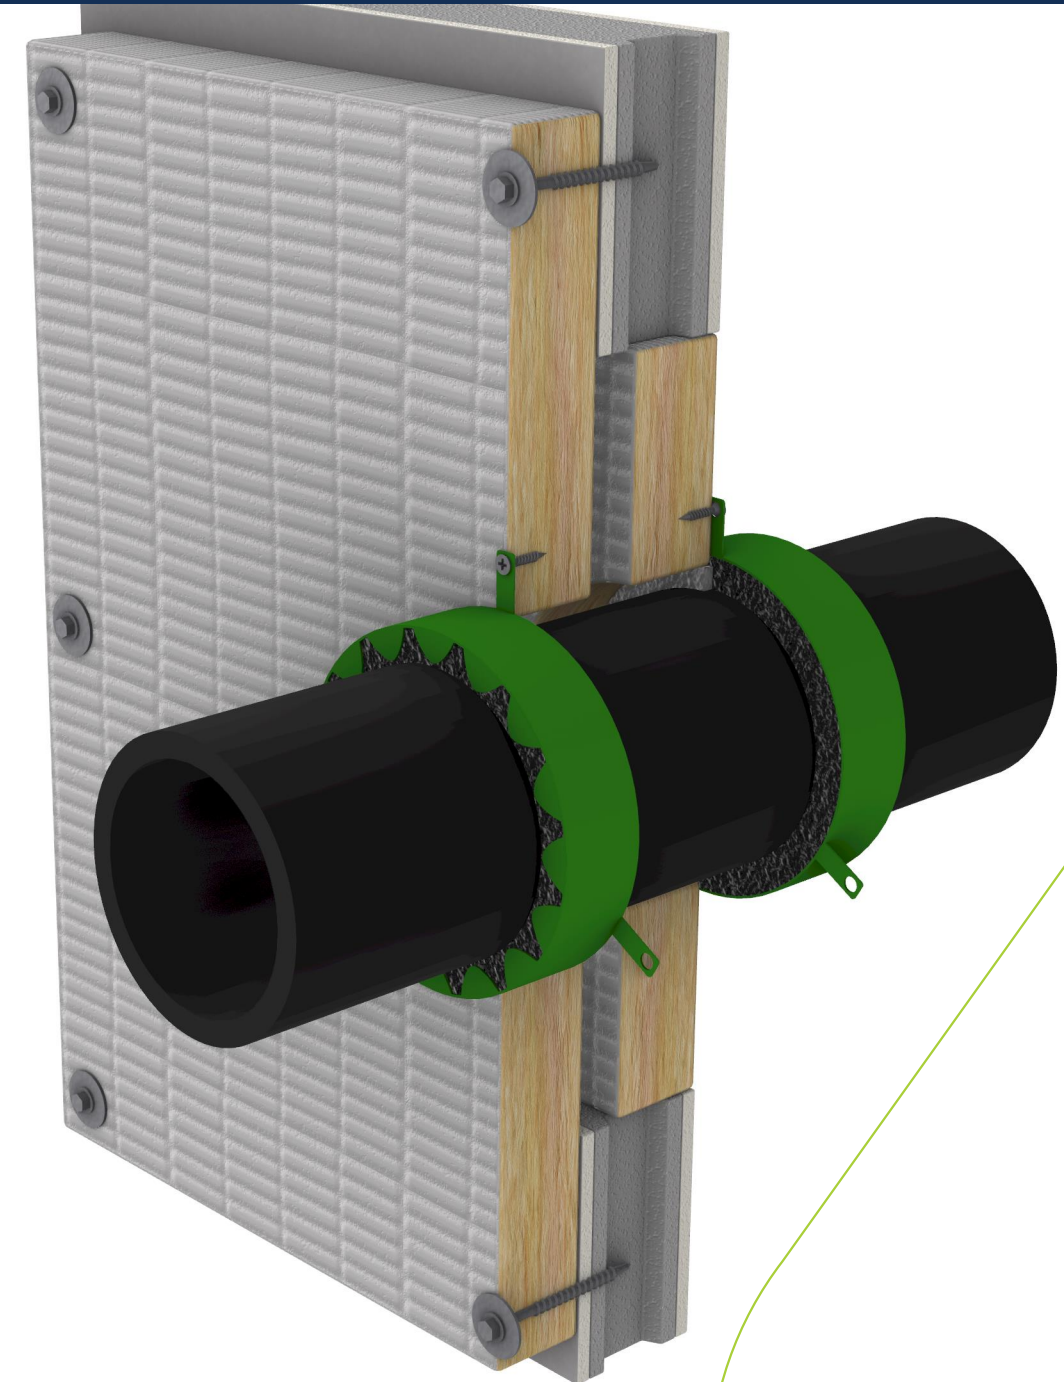


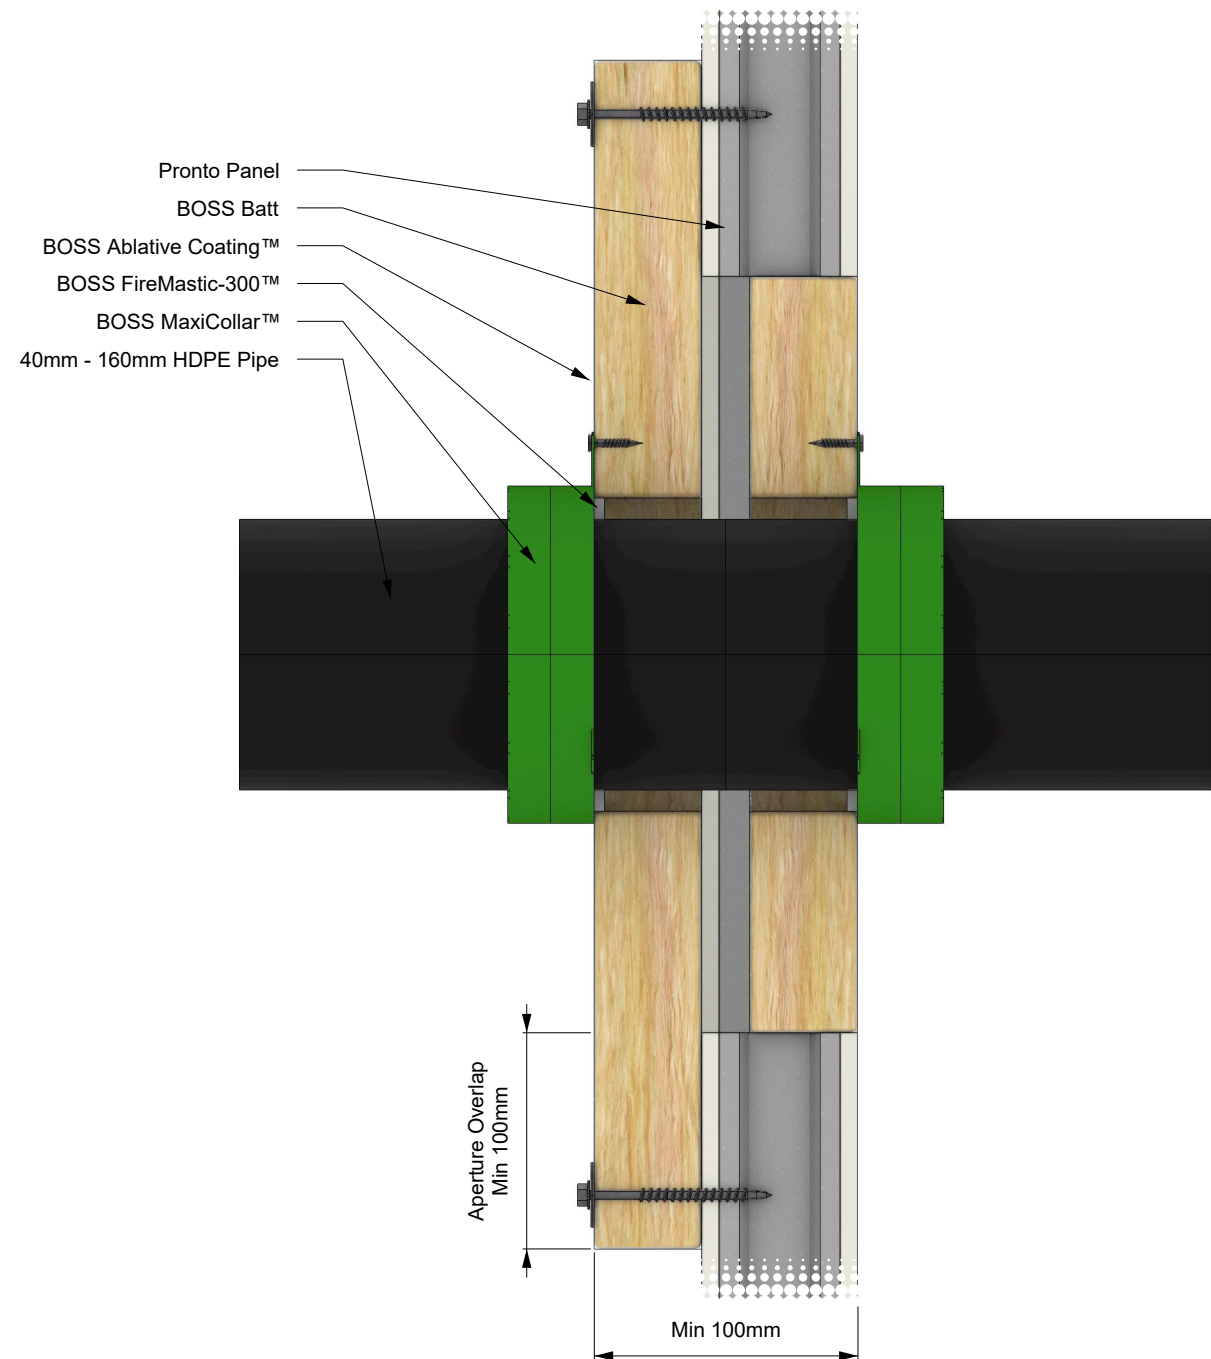

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS Batt™	BOSS FireMastic-300™	40 mm - 160 mm HDPE pipe with 3.2 mm - 14.5 mm maximum wall thickness, penetrating 2 layers of BOSS Batt™ protecting an aperture up to 1200 mm x 500 mm. Sealant 5.0 mm deep in 10.0 mm annular gap both sides. BOSS MaxiCollar™ relative to pipe size, installed on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Ablative Coating™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	HDPE	BOSS MaxiCollar™	-		Report Reference:		WF FAS 210203	
Substrate:	Pronto Panel	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-3000.8	
Min Substrate Thickness (mm):	100	Up to 1200 x 500	10.0		Date:		14/08/25	Rev:
Sealant Depth (mm):	5	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	-							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							